

Filed November 11, 1969
10:49 am

Ind 8


STATE OF WISCONSIN)
) SS.
DEPARTMENT OF INDUSTRY,)
LABOR AND HUMAN RELATIONS)

TO ALL TO WHOM THESE PRESENTS SHALL COME, GREETINGS:

I, Stephen J. Reilly, Executive Secretary of the Department of Industry, Labor and Human Relations, and custodian of the official records of said Department do hereby certify that the annexed rules and regulations, relating to flammable liquids, were duly approved and adopted by this Department on November 5, 1969.

I further certify that said copy has been compared by me with the original on file in this Department and that the same is a true copy thereof, and of the whole of such original.

IN TESTIMONY WHEREOF, I have hereunto set my hand and affixed the official seal of the department at the Capirol, in the city of Madison, this 7 day of November, A. D., 1969.

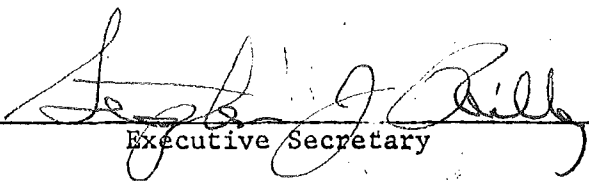

Executive Secretary

ORDER OF THE DEPARTMENT OF INDUSTRY, LABOR AND HUMAN RELATIONS
ADOPTING, AMENDING OR REPEALING RULES

Pursuant to authority vested in the Department of Industry, Labor and Human Relations by section 101.01 to 101.29 Wis. Stats., the Department of Industry, Labor and Human Relations hereby creates and adopts rules as follows:

Section Ind 8.62 (6) is created to read:

- (6) Attendance or supervision of dispensing. (a) Each service station open to the public shall have an attendant or supervisor on duty whenever the station is open for business. The attendant shall supervise individual dispensing devices except as provided in Ind 8.63 (4).
- (b) Service stations not accessible to or open to the public do not require an attendant or supervisor. Such station shall be used only by commercial, industrial or manufacturing establishments.

Section Ind 8.63 (2)(a) is amended to read:

- (a) Class I and Class II flammable liquids shall be transferred from underground tanks by means of fixed pumps so designed and equipped as to allow control of the flow and to prevent leakage or accidental discharge. Class I or Class II flammable liquids shall not be transferred from any storage tank by any equipment or procedure which subjects the shell of the storage tank to pressures above its allowable working pressure. Air or gas pressure shall not be used for this purpose.

Section Ind 8.63 (2)(e) is created to read:

- (e) Self-service. Only owners, operators, or trained employes shall dispense gasoline to the general public, except that the commission may approve self-service if construction and supervision standards are as outlined in section Ind 8.63 (4).
1. Approval of the department must be obtained for all service stations to be converted to self-service and all newly constructed self-service stations. Applicants must submit full information and plans in triplicate.

Ind 8.63 (4) is repealed and recreated to read:

- (4) Automatic dispensing units. (a) Underwriters' Laboratories approved special dispensing devices such as, but not limited to, money operated, card operated, and remote preset types are permitted at self-service stations, provided that dispensing of Class I liquids is under the observation of an authorized attendant at all times and provided that emergency controls are clearly indentified, easily accessible and located within 15 feet of the attendant's control station. Instructions for operation of dispensing devices shall be conspicuously posted.


- (b) The observation and control of the special dispensing devices shall be the sole function of the attendant. The attendant shall be regularly instructed in all appropriate regulations pertaining to dispensing, use of approved containers, and smoking restrictions.
- (c) A reliable 2-way communication system shall be installed between the attendant's observation station and each set of pumps or island.

Ind 8.63 (5) is repealed and recreated to read:

- (5) Delivery nozzles. (a) Hose nozzle valves of either the manual or automatic-closing type for dispensing Class I liquids into a fuel tank or into a container shall be manually held open during the dispensing operation except as provided in (5)(b).
- (b) On any service station dispenser accessible to the public a listed automatic-closing type nozzle with latch-open device is permitted only when all dispensing of Class I liquids is to be done by the service station attendant.
- (c) If the dispensing of Class I liquids at a self-service station available and open to the public is to be done by a person other than the service station attendant, the nozzle shall be a listed automatic-closing type without a latch-open device.

The rules shall become effective on the first day of the month following publication in the Wisconsin Administrative Code as provided in Section 227 Wis. Stats.

DEPARTMENT OF INDUSTRY, LABOR AND HUMAN RELATIONS

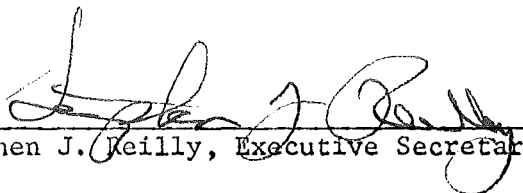

Stephen J. Keilly, Executive Secretary

November 7, 1969