

APPENDIX

CHAPTER Ind 20

CITY OF MADISON DIVISION OF COMMUNITY DEVELOPMENT 100 SOUTH MONROE STREET MADISON, WISCONSIN 53703 TEL: 265-3100 FAX: 265-3101		<b>WISCONSIN UNIFORM                      BUILDING PERMIT                      APPLICATION</b>				PERMIT NO. _____ PARCEL NO. _____
<b>PERMIT REQUESTED</b>		CONST	HVAC	ELEC	PLUMB	
Owner's Name _____		Mailing Address _____				Telephone _____
Contractor's Name _____		Mailing Address _____				Telephone _____
<b>PROJECT LOCATION</b>		SECTION _____				_____
Building Address _____		Subdivision Name _____		Lot No. _____	Block No. _____	Sheet No. _____
zoning District _____	lot Area _____	setbacks _____	front _____	rear _____	left _____	right _____
<b>1. PROJECT</b>	<b>2. TYPE</b>	<b>3. ELECTRICAL</b>	<b>4. HVAC EQUIPMENT</b>	<b>5. ENERGY SOURCES</b>		
New Addition Alteration Garage <input type="checkbox"/> Attached <input type="checkbox"/> Detached Other: _____ Manufacture (if applicable) _____	Single family Two family Other	Entrance Panel Service Single ground Double	Forced Air Furnace Radiant Baseboard Heating Radiant Heating Electric Central Air Conditioning Other: _____	Fuel _____ Solar _____ Wind _____ Geothermal _____ Other _____		
<b>9. AREA</b>	<b>6. CONST. TYPE</b>	<b>7. FOUNDATION</b>		<b>8. PLUMBING</b>		<b>12. WATER</b>
Basement _____ sq ft Living Area _____ sq ft Garage _____ sq ft	Sitecast Manufactured	Concrete Masonry Treated Wood Other: _____		Water pit Sewer Rainwater		
<b>10. STORIES</b>	<b>11. USE</b>					
1 Story 2 Story Other: _____	Residential Commercial Other: _____					
The applicant agrees to comply with the Wisconsin Uniform Building Code and other applicable laws and regulations and to hold the issuer of the permit harmless for any loss or expense incurred by the Department of Community Development as a result of the applicant's failure to comply with the above.						
<b>SIGNATURE OF APPLICANT</b> _____		<b>DATE</b> _____				
<b>CONDITIONS OF APPROVAL</b>						
<b>13. ISSUING JURISDICTION</b>						
VILLAGE _____		CITY _____	TOWN _____	COUNTY _____	STATE _____	
NAME _____		MUNICIPALITY NO. _____				
<b>FEES</b>	<b>PERMIT ISSUED</b>	<b>MS. UNIFORM PERMIT SEAL NO. 151</b>		<b>PERMIT ISSUED BY</b>		
PLAN REVIEW \$ _____ INSPECTION _____ WIS. PERMIT SEAL(S) _____ OTHER \$ _____ <b>TOTAL \$ _____</b>	CONST _____ HVAC _____ ELEC _____ PLUMB _____	_____ _____		NAME _____ DATE _____ CERT. NO. _____		

DILHR 680-5823

Site Info	
SUBDIVISION	BLOCK NO
LOT NO	ZONING DISTRICT
TOWN, VILLAGE OR CITY	
SETBACKS	
FRONT YARD	feet
REAR YARD	feet
LEFT YARD	feet
RIGHT YARD	feet

# WISCONSIN UNIFORM BUILDING PERMIT

Inspection		
PHASE	RHG	FNL
FOUNDATION		
CONSTRUCTION		
INSULATION		
PLUMBING		
HEAT VENT/AC		
ELECTRICAL		
OCCUPANCY		

const;  hvac;  elec;  plumb;

<b>Issued to</b>	OWNER (AGENT)
	BUILDING SITE ADDRESS
	CITY, VILLAGE, TOWN, COUNTY

<b>Issued by</b>	MUNICIPALITY OR AUTHORIZED AGENCY	<small>If the permit was transferred, attach it here.</small>	
	PERSON		CERT NO
	ISSUING DATE		TELEPHONE NUMBER
	ISSUED		

**NOTICE OF NONCOMPLIANCE**

This issuing jurisdiction shall notify the applicant in writing of any violations to be corrected. All such violations shall be corrected within 30 days after notification, unless extension of time is granted.

Keep this card posted until final inspection has been made. Inspection shall be arranged 48 hrs. in advance. Work shall not proceed until the inspector has approved the various stages of construction on the job. The set back permit fee has elapsed. This permit will expire 24 months after the date of issuance. Construction has not commenced.

Register, February, 1980, No. 290

## APPENDIX

## CHAPTER Ind 21

FASTENER SCHEDULE TABLE

Description of Building Materials/Connection	Number and Type of Fastener <sup>1 2 3 4</sup>
Joist to sill or girder, toe nail	2-16d, 3-8d
Bridging to joist, toe nail each end	2-8d
1" x 6" subfloor or less to each joist, face nail	2-8d or 2 staples, 1 3/4"
Wider than 1" x 6" subfloor to each joist, face nail	3-8d or 4 staples, 1 3/4"
2" subfloor to joist or girder, blind and face nail	2-16d
Sole plate to joist or blocking, face nail	16d at 16" o.c.
Top or sole plate to stud, end nail	2-16d
Stud to sole plate, toe nail	4-8d or 3-16d
Doubled studs, face nail	16d at 24" o.c.
Doubled top plates, face nail	16d at 16" o.c.
Top plates, laps and intersections, face nail	2-16d
Continuous header, two pieces	16d at 16" o.c. along each edge
Ceiling joists to plate, toe nail	2-16d, 3-8d
Continuous header to stud, toe nail	4-8d
Ceiling joist, laps over partitions, face nail	3-16d
Ceiling joist to parallel rafters, face nail	3-16d
Rafter to plate, toe nail	2-16d, 3-8d
1" brace to each stud and plate, face nail	2-8d or 2 staples, 1 3/4"
1" x 6" sheathing to each bearing, face nail	2-8d or 2 staples, 1 3/4"
1" x 8" sheathing to each bearing, face nail	2-8d or 3 staples, 1 3/4"
Wider than 1" x 8" sheathing to each bearing, face nail	3-8d or 4 staples, 1 3/4"
Built-up corner studs	16d at 30" o.c., 16d at 24" o.c.
Built-up girder and beams	20d at 32" o.c. at top and bottom and staggered 2-20d at ends and at each splice
2-inch planks	2-16d at each bearing
Roof rafters to ridge, valley or hip rafters, toe nail	4-16d
Roof rafters to ridge, valley or hip rafters, face nail	3-16d
Collar ties to rafters, face nail	3-8d
Plywood subfloor, roof and wall sheathing (to framing) <sup>4</sup>	
3/8-inch to 5/16-inch	6d <sup>3</sup> or staple
3/8-inch to 1/2-inch	8d smooth or common, 6d deformed, or staple
1/2-inch to 1-inch	8d <sup>3</sup>
1 1/4-inch to 1 1/2-inch	10d smooth or common, or 8d deformed
Fiberboard sheathing <sup>7</sup>	
3/8-inch	6d common or staple, 1 1/2" long or roofing nail <sup>11</sup>
25/32-inch	8d common or staple, 1 1/2" long or roofing nail <sup>11</sup>
Gypsum sheathing, 1/2"	1 1/2" galvanized roofing nail, or 6d common, or staple
Particleboard wall sheathing (to framing) <sup>4</sup>	
3/8-inch to 1/2-inch	6d common
3/8-inch to 3/4-inch	8d common or staple
Insulated sheathing	11-gauge roofing nails, 6d, 8d, or staple
Combination subfloor underlayment (to framing) <sup>4</sup>	
3/4-inch and less	6d deformed
3/8-inch to 1-inch	8d deformed
1 1/4-inch to 1 1/2-inch	10d smooth <sup>3</sup> or common or 8d deformed <sup>3</sup>
Panel siding (to framing) <sup>3</sup>	
1/2-inch or less	6d
3/8-inch	8d

<sup>1</sup>All nails are smooth-common, box or deformed shank except where otherwise stated.

<sup>2</sup>Nail is a general description and may be T-head, modified round head or round head.

<sup>3</sup>Staples are 16-gauge wire and have a minimum 7/16-inch o.d. crown width.

<sup>4</sup>Common or box nails may be used except where otherwise stated.

<sup>5</sup>Common or deformed shank.

<sup>6</sup>Nails spaced at 6 inches on center at edges, 12 inches at intermediate supports (10 inches at intermediate supports for floors), except 6 inches at all supports where spans are 48 inches or more.

<sup>7</sup>Nails spaced at 3 inches on center at edges, 6 inches at intermediate supports.

<sup>8</sup>Nails spaced at 4 inches on center at edges, 8 inches at intermediate supports.

<sup>9</sup>Nails spaced at 6 inches on center at edges and at intermediate supports.

<sup>10</sup>Corrosion-resistant siding and casing nails.

<sup>11</sup>Galvanized roofing nails with 7/16-inch diameter head and 1 1/2-inch length for 3/4-inch sheathing and 1 3/4-inch for 25/32-inch sheathing.

### SPAN TABLES FOR JOISTS AND RAFTERS (Recommended by National Forest Products Association)

#### EXPLANATION OF TABLES

These span tables for joists and rafters are calculated on the basis of a series of modulus of elasticity ( $E$ ) and fiber bending stress ( $F_b$ ) values. The range of values in the tables provides allowable spans for all species and grades of nominal 2-inch framing lumber customarily used in construction.

Tables J-1 through J-6 list spans for floor and ceiling joists used over a single span with calculations based on  $E$  and the required  $F_b$  values shown.

Tables R-1 through R-6 list spans for rafters used over a single span with calculations based on  $F_b$  and the required  $E$  values shown.

Tables TSJ-1 and TSJ-2 list spans for floor joists continuous over two equal spans with calculations based on  $E$  and the required  $F_b$  values shown.

Applicable design criteria for each condition of use appear at the top of each table. While these criteria are directed principally to residential construction, they are suitable for other occupancies having similar conditions of loading. Tabulated spans for rafters also apply to other types of occupancy, since the occupancy has little bearing on roof loading.

#### LUMBER SIZES

Tabulated spans apply to surfaced (S4S) lumber having dimensions which conform to the American Softwood Lumber Standard, PS 20-70. These sizes are as follows:

Reference	Dressed Size (inches)	
	Surfaced Dry	Surfaced Green
2 x 4	1 1/2 x 3 1/2	1-9/16 x 3-9/16
2 x 6	1 1/2 x 5 1/2	1-9/16 x 5 3/8
2 x 8	1 1/2 x 7 1/4	1-9/16 x 7 1/2

2 x 10	1½ x 9¼	1-9/16 x 9½
2 x 12	1½ x 11¼	1-9/16 x 11½

**MOISTURE CONTENT**

The listed dry and green sizes are related at 19% maximum moisture content. Tabulated spans are calculated on the basis of the dry sizes and are also applicable to the corresponding green sizes. The spans in these tables are intended for use in covered structures or where moisture content in use does not exceed 19%.

**SPAN MEASUREMENT**

Tabulated spans are the clear distance between supports. For sloping rafters, the span is measured along the horizontal projection.

**LUMBER DESIGN VALUES**

Use of these span tables requires reference to the applicable design values for the various species and grades of lumber. "Design Values for Joists and Rafters", a supplement to these span tables, provide such values in convenient-to-use form. Modulus of elasticity (E) and fiber bending stress ( $F_b$ ) values therein are based on the National Design Specification for Wood Construction (formerly National Design Specification for Stress Grade Lumber and Its Fastenings) and incorporate adjustments appropriate for repetitive-member use under various durations of load.

Repetitive-member use is that condition where framing members such as joists, rafters, studs, planks, decking or similar members are spaced not more than 24 inches, are not less than 3 in number and are joined by floor, roof or other load-distributing elements adequate to support the design load. Design values in bending ( $F_b$ ) for such use are 15% greater than for single-member use.

For rafters, design values in bending ( $F_b$ ) may be greater than the design values for normal duration of load, by the following amounts:

- 15% for 2 months' duration, as for snow.
- 25% for 7 days' duration, as for construction load.

The design value tables provide values for bending for repetitive-member use of joists and rafters under normal, 2-month and 7-day durations of load.

**ROOF LOADS**

Rafter spans are tabulated for the most common roof loads. For roof loads intermediate between those tabulated, straight line interpolation may be used.

**LUMBER IDENTIFICATION**

When used with the tabulated spans in these tables, lumber should be identified by the grademark of an agency recognized as being competent by the Board of Review of the American Lumber Standards Committee or the Canadian Lumber Standards Administrative Board.

**USE OF THE SPAN TABLES**

Spans for floor and ceiling joists are calculated on the basis of the modulus of elasticity (E) with the required fiber bending stress ( $F_b$ )

listed below each span. Spans for rafters are calculated on the basis of fiber bending stress ( $F_b$ ) with the required modulus of elasticity ( $E$ ) listed below each span. Use of the tables is illustrated in the examples which follow.

Example 1. Floor joists. Assume a required span of 12'-9", a live load of 40 psf and joists spaced 16 inches on centers. Table J-1 shows that a grade of 2 x 8 having an  $E$  value of 1,600,000 psi and an  $F_b$  value of 1250 psi would have a span of 12'-10", which satisfies the condition.

Example 2. Rafters. Assume a horizontal projection span of 13'-0", a live load of 30 psf, dead load of 15 psf and rafters spaced 16 inches on centers. Table R-2 shows that a 2x8 having an  $F_b$  value of 1300 psi and an  $E$  value of 1,000,000 psi would have a span of 13'-3" of horizontal projection.

Since many combinations of size, spacing,  $E$  and  $F_b$  values are possible, it is recommended that the users examine the tables to determine which combination fits their particular case most effectively.

TABLE J-1  
FLOOR JOISTS

40 Lbs. Per Sq. Ft. Live Load  
(All rooms except those used for sleeping areas and attic floors)

DESIGN CRITERIA  
Deflection - For 40 lbs. per sq. ft. live load  
Limited to span in inches divided by 360  
Strength - Live Load of 40 lbs. per sq. ft. plus  
dead load of 10 lbs. per sq. ft. determines the  
required fiber stress value.

JOIST SIZE SPACING (IN)	Modulus of Elasticity, "E", in 1,000,000 psi																			
	0.4	0.5	0.6	0.7	0.8	0.9	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	2.2	2.4	
2x6	12.0	6.9 450	7.3 520	7.9 590	8.2 660	8.6 720	8.10 780	8.2 830	8.6 890	9.0 940	9.0 990	10.0 1040	10.3 1090	10.6 1140	10.9 1190	10.11 1230	11.2 1280	11.4 1320	11.7 1410	12.3 1490
	13.7	6.6 470	7.0 550	7.5 620	7.9 690	8.2 750	8.6 810	8.9 870	9.1 930	9.4 980	9.7 1040	9.10 1090	10.0 1140	10.3 1190	10.6 1240	10.8 1290	10.10 1340	11.1 1380	11.5 1470	11.9 1560
	16.0	6.2 500	6.7 580	7.0 650	7.5 720	7.9 790	8.0 860	8.4 920	8.7 980	8.10 1040	9.1 1090	9.4 1150	9.6 1200	9.9 1250	9.11 1310	10.2 1360	10.4 1410	10.6 1460	10.10 1550	10.12 1640
	19.2	5.9 530	6.3 610	6.7 690	7.0 770	7.3 840	7.7 910	7.10 970	8.1 1040	8.4 1100	8.7 1150	8.9 1220	9.0 1290	9.2 1330	9.4 1390	9.6 1440	9.8 1500	9.10 1550	9.12 1650	10.2 1750
	24.0	5.4 570	5.9 650	6.2 750	6.6 830	6.9 900	7.0 980	7.3 1050	7.6 1120	7.9 1190	7.11 1250	8.2 1310	8.4 1380	8.6 1440	8.8 1500	8.10 1550	9.0 1610	9.2 1670	9.5 1780	9.9 1880
	32.0					6.2 1010	6.5 1090	6.7 1150	6.10 1230	7.0 1300	7.3 1390	7.5 1450	7.7 1520	7.9 1590	7.11 1660	8.0 1690	8.2 1760	8.4 1840	8.7 1950	8.10 2060
2x8	12.0	8.11 490	9.7 520	10.2 590	10.9 660	11.3 720	11.8 780	12.1 830	12.6 890	12.10 940	13.2 990	13.6 1040	13.10 1090	14.7 1140	14.5 1190	14.9 1230	15.0 1290	15.3 1320	15.6 1410	16.2 1490
	13.7	8.6 470	9.2 550	9.9 620	10.3 690	10.9 750	11.2 810	11.7 870	11.11 930	12.3 980	12.7 1040	12.11 1090	13.3 1140	13.6 1190	13.10 1240	14.1 1340	14.4 1380	14.7 1460	15.0 1550	15.6 1640
	16.0	8.1 500	8.9 580	9.3 650	9.9 720	10.7 790	10.7 850	11.0 920	11.4 980	11.8 1040	12.0 1090	12.3 1150	12.7 1200	12.10 1250	13.1 1310	13.4 1360	13.7 1410	13.10 1460	14.3 1550	14.8 1640
	19.2	7.7 530	8.2 610	8.9 690	9.2 770	9.7 840	10.0 910	10.4 970	10.8 1040	11.0 1100	11.3 1160	11.7 1220	11.10 1280	12.1 1330	12.4 1390	12.7 1440	12.10 1500	13.0 1550	13.5 1650	13.10 1750
	24.0	7.1 570	7.7 650	8.1 750	8.6 830	8.11 900	8.3 980	8.7 1050	9.1 1120	9.11 1190	10.2 1250	10.6 1310	10.9 1380	11.0 1440	11.3 1500	11.5 1550	11.8 1610	11.11 1670	12.1 1780	12.10 1880
	32.0					8.1 990	8.5 1080	8.9 1170	9.0 1230	9.3 1300	9.6 1370	9.9 1450	10.0 1520	10.2 1570	10.5 1650	10.7 1700	10.10 1790	11.0 1840	11.4 1950	11.8 2070



208	201	195	189	185	180	178	178	173	165	160	158	158	150	140	130	120	110	100	90	80	70	60	50	40	30	20	10	0	
208	201	195	189	185	180	178	178	173	165	160	158	158	150	140	130	120	110	100	90	80	70	60	50	40	30	20	10	0	
192	182	178	178	173	168	163	163	158	150	140	130	120	110	100	90	80	70	60	50	40	30	20	10	0	0	0	0	0	0
180	178	173	168	163	158	153	153	148	140	130	120	110	100	90	80	70	60	50	40	30	20	10	0	0	0	0	0	0	0
160	150	140	130	120	110	100	100	95	80	70	60	50	40	30	20	10	0	0	0	0	0	0	0	0	0	0	0	0	0
140	130	120	110	100	90	80	80	75	60	50	40	30	20	10	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
120	110	100	90	80	70	60	60	55	40	30	20	10	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
100	90	80	70	60	50	40	40	35	20	10	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
80	70	60	50	40	30	20	20	15	10	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
60	50	40	30	20	10	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
40	30	20	10	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
20	10	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0

Note: The required extreme fiber stress in bending,  $F_b$ , in pounds per square inch is shown below each span.

TABLE J-2  
FLOOR JOISTS  
30 lbs. Per Sq. Ft. Live Load  
(All rooms used for sleeping areas and attic floors.)

DESIGN CRITERIA:  
Deflection - For 30 lbs. per sq. ft. live load,  
limited to span in inches divided by 360.  
Strength - For 30 lbs. per sq. ft. plus  
Strength of 10 lbs. per sq. ft. plus  
the required fiber stress value.

JOIST SIZE SPACING (IN)	Modulus of Elasticity, "E", in 1,000,000 psi																			
	0.4	0.5	0.6	0.7	0.8	0.9	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	2.2	2.4	
12.0	7.5	8.0	8.6	9.1	9.4	9.9	10.1	10.5	10.9	11.0	11.3	11.7	11.8	12.0	12.3	12.6	12.9	13.1	13.6	
	440	510	570	640	700	750	810	850	910	960	1010	1060	1100	1150	1200	1240	1280	1370	1450	
	7.1	7.8	8.2	8.7	8.1	8.4	9.8	10.0	10.3	10.6	10.10	11.1	11.3	11.6	11.9	11.11	12.2	12.7	12.11	
	460	530	600	670	730	790	840	900	950	1010	1060	1110	1150	1200	1250	1300	1340	1430	1510	
	6.9	7.3	7.9	8.2	8.6	8.10	9.2	9.6	9.9	10.0	10.3	10.6	10.9	11.1	11.2	11.4	11.7	11.11	12.3	
16.0	6.4	6.10	7.3	7.8	8.0	8.4	8.6	8.11	9.2	9.5	9.8	10.0	10.1	10.4	10.6	10.9	10.10	11.3	11.7	
	510	600	670	740	810	880	940	1010	1070	1130	1180	1240	1290	1350	1400	1450	1500	1600	1690	
	5.11	6.4	6.9	7.1	7.5	7.9	8.0	8.3	8.6	8.9	8.11	9.2	9.4	9.7	9.9	9.11	10.1	10.5	10.9	
	550	640	720	800	880	950	1020	1080	1150	1210	1270	1330	1390	1450	1510	1560	1620	1720	1820	
	5.9	7.0	7.3	7.6	7.9	7.11	8.2	8.4	8.6	8.8	8.10	9.0	9.2	9.6	9.9	9.9	9.9	9.9	9.9	
24.0	5.10	5.7	6.3	6.7	7.0	7.3	7.6	7.9	8.2	8.5	8.8	9.1	9.4	9.7	10.0	10.3	10.6	11.0	11.4	
	440	510	570	640	700	750	810	850	910	960	1010	1060	1100	1150	1200	1240	1280	1370	1450	
	4.4	5.1	5.5	5.8	6.1	6.4	6.7	7.0	7.3	7.6	7.9	8.2	8.5	8.8	9.1	9.4	9.7	10.0	10.3	
	460	530	600	670	730	790	840	900	950	1010	1060	1110	1160	1210	1260	1310	1360	1410	1500	
	4.1	4.7	5.0	5.3	5.6	5.9	6.2	6.5	6.8	7.1	7.4	7.7	8.0	8.3	8.6	8.9	9.2	9.5	9.8	
32.0	3.4	4.0	4.3	4.6	4.9	5.2	5.5	5.8	6.1	6.4	6.7	7.0	7.3	7.6	7.9	8.2	8.5	8.8	9.1	
	360	420	480	540	600	660	720	780	840	900	960	1020	1080	1140	1200	1260	1320	1380	1440	
	3.1	3.7	4.0	4.3	4.6	4.9	5.2	5.5	5.8	6.1	6.4	6.7	7.0	7.3	7.6	7.9	8.2	8.5	8.8	
	330	390	450	510	570	630	690	750	810	870	930	990	1050	1110	1170	1230	1290	1350	1410	
	2.9	3.5	3.8	4.1	4.4	4.7	5.0	5.3	5.6	5.9	6.2	6.5	6.8	7.1	7.4	7.7	8.0	8.3	8.6	

12.0	440	510	570	640	700	750	810	860	910	960	1010	1060	1100	1150	1200	1240	21.0	21.5	22.1	22.9
13.7	480	530	590	670	730	790	840	900	960	1010	1060	1110	1160	1200	1250	1300	20.5	21.1	21.9	21.9
2x10	11.4	12.3	13.0	14.4	14.4	14.11	15.5	15.11	16.5	16.10	17.3	17.8	18.0	18.5	18.9	19.1	19.5	20.1	20.9	20.9
19.2	510	600	670	740	810	880	940	1010	1070	1130	1180	1240	1290	1350	1400	1450	15.00	15.00	16.00	16.00
24.0	550	640	720	800	880	950	1020	1080	1150	1210	1270	1330	1380	1450	1510	1560	17.0	17.0	17.6	18.0
32.0					11.4	11.10	12.3	12.8	13.0	13.4	14.4	14.7	15.2	15.5	15.11	15.2	15.5	15.11	15.5	16.5
12.0	440	510	570	640	700	750	810	860	910	960	1010	1060	1110	1160	1210	1240	25.7	26.0	26.0	27.8
13.7	460	530	600	670	730	790	840	900	960	1010	1060	1110	1160	1210	1250	1300	24.8	24.8	25.1	25.7
2x12	13.10	14.11	15.10	16.8	17.5	18.1	18.9	19.4	19.11	20.6	21.0	21.7	22.1	22.7	23.1	23.7	24.0	24.5	24.8	25.8
16.0	480	560	630	700	770	830	890	950	1000	1050	1100	1150	1200	1250	1300	1340	22.5	23.3	23.7	25.1
19.2	510	600	670	740	810	880	940	1010	1070	1130	1180	1240	1290	1350	1400	1450	21.1	21.6	22.3	23.7
24.0	550	640	720	800	880	950	1020	1080	1150	1210	1270	1330	1380	1450	1510	1560	19.7	19.7	20.3	20.8
32.0					13.10	14.4	14.11	15.4	15.10	16.3	16.8	17.4	17.5	17.9	18.1	18.5	18.5	18.9	18.4	18.1
					970	1040	1130	1190	1270	1340	1400	1460	1530	1590	1650	1720	1780	1840	1880	2010

Note: The required extreme fiber stress in bending, "F<sub>b</sub>", in pounds per square inch is shown below each span.

**TABLE J-3  
CEILING JOISTS**  
20 Lbs. Per Sq. Ft. Live Load  
(Limited attic storage where development of future rooms is not possible)  
(Plaster Ceiling)

**DESIGN CRITERIA:**  
Deflection For 20 lbs. per sq. ft. live load.  
Limited to span in inches divided by 360.  
Strength Live load of 20 lbs. per sq. ft. plus  
dead load of 10 lbs. per sq. ft. determines  
required fiber stress value.

JOIST SIZE SPACING (IN)	Modulus of Elasticity, "E", in 1,000,000 psi																			
	0.4	0.5	0.6	0.7	0.8	0.9	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	2.2	2.4	
12.0	5.5	5.10	5.2	6.6	6.10	7.1	7.4	7.7	7.10	8.0	8.3	8.5	8.7	8.9	8.11	9.1	9.3	9.7	9.10	
	4.30	5.00	5.60	6.30	6.80	7.40	7.90	8.50	9.00	9.60	9.90	10.40	10.90	11.30	11.70	12.20	12.60	13.40	14.20	
	5.2	5.7	5.11	6.3	6.6	6.9	7.0	7.3	7.6	7.8	7.10	8.1	8.3	8.5	8.7	8.8	8.10	9.2	9.5	
	4.50	5.20	5.90	6.50	7.20	7.70	8.30	8.60	8.90	9.40	9.90	10.40	10.90	11.40	11.80	12.30	12.70	13.20	14.00	
	4.11	5.4	5.8	5.11	6.2	6.5	6.8	6.11	7.1	7.3	7.6	7.8	7.10	8.0	8.1	8.3	8.5	8.8	8.11	
16.0	4.70	5.60	6.20	6.90	7.50	8.10	8.70	9.30	9.90	10.40	10.90	11.40	12.00	12.40	12.90	13.40	13.90	14.90	15.70	
	4.8	5.0	5.4	5.7	5.10	6.1	6.3	6.6	6.8	6.10	7.0	7.2	7.4	7.6	7.8	7.9	7.11	8.2	8.5	
	5.00	5.80	6.60	7.30	8.00	8.70	9.30	9.90	10.50	11.10	11.60	12.20	12.70	13.20	13.70	14.20	14.70	15.70	16.60	
	4.4	4.8	4.11	5.2	5.5	5.8	5.10	6.0	6.2	6.4	6.6	6.9	7.0	7.0	7.1	7.3	7.4	7.7	7.10	
	5.40	6.30	7.10	7.90	8.60	9.30	10.00	10.70	11.30	11.90	12.50	13.10	13.70	14.20	14.70	15.30	15.90	16.90	17.90	
19.2	8.6	9.2	9.9	10.3	10.9	11.2	11.7	11.11	12.3	12.7	12.11	13.3	13.6	13.9	14.1	14.4	14.7	15.0	15.6	
	4.30	5.00	5.60	6.30	6.80	7.40	7.90	8.50	9.00	9.60	9.90	10.40	10.90	11.30	11.70	12.20	12.60	13.40	14.20	
	8.2	8.8	9.4	9.10	10.3	10.8	11.1	11.5	11.9	12.1	12.4	12.8	12.11	13.2	13.5	13.8	13.11	14.4	14.9	
	4.50	5.20	5.90	6.50	7.20	7.70	8.30	8.60	9.40	9.90	10.40	10.90	11.40	11.80	12.30	12.70	13.20	14.00	14.90	
	7.9	8.4	8.10	9.4	9.9	10.2	10.6	10.10	11.2	11.5	11.9	12.0	12.3	12.6	12.9	13.0	13.3	13.8	14.1	
24.0	4.70	5.50	6.20	6.90	7.50	8.10	8.70	9.30	9.90	10.40	10.90	11.40	12.00	12.40	12.90	13.40	13.90	14.80	15.70	
	7.3	7.10	8.4	8.9	9.2	9.6	9.10	10.2	10.6	10.9	11.1	11.4	11.7	11.9	12.0	12.3	12.5	12.10	13.3	
	5.00	5.80	6.60	7.30	8.00	8.70	9.30	9.90	10.50	11.10	11.60	12.20	12.70	13.20	13.70	14.20	14.70	15.70	16.60	
	6.9	7.3	7.9	8.2	8.6	8.10	9.2	9.6	9.9	10.0	10.3	10.6	10.9	11.1	11.2	11.4	11.7	11.11	12.3	
	5.40	6.30	7.10	7.90	8.60	9.30	10.00	10.70	11.30	11.90	12.50	13.10	13.70	14.20	14.70	15.30	15.90	16.90	17.90	

12.0	11.3	12.1	12.10	13.6	14.2	14.8	15.3	15.9	16.2	16.7	17.0	17.5	17.10	18.2	18.6	18.10	19.2	19.10	20.5
	430	500	560	630	680	740	790	850	900	950	990	1040	1090	1130	1170	1220	1260	1340	1420
13.7	109	117	123	136	141	147	150	156	151	151	16.3	16.8	17.0	17.5	17.9	18.0	18.4	19.11	19.6
	450	520	590	650	720	770	830	880	940	990	1040	1090	1140	1180	1230	1270	1320	1400	1490
2x6	10.2	11.0	11.8	12.3	12.10	13.4	13.10	14.3	14.8	15.1	15.6	15.10	15.2	16.5	16.10	17.2	17.5	18.0	18.6
	470	550	620	690	750	810	870	930	990	1040	1080	1140	1200	1240	1290	1340	1390	1480	1570
19.2	97	10.4	11.0	11.7	12.1	12.7	13.0	13.5	13.10	14.2	14.7	14.11	15.3	15.6	15.10	16.1	16.5	16.11	17.5
	500	580	660	730	800	870	930	990	1050	1110	1160	1220	1270	1320	1370	1420	1470	1570	1660
24.0	8.11	9.7	10.2	10.9	11.3	11.8	12.1	12.6	12.10	13.2	13.6	13.10	14.2	14.5	14.8	15.0	15.3	15.9	16.2
	540	630	710	790	860	930	1000	1070	1130	1190	1250	1310	1370	1420	1480	1530	1580	1690	1790
12.0	14.4	15.5	16.5	17.3	18.0	18.9	19.5	20.1	20.8	21.2	21.9	22.3	22.9	23.2	23.8	24.1	24.6	25.3	26.0
	430	500	560	630	680	740	790	850	900	950	990	1040	1090	1130	1170	1220	1260	1340	1420
13.7	13.8	14.9	15.8	16.6	17.3	17.11	18.7	19.2	19.9	20.3	20.9	21.3	21.6	22.2	22.7	23.0	23.5	24.2	24.10
	450	520	590	650	720	770	830	880	940	990	1040	1090	1140	1180	1230	1270	1320	1400	1490
2x10	13.0	14.0	14.11	15.8	16.5	17.0	17.6	18.3	18.5	19.3	19.9	20.2	20.8	21.1	21.6	21.10	22.3	22.11	23.8
	470	550	620	690	750	810	870	930	990	1040	1090	1140	1200	1240	1290	1340	1390	1480	1570
19.2	12.3	13.2	14.0	14.9	15.5	16.0	16.7	17.2	17.8	18.1	18.7	19.0	19.5	19.10	20.2	20.7	20.11	21.7	22.3
	500	580	660	730	800	870	930	990	1050	1110	1160	1220	1270	1320	1370	1420	1470	1570	1660
24.0	11.4	12.3	13.0	13.8	14.4	14.11	15.5	15.11	16.5	16.10	17.3	17.6	18.0	18.5	18.9	19.1	19.5	20.1	20.8
	540	630	710	790	860	930	1000	1070	1130	1190	1250	1310	1370	1420	1480	1530	1590	1690	1790

Note: The required extreme fiber stress in bending, "F<sub>b</sub>", in pounds per square inch is shown below each span.

TABLE J-4  
CEILING JOISTS

20 Lbs. Per Sq. Ft. Live Load  
(Limited attic storage where development of future rooms is not possible)  
(Drywall Ceiling)

DESIGN CRITERIA:  
Deflection - For 20 lbs. per sq. ft. live load.  
Limited to span in inches divided by 240.  
Strength - live load of 20 lbs. per sq. ft. plus dead load of 10 lbs. per sq. ft. determines required fiber stress value.

JOIST SIZE SPACING (IN)	Modulus of Elasticity, "E", in 1,000,000 psi																			
	0.4	0.5	0.6	0.7	0.8	0.9	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	2.2	2.4	
12.0	6-2	6-8	7-1	7-6	7-10	8-1	8-5	8-8	8-11	9-2	9-5	9-8	9-10	10-0	10-3	10-5	10-7	10-11	11-3	
	5-11	6-5	6-9	7-2	7-6	7-9	8-1	8-4	8-7	8-9	9-0	9-3	9-5	9-7	9-9	10-0	10-2	10-6	10-9	
	5-8	6-1	6-5	6-9	7-1	7-5	7-8	7-11	8-1	8-4	8-7	8-9	8-11	9-1	9-4	9-6	9-9	9-11	10-3	
	5-4	5-9	6-1	6-5	6-8	6-11	7-2	7-5	7-8	7-10	8-1	8-3	8-5	8-7	8-9	8-11	9-1	9-4	9-8	
	4-11	5-4	5-8	5-11	6-2	6-5	6-8	6-11	7-1	7-3	7-6	7-8	7-10	8-0	8-1	8-3	8-5	8-8	8-11	
13.7	9-9	10-6	11-2	11-9	12-3	12-9	13-3	13-8	14-1	14-5	14-9	15-2	15-6	15-9	16-1	16-4	16-8	17-2	17-8	
	5-4	6-0	6-6	7-0	7-4	7-8	8-2	8-6	9-0	9-4	9-8	10-2	10-6	11-0	11-4	11-8	12-2	12-6	13-0	
	5-4	6-0	6-6	7-0	7-4	7-8	8-2	8-6	9-0	9-4	9-8	10-2	10-6	11-0	11-4	11-8	12-2	12-6	13-0	
	5-4	6-0	6-6	7-0	7-4	7-8	8-2	8-6	9-0	9-4	9-8	10-2	10-6	11-0	11-4	11-8	12-2	12-6	13-0	
	5-4	6-0	6-6	7-0	7-4	7-8	8-2	8-6	9-0	9-4	9-8	10-2	10-6	11-0	11-4	11-8	12-2	12-6	13-0	
24.0	9-9	10-6	11-2	11-9	12-3	12-9	13-3	13-8	14-1	14-5	14-9	15-2	15-6	15-9	16-1	16-4	16-8	17-2	17-8	
	5-4	6-0	6-6	7-0	7-4	7-8	8-2	8-6	9-0	9-4	9-8	10-2	10-6	11-0	11-4	11-8	12-2	12-6	13-0	
	5-4	6-0	6-6	7-0	7-4	7-8	8-2	8-6	9-0	9-4	9-8	10-2	10-6	11-0	11-4	11-8	12-2	12-6	13-0	
	5-4	6-0	6-6	7-0	7-4	7-8	8-2	8-6	9-0	9-4	9-8	10-2	10-6	11-0	11-4	11-8	12-2	12-6	13-0	
	5-4	6-0	6-6	7-0	7-4	7-8	8-2	8-6	9-0	9-4	9-8	10-2	10-6	11-0	11-4	11-8	12-2	12-6	13-0	

12.0	12.10	13.10	14.8	15.5	16.2	16.10	17.5	18.0	18.6	19.0	19.6	19.11	20.5	20.10	21.2	21.7	21.11	22.8	23.4
	560	660	740	820	900	970	1040	11.10	1170	1240	1300	1360	1420	1480	1540	1600	1650	1760	1860
13.7	12.3	13.3	14.1	14.10	15.6	16.1	16.8	17.2	17.6	18.2	18.8	19.1	19.6	19.11	20.3	20.8	21.0	21.8	22.4
	560	690	770	860	940	1010	1090	1160	1230	1300	1360	1420	1490	1550	1610	1670	1730	1840	1950
16.0	11.8	12.7	13.4	14.1	14.8	15.3	15.10	16.4	16.10	17.3	17.9	18.2	18.6	18.11	19.3	19.7	19.11	20.7	21.2
	620	720	810	900	990	1070	1140	1220	1290	1360	1430	1500	1570	1630	1690	1760	1820	1940	2050
19.2	11.0	11.10	12.7	13.3	13.10	14.5	14.11	15.5	15.10	16.3	16.8	17.1	17.5	17.9	18.2	18.5	18.9	19.5	19.11
	660	770	870	960	1050	1130	1220	1300	1370	1450	1520	1590	1660	1730	1800	1870	1930	2060	2180
24.0	10.2	11.0	11.8	12.3	12.10	13.4	13.10	14.3	14.8	15.1	15.6	15.10	16.2	16.6	16.10	17.2	17.5	18.0	18.6
	710	830	930	1030	1130	1220	1310	1400	1480	1560	1640	1720	1790	1870	1940	2010	2080	2220	2350
12.0	16.5	17.8	18.9	19.9	20.8	21.6	22.3	22.11	23.8	24.3	24.10	25.5	26.0	26.6	27.1	27.6	28.0	28.11	29.9
	560	660	740	820	900	970	1040	1110	1170	1240	1300	1360	1420	1480	1540	1600	1650	1760	1860
13.7	15.8	16.11	17.11	18.11	19.9	20.5	21.3	21.11	22.7	23.3	23.9	24.4	24.10	25.5	25.10	26.4	26.10	27.8	28.6
	590	690	770	860	940	1010	1090	1160	1230	1300	1360	1420	1490	1550	1610	1670	1730	1840	1950
16.0	14.11	16.0	17.0	18.9	19.6	20.2	20.10	21.6	22.1	22.11	22.7	23.2	23.8	24.1	24.7	25.0	25.5	26.3	27.1
	620	720	810	900	990	1070	1140	1220	1290	1360	1430	1500	1570	1630	1690	1760	1820	1940	2050
19.2	14.0	15.1	16.0	16.11	17.8	18.4	19.0	19.7	20.2	20.5	21.3	21.9	22.3	22.8	23.2	23.7	23.11	24.9	25.5
	660	770	870	960	1050	1130	1220	1300	1370	1450	1520	1590	1660	1730	1800	1870	1930	2060	2180
24.0	13.0	14.0	14.11	15.8	16.5	17.0	17.8	18.3	18.6	19.3	19.9	20.2	20.8	21.1	21.6	21.10	22.3	22.11	23.8
	710	830	930	1030	1130	1220	1310	1400	1480	1560	1640	1720	1790	1870	1940	2010	2080	2220	2350

Note: The required extreme fiber stress in bending, "F<sub>b</sub>", in pounds per square inch is shown below each span.

**TABLE J-5  
CEILING JOISTS**  
10 Lbs. Per Sq. Ft. Live Load  
(No attic storage and roof slope not steeper than 3 in 12)  
(Plaster Ceiling)

**DESIGN CRITERIA:**  
Deflection - For 10 lbs. per sq. ft. live load.  
Limited to span in inches divided by 360.  
Strength - live load of 10 lbs. per sq. ft. plus  
dead load of 5 lbs. per sq. ft. determines  
required fiber stress value.

JOIST SIZE SPACING (IN)	Modulus of Elasticity, "E", in 1,000,000 psi																			
	0.4	0.5	0.6	0.7	0.8	0.9	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	2.2	2.4	
12.0	610	74	710	83	87	811	83	97	810	101	104	107	1010	111	113	115	118	121	125	
	340	400	450	500	540	590	630	670	710	750	790	830	860	900	930	970	1000	1070	1130	
	66	70	76	710	83	87	810	92	95	98	911	102	104	107	109	110	112	116	1110	
	360	410	470	520	570	610	660	700	740	780	820	860	900	940	970	1010	1050	1110	1180	
2x4	62	68	71	76	710	81	85	88	811	92	95	98	910	100	103	105	107	111	113	
	360	440	490	550	600	650	690	740	780	830	870	910	950	990	1030	1060	1100	1170	1240	
	510	63	68	70	74	78	711	82	85	88	810	91	93	95	98	910	100	104	107	
	400	460	520	580	630	680	740	790	830	880	920	970	1010	1050	1090	1130	1170	1250	1320	
24.0	430	500	560	620	680	740	790	850	900	950	990	1040	1090	1130	1170	1220	1260	1340	1420	
	109	117	123	1211	136	141	147	150	156	1511	163	168	170	174	178	180	184	1811	196	
	340	400	450	500	540	590	630	670	710	750	790	830	860	900	930	970	1000	1070	1130	
	103	111	119	124	1211	135	1311	144	149	152	157	1511	163	167	1611	173	176	181	188	
13.7	360	410	470	520	570	610	660	700	740	780	820	860	900	940	970	1010	1050	1110	1180	
	99	106	112	119	123	129	133	138	141	145	149	152	156	159	161	164	168	172	178	
	380	440	490	550	600	650	690	740	780	830	870	910	950	990	1030	1060	1100	1170	1240	
	92	910	106	111	117	120	125	1210	133	137	1311	143	147	1410	152	155	158	162	168	
19.2	400	460	520	580	630	680	740	790	830	880	920	970	1010	1050	1090	1130	1170	1250	1320	
	86	92	99	103	109	112	117	1111	123	127	1211	132	136	139	141	144	147	150	156	
	430	500	560	620	680	740	790	850	900	950	990	1040	1090	1130	1170	1220	1260	1340	1420	
	109	117	123	1211	136	141	147	150	156	1511	163	168	170	174	178	180	184	1811	196	



2x8	12.0	14.2 340	15.3 400	16.2 450	17.0 500	17.10 540	18.6 590	19.2 630	19.10 670	20.5 710	20.11 750	21.5 790	21.11 830	22.5 860	22.11 900	23.4 930	23.9 970	24.2 1000	24.11 1070	25.6 1130
	13.7	13.8 360	14.7 410	15.6 470	16.3 520	17.0 570	17.9 610	18.4 660	18.11 700	19.6 740	20.0 780	20.6 820	21.0 860	21.5 900	21.11 940	22.4 970	22.9 1010	23.1 1050	23.10 1110	24.7 1180
	16.0	12.10 380	13.10 440	14.8 490	15.6 550	16.2 600	16.10 650	17.5 690	18.0 740	18.6 780	19.0 830	19.6 870	19.11 910	20.5 950	20.10 990	21.2 1030	21.7 1060	21.11 1100	22.8 1170	23.4 1240
	19.2	12.1 400	13.0 460	13.10 520	14.7 580	15.3 630	15.10 690	16.5 740	16.11 790	17.5 830	17.11 880	18.4 920	18.9 970	19.2 1010	19.7 1050	19.11 1090	20.4 1130	20.8 1170	21.4 1250	21.11 1320
	24.0	11.3 430	12.1 500	12.10 560	13.6 630	14.2 680	14.8 740	15.3 790	15.9 850	16.2 900	16.7 950	17.0 990	17.5 1040	17.10 1090	18.2 1130	18.6 1170	18.10 1220	19.2 1260	19.10 1340	20.5 1420
2x10	12.0	18.0 340	19.5 400	20.8 450	21.9 500	22.9 540	23.8 590	24.6 630	25.3 670	26.0 710	26.9 750	27.5 790	28.0 830	28.7 860	29.2 900	29.9 930	30.4 970	30.10 1000	31.10 1070	32.9 1130
	13.7	17.3 360	18.7 410	19.9 470	20.9 520	21.9 570	22.7 610	23.5 660	24.2 700	24.10 740	25.7 780	26.2 820	26.10 860	27.5 900	27.11 940	28.6 970	29.0 1010	29.6 1050	30.5 1110	31.4 1180
	16.0	16.5 380	17.8 440	18.9 490	19.9 550	20.8 600	21.6 650	22.3 690	22.11 740	23.8 780	24.3 830	24.10 870	25.5 910	26.0 950	26.6 990	27.1 1030	27.6 1060	28.0 1100	28.11 1170	29.9 1240
	19.2	15.5 400	16.7 460	17.8 520	18.7 580	19.5 630	20.2 690	20.11 740	21.7 790	22.3 830	22.10 880	23.5 920	23.11 970	24.6 1010	25.0 1050	25.5 1090	25.11 1130	26.4 1170	27.3 1250	28.0 1320
	24.0	14.4 430	15.6 500	16.5 560	17.3 630	18.0 680	18.9 740	19.5 790	20.1 850	20.8 900	21.2 950	21.9 990	22.3 1040	22.9 1090	23.2 1130	23.8 1170	24.1 1220	24.6 1260	25.3 1340	26.0 1420

Note: The required extreme fiber stress in bending, "F<sub>b</sub>" in pounds per square inch is shown below each span.

**TABLE J-6**  
**CEILING JOISTS**  
10 Lbs. Per Sq. Ft. Live Load  
(No attic storage and roof slope not steeper than 3 in 12)  
(Drywall Ceiling)

**DESIGN CRITERIA:**  
Deflection - For 10 lbs. per sq. ft. live load.  
Limited to span in inches divided by 240.  
Strength - live load of 10 lbs. per sq. ft. plus  
dead load of 5 lbs. per sq. ft. determines  
required fiber stress value.

JOIST SIZE SPACING (IN)		Modulus of Elasticity, "E", in 1,000,000 psi																	
		0.4	0.5	0.6	0.7	0.8	0.9	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	2.2
2x4	7-10	85	8-11	9-5	9-10	10-3	10-7	10-11	11-3	11-7	11-10	12-2	12-5	12-8	12-11	13-2	13-4	13-8	14-2
	4-50	520	590	650	710	770	830	880	930	980	1030	1080	1130	1180	1220	1270	1310	1400	1480
	7-6	8-1	8-7	9-0	9-5	9-9	10-2	10-6	10-9	11-1	11-4	11-7	11-10	12-1	12-4	12-7	12-9	13-2	13-7
	4-70	540	610	680	740	800	860	920	970	1030	1080	1130	1180	1230	1280	1320	1370	1460	1550
	7-1	7-8	8-1	8-7	8-11	9-4	9-8	9-11	10-3	10-6	10-9	11-0	11-3	11-6	11-9	12-1	12-2	12-5	12-11
	4-90	570	650	720	780	850	910	970	1030	1080	1140	1190	1240	1290	1340	1390	1440	1540	1630
2x6	6-8	7-2	7-8	8-1	8-5	8-9	9-1	9-4	9-8	9-11	10-2	10-4	10-7	10-10	11-0	11-3	11-5	11-9	12-2
	5-20	610	690	760	830	900	970	1030	1090	1150	1210	1270	1320	1380	1430	1480	1530	1630	1730
	6-2	6-8	7-1	7-6	7-10	8-1	8-5	8-8	8-11	9-2	9-5	9-8	9-10	10-0	10-3	10-5	10-7	10-11	11-3
	5-60	660	740	820	900	970	1040	1110	1170	1240	1300	1360	1420	1480	1540	1600	1650	1760	1860
	12-3	13-3	14-1	14-9	15-6	16-1	16-8	17-2	17-8	18-2	18-8	19-1	19-6	19-11	20-3	20-8	21-0	21-8	22-4
	4-50	520	590	650	710	770	830	880	930	980	1030	1080	1130	1180	1230	1270	1310	1400	1480
2x8	11-9	12-8	13-5	14-2	14-9	15-5	15-11	15-5	16-11	17-5	17-10	18-3	18-8	19-0	19-5	19-9	20-1	20-9	21-4
	4-70	540	610	680	740	800	860	920	970	1030	1080	1130	1180	1230	1280	1320	1370	1460	1550
	11-2	12-0	12-9	13-5	14-1	14-7	15-2	15-7	16-1	16-6	16-11	17-4	17-8	18-1	18-1	18-5	18-9	19-1	19-8
	4-90	570	650	720	780	850	910	970	1030	1080	1140	1190	1240	1290	1340	1390	1440	1540	1630
	10-6	11-4	12-0	12-8	13-3	13-9	14-3	14-8	15-2	15-7	15-11	16-4	16-8	17-0	17-4	17-8	17-11	18-6	19-1
	5-20	610	690	760	830	900	970	1030	1090	1150	1210	1270	1320	1380	1430	1480	1530	1630	1730
24.0	9-9	10-6	11-2	11-9	12-3	12-9	13-3	13-8	14-1	14-5	14-9	15-2	15-6	15-9	16-1	16-4	16-8	17-2	17-8
	5-60	660	740	820	900	970	1040	1110	1170	1240	1300	1360	1420	1480	1540	1600	1650	1760	1860

12.0	15.2	17.5	18.6	19.6	20.5	21.2	21.11	22.8	33.4	34.0	24.7	25.2	25.8	26.2	25.9	27.2	27.6	28.7	29.5
	450	520	590	650	710	770	830	880	930	980	1030	1080	1130	1180	1220	1270	1310	1400	1480
13.7	15.6	16.8	17.9	18.8	19.6	20.3	21.0	21.8	22.4	22.11	22.6	24.0	24.7	25.1	25.7	26.0	26.6	27.4	28.1
	470	540	610	680	740	800	860	920	970	1030	1080	1130	1180	1230	1280	1330	1370	1460	1550
2x6	14.8	15.10	16.10	17.9	18.6	19.3	19.11	20.7	21.2	21.9	22.4	22.10	23.4	23.10	24.3	24.8	25.2	25.11	26.9
	490	570	650	720	780	850	910	1030	1080	1140	1190	1240	1290	1340	1390	1440	1540	1630	1830
19.2	13.10	14.11	15.10	16.8	17.5	18.2	18.9	19.5	19.11	20.5	21.0	21.6	21.11	22.5	22.10	23.3	23.8	24.5	25.2
	520	610	690	760	830	900	970	1030	1090	1150	1210	1270	1330	1390	1450	1530	1630	1730	1930
24.0	12.10	13.10	14.8	15.6	16.2	16.10	17.5	18.0	18.6	19.0	19.6	19.11	20.5	20.10	21.2	21.7	21.11	22.8	23.4
	560	660	740	820	900	970	1040	1110	1170	1240	1300	1360	1420	1480	1540	1600	1650	1760	1860
12.0	20.8	22.3	23.8	24.10	26.0	27.1	28.0	28.11	29.9	30.7	31.4	32.1	32.8	33.5	34.1	34.8	35.4	36.5	37.6
	450	520	590	650	710	770	830	890	950	1010	1070	1130	1190	1250	1310	1370	1430	1490	1600
13.7	19.9	21.3	22.7	23.9	24.10	25.10	26.10	27.8	28.6	29.3	30.0	30.8	31.4	32.0	32.7	33.2	33.9	34.10	35.10
	470	540	610	680	740	800	860	920	970	1030	1080	1130	1180	1230	1280	1330	1370	1460	1550
15.0	18.9	20.2	21.6	22.7	23.8	24.7	25.5	26.3	27.1	27.9	28.6	29.2	29.9	30.5	31.0	31.6	32.1	33.1	34.1
	490	570	650	720	780	850	910	970	1030	1090	1140	1190	1240	1290	1340	1390	1440	1540	1630
19.2	17.8	19.0	20.2	21.3	22.3	23.2	23.11	24.9	25.5	26.2	26.10	27.6	28.0	28.7	29.2	29.8	30.2	31.2	32.1
	520	610	690	760	830	900	970	1030	1090	1150	1210	1270	1320	1380	1430	1490	1530	1630	1730
24.0	15.5	17.8	18.9	19.9	20.8	21.6	22.3	23.11	23.8	24.3	24.10	25.5	26.0	26.6	27.1	27.6	28.0	28.11	29.6
	580	660	740	820	900	970	1040	1110	1170	1240	1300	1360	1420	1480	1540	1600	1650	1760	1860

Note: The required extreme fiber stress in bending, "f<sub>b</sub>", in pounds per square inch is shown below each span.

**TABLE R-1  
FLAT OR SLOPED RAFTERS  
Supporting Drywall Ceiling  
(Flat roof or cathedral ceiling with no attic space)  
Live Load - 20 lb. per sq. ft.**

**DESIGN CRITERIA:**  
Strength - 15 lbs. per sq. ft. dead load plus 20 lbs. per sq. ft. live load determines required fiber stress.  
Deflection - For 20 lbs. per sq. ft. live load. Limited to span in inches divided by 240.

RAFTER SIZE	SPACING (IN)	Extreme Fiber Stress in Bending, "F <sub>b</sub> " (psi).										
		300	400	500	600	700	800	900	1000	1100	1200	1300
2x6	12.0	6-7 0.12	7-7 0.19	8-6 0.26	9-4 0.35	10-0 0.44	10-9 0.54	11-5 0.64	12-0 0.75	12-7 0.86	13-2 0.98	13-8 1.11
	13.7	6-2 0.12	7-1 0.18	7-11 0.25	8-8 0.33	9-5 0.41	10-0 0.50	10-8 0.60	11-3 0.70	11-9 0.81	12-4 0.92	12-10 1.04
	16.0	5-8 0.11	6-7 0.16	7-4 0.23	8-1 0.30	8-8 0.38	9-4 0.46	9-10 0.55	10-5 0.65	10-11 0.75	11-5 0.85	11-10 0.96
	19.2	5-2 0.10	6-0 0.15	6-9 0.21	7-4 0.27	7-11 0.35	8-6 0.42	9-0 0.51	9-6 0.59	9-11 0.68	10-5 0.78	10-10 0.88
	24.0	4-8 0.09	5-4 0.13	6-0 0.19	6-7 0.25	7-1 0.31	7-7 0.38	8-1 0.45	8-6 0.53	8-11 0.61	9-4 0.70	9-8 0.78
	12.0	8-8 0.12	10-0 0.19	11-2 0.26	12-3 0.35	13-3 0.44	14-2 0.54	15-0 0.64	15-10 0.75	16-7 0.86	17-4 0.98	18-0 1.11
2x8	13.7	8-1 0.12	9-4 0.18	10-6 0.25	11-6 0.33	12-5 0.41	13-3 0.50	14-0 0.60	14-10 0.70	15-6 0.81	16-3 0.92	16-10 1.04
	16.0	7-6 0.11	8-8 0.16	9-8 0.23	10-7 0.30	11-6 0.38	12-3 0.46	13-0 0.55	13-8 0.65	14-4 0.75	15-0 0.85	15-7 0.96
	19.2	6-10 0.10	7-11 0.15	8-10 0.21	9-8 0.27	10-6 0.35	11-2 0.42	11-10 0.51	12-6 0.59	13-1 0.68	13-8 0.78	14-3 0.88
	24.0	6-2 0.09	7-1 0.13	7-11 0.19	8-8 0.25	9-4 0.31	10-0 0.38	10-7 0.45	11-2 0.53	11-9 0.61	12-3 0.70	12-9 0.78

2x10	12.0	11.1 0.12	12.9 0.19	14.3 0.26	15.8 0.35	16.11 0.44	18.1 0.54	19.2 0.64	20.2 0.75	21.2 0.86	22.1 0.98	23.0 1.11
	13.7	10.4 0.12	11.11 0.18	13.4 0.25	14.8 0.33	15.10 0.41	16.11 0.50	17.11 0.60	18.11 0.70	19.10 0.81	20.8 0.92	21.6 1.04
	16.0	9.7 0.11	11.1 0.16	12.4 0.23	13.6 0.30	14.8 0.38	15.8 0.46	16.7 0.55	17.6 0.65	18.4 0.75	19.2 0.85	19.11 0.96
	19.2	8.9 0.10	10.1 0.15	11.3 0.21	12.4 0.27	13.4 0.35	14.3 0.42	15.2 0.51	15.11 0.59	16.9 0.68	17.6 0.78	18.2 0.88
	24.0	7.10 0.09	9.0 0.13	10.1 0.19	11.1 0.25	11.11 0.31	12.9 0.38	13.6 0.45	14.3 0.53	15.0 0.61	15.8 0.70	16.3 0.78
2x12	12.0	13.5 0.12	15.6 0.19	17.4 0.26	19.0 0.35	20.6 0.44	21.11 0.54	23.3 0.64	24.7 0.75	25.9 0.86	26.11 0.98	28.0 1.11
	13.7	12.7 0.12	14.6 0.18	16.3 0.25	17.9 0.33	19.3 0.41	20.6 0.50	21.9 0.60	23.0 0.70	24.1 0.81	25.2 0.92	26.2 1.04
	16.0	11.8 0.11	13.5 0.16	15.0 0.23	16.6 0.30	17.9 0.38	19.0 0.46	20.2 0.55	21.3 0.65	22.4 0.75	23.3 0.85	24.3 0.96
	19.2	10.8 0.10	12.3 0.15	13.9 0.21	15.0 0.27	16.3 0.35	17.4 0.42	18.5 0.51	19.5 0.59	20.4 0.68	21.3 0.78	22.2 0.88
	24.0	9.6 0.09	11.0 0.13	12.3 0.19	13.5 0.25	14.6 0.31	15.6 0.38	16.6 0.45	17.4 0.53	18.2 0.61	19.0 0.70	19.10 0.78

Note: The required modulus of elasticity, "E", in 1,000,000 pounds per square inch is shown below each span.

TABLE R-1 (cont.)

RAFTERS: Spans are measured along the horizontal projection and loads are considered as applied on the horizontal projection.

Extreme Fiber Stress in Bending, "F <sub>b</sub> " (psi).											RAFTER SPACING SIZE (IN) (IN)	
1400	1500	1600	1700	1800	1900	2000	2100	2200	2400	2700		
14-2 1.24	14-8 1.37	15-2 1.51	15-8 1.66	16-1 1.81	16-7 1.96	17-0 2.12	17-5 2.28	17-10 2.44				12.0
13-3 1.16	13-9 1.29	14-2 1.42	14-8 1.55	15-1 1.69	15-6 1.83	15-11 1.98	16-3 2.13	16-8 2.28	17-5 2.60			13.7
12-4 1.07	12-9 1.19	13-2 1.31	13-7 1.44	13-11 1.56	14-4 1.70	14-8 1.83	15-1 1.97	15-6 2.11	16-7 2.41			16.0
11-3 0.98	11-7 1.09	12-0 1.20	12-4 1.31	12-9 1.43	13-1 1.55	13-5 1.67	13-9 1.80	14-1 1.93	14-8 2.20			19.2
10-0 0.88	10-5 0.97	10-9 1.07	11-1 1.17	11-5 1.28	11-8 1.39	12-0 1.50	12-4 1.61	12-7 1.73	13-2 1.97	13-11 2.35		24.0
18-9 1.24	19-5 1.37	20-0 1.51	20-8 1.66	21-3 1.81	21-10 1.96	22-4 2.12	22-11 2.28	23-6 2.44				12.0
17-6 1.16	18-2 1.29	18-9 1.42	19-4 1.55	19-10 1.69	20-5 1.83	20-11 1.98	21-5 2.13	21-11 2.28	22-11 2.60			13.7
16-3 1.07	16-9 1.19	17-4 1.31	17-10 1.44	18-5 1.56	18-11 1.70	19-5 1.83	19-10 1.97	20-4 2.11	21-3 2.41			16.0
14-10 0.98	15-4 1.09	15-10 1.20	16-4 1.31	16-9 1.43	17-3 1.55	17-8 1.67	18-2 1.80	18-7 1.93	19-5 2.20			19.2
13-3 0.88	13-8 0.97	14-2 1.07	14-7 1.17	15-0 1.28	15-5 1.39	15-10 1.50	16-3 1.61	16-7 1.73	17-4 1.97	18-5 2.35		24.0

23-11 1.24	24-9 1.37	25-6 1.51	26-4 1.66	27-1 1.81	27-10 1.96	28-7 2.12	29-3 2.28	29-11 2.44				12.0	2x10
22-4 1.16	23-2 1.29	23-11 1.42	24-7 1.55	25-4 1.69	26-0 1.83	26-8 1.98	27-4 2.13	28-0 2.28	29-3 2.60			13.7	
20-8 1.07	21-5 1.19	22-1 1.31	22-10 1.44	23-5 1.56	24-1 1.70	24-9 1.83	25-4 1.97	25-11 2.11	27-1 2.41			16.0	
18-11 0.98	19-7 1.09	20-2 1.20	20-10 1.31	21-5 1.43	22-0 1.55	22-7 1.67	23-2 1.80	23-8 1.93	24-9 2.20			19.2	
16-11 0.88	17-6 0.97	18-1 1.07	18-7 1.17	19-2 1.28	19-8 1.39	20-2 1.50	20-8 1.61	21-2 1.73	22-1 1.97	23-5 2.35		24.0	
29-1 1.24	30-1 1.37	31-1 1.51	32-0 1.66	32-11 1.81	33-10 1.96	34-9 2.12	35-7 2.28	36-5 2.44				12.0	2x12
27-2 1.16	28-2 1.29	29-1 1.42	29-11 1.55	30-10 1.69	31-8 1.83	32-6 1.98	33-3 2.13	34-1 2.28	35-7 2.60			13.7	
25-2 1.07	26-0 1.19	26-11 1.31	27-9 1.44	28-6 1.56	29-4 1.70	30-1 1.83	30-10 1.97	31-6 2.11	32-11 2.41			16.0	
23-0 0.98	23-9 1.09	24-7 1.20	25-4 1.31	26-0 1.43	26-9 1.55	27-5 1.67	28-2 1.80	28-9 1.93	30-1 2.20			19.2	
20-6 0.88	21-3 0.97	21-11 1.07	22-8 1.17	23-3 1.28	23-11 1.39	24-7 1.50	25-2 1.61	25-9 1.73	26-11 1.97	28-6 2.35		24.0	

Note: The required modulus of elasticity, "E", in 1,000,000 pounds per square inch is shown below each span.

**TABLE R-2**  
**FLAT OR SLOPED RAFTERS**  
 Supporting Drywall Ceiling  
 (Flat roof or cathedral ceiling with no attic space)  
 Live Load - 30 lb. per sq. ft.

**DESIGN CRITERIA:**  
 Strength - 15 lbs. per sq. ft. dead load plus 30 lbs. per sq. ft. live load determines required fiber stress.  
 Deflection - For 30 lbs. per sq. ft. live load. Limited to span in inches divided by 240.

RAFTER SIZE SPACING (IN)		Extreme Fiber Stress in Bending, "F <sub>b</sub> " (psi).										
		300	400	500	600	700	800	900	1000	1100	1200	1300
2x6	12.0	5-10 0.13	6-8 0.19	7-6 0.27	8-2 0.36	8-10 0.45	9-6 0.55	10-0 0.66	10-7 0.77	11-1 0.89	11-7 1.01	12-1 1.14
	13.7	5-5 0.12	6-3 0.18	7-0 0.25	7-8 0.33	8-3 0.42	8-10 0.52	9-5 0.61	9-11 0.72	10-5 0.83	10-10 0.95	11-3 1.07
	16.0	5-0 0.11	5-10 0.17	6-6 0.24	7-1 0.31	7-8 0.39	8-2 0.48	8-8 0.57	9-2 0.67	9-7 0.77	10-0 0.88	10-5 0.99
	19.2	4-7 0.10	5-4 0.15	5-11 0.22	6-6 0.28	7-0 0.36	7-6 0.44	7-11 0.52	8-4 0.61	8-9 0.70	9-2 0.80	9-6 0.90
	24.0	4-1 0.09	4-9 0.14	5-4 0.19	5-10 0.25	6-3 0.32	6-8 0.39	7-1 0.46	7-6 0.54	7-10 0.63	8-2 0.72	8-6 0.81
	12.0	7-8 0.13	8-10 0.19	9-10 0.27	10-10 0.36	11-8 0.45	12-6 0.55	13-3 0.66	13-11 0.77	14-8 0.89	15-3 1.01	15-11 1.14
2x8	13.7	7-2 0.12	8-3 0.18	9-3 0.25	10-1 0.33	10-11 0.42	11-8 0.52	12-5 0.61	13-1 0.72	13-8 0.83	14-4 0.95	14-11 1.07
	16.0	6-7 0.11	7-8 0.17	8-7 0.24	9-4 0.31	10-1 0.39	10-10 0.48	11-6 0.57	12-1 0.67	12-8 0.77	13-3 0.88	13-9 0.99
	19.2	6-1 0.10	7-0 0.15	7-10 0.22	8-7 0.28	9-3 0.36	9-10 0.44	10-6 0.52	11-0 0.61	11-7 0.70	12-1 0.80	12-7 0.90
	24.0	5-5 0.09	6-3 0.14	7-0 0.19	7-8 0.25	8-3 0.32	8-10 0.39	9-4 0.46	9-10 0.54	10-4 0.63	10-10 0.72	11-3 0.81



12.0	9.9	11.3	12.7	13.9	14.7	15.1	16.1	17.0	18.8	19.6	20.4
	0.13	0.19	0.27	0.36	0.45	0.55	0.66	0.77	0.89	1.01	1.14
13.7	9.1	10.6	11.9	12.1	13.1	14.1	15.0	16.8	17.6	18.3	19.0
	0.12	0.18	0.25	0.33	0.42	0.52	0.61	0.72	0.83	0.95	1.07
2x10	8.5	9.9	10.1	11.1	12.1	13.9	14.8	15.5	16.2	16.1	17.7
	0.11	0.17	0.24	0.31	0.39	0.48	0.57	0.67	0.77	0.88	0.99
19.2	7.8	8.1	9.1	10.1	11.9	12.7	13.4	14.1	14.9	15.5	16.1
	0.10	0.15	0.22	0.28	0.36	0.44	0.52	0.61	0.70	0.80	0.90
24.0	6.1	8.0	8.1	9.9	10.6	11.3	11.1	12.7	13.2	13.9	14.4
	0.09	0.14	0.19	0.25	0.32	0.39	0.46	0.54	0.63	0.72	0.81
12.0	11.0	13.8	15.4	16.9	18.1	19.4	20.6	21.8	22.8	23.9	24.8
	0.13	0.19	0.27	0.36	0.45	0.55	0.66	0.77	0.89	1.01	1.14
13.7	11.1	12.0	14.4	15.8	16.1	18.1	19.3	20.3	21.3	22.2	23.1
	0.12	0.18	0.25	0.33	0.42	0.52	0.61	0.72	0.83	0.95	1.07
2x12	10.3	11.0	13.3	14.6	15.8	16.9	17.9	18.9	19.8	20.6	21.5
	0.11	0.17	0.24	0.31	0.39	0.48	0.57	0.67	0.77	0.88	0.99
19.2	6.5	10.0	12.1	13.3	14.4	15.4	16.3	17.1	17.1	18.9	19.6
	0.10	0.15	0.22	0.28	0.36	0.44	0.52	0.61	0.70	0.80	0.90
24.0	8.5	9.8	10.0	11.0	12.0	13.8	14.6	15.4	16.1	16.9	17.5
	0.09	0.14	0.19	0.25	0.32	0.39	0.46	0.54	0.63	0.72	0.81

Note: The required modulus of elasticity, "E", in 1,000,000 pounds per square inch is shown below each span.

TABLE R-2 (cont.)

RAFTERS: Spans are measured along the horizontal projection and loads are considered as applied on the horizontal projection.

Extreme Fiber Stress in Bending, "F <sub>b</sub> " (psi).											RAFTER SPACING SIZE (IN)	
1400	1500	1600	1700	1800	1900	2000	2100	2200	2400	2700	(IN)	(IN)
12-6 1.28	13-0 1.41	13-5 1.56	13-10 1.71	14-2 1.86	14-7 2.02	15-0 2.18	15-4 2.34	15-8 2.51			12.0	2x6
11-9 1.19	12-2 1.32	12-6 1.46	12-11 1.60	13-3 1.74	13-8 1.89	14-0 2.04	14-4 2.19	14-8 2.35			13.7	
10-10 1.10	11-3 1.22	11-7 1.35	11-11 1.48	12-4 1.61	12-8 1.75	13-0 1.89	13-3 2.03	13-7 2.18	14-2 2.48		16.0	
9-11 1.01	10-3 1.12	10-7 1.23	10-11 1.35	11-3 1.47	11-6 1.59	11-10 1.72	12-2 1.85	12-5 1.99	13-0 2.26		19.2	
8-10 0.90	9-2 1.00	9-6 1.10	9-9 1.21	10-0 1.31	10-4 1.43	10-7 1.54	10-10 1.66	11-1 1.78	11-7 2.02	12-4 2.41	24.0	
16-6 1.28	17-1 1.41	17-8 1.56	18-2 1.71	18-9 1.86	19-3 2.02	19-9 2.18	20-3 2.34	20-8 2.51			12.0	
15-5 1.19	16-0 1.32	16-6 1.46	17-0 1.60	17-6 1.74	18-0 1.89	18-5 2.04	18-11 2.19	19-4 2.35			13.7	
14-4 1.10	14-10 1.22	15-3 1.35	15-9 1.48	16-3 1.61	16-8 1.75	17-1 1.89	17-6 2.03	17-11 2.18	18-9 2.48		16.0	
13-1 1.01	13-6 1.12	13-11 1.23	14-5 1.35	14-10 1.47	15-2 1.59	15-7 1.72	16-0 1.85	16-4 1.99	17-1 2.26		19.2	
11-8 0.90	12-1 1.00	12-6 1.10	12-10 1.21	13-3 1.31	13-7 1.43	13-11 1.54	14-4 1.66	14-8 1.78	15-3 2.02	16-3 2.41	24.0	

21-1 1.28	21-10 1.41	22-6 1.56	23-3 1.71	23-11 1.86	24-6 2.02	25-2 2.18	25-10 2.34	26-5 2.51				12.0	2x10	
19-8 1.19	20-5 1.32	21-1 1.46	21-9 1.60	22-4 1.74	22-11 1.89	23-7 2.04	24-2 2.19	24-8 2.35				13.7		
18-3 1.10	18-11 1.22	19-6 1.35	20-1 1.48	20-8 1.61	21-3 1.75	21-10 1.89	22-4 2.03	22-10 2.18	23-11 2.48			16.0		
16-8 1.01	17-3 1.12	17-10 1.23	18-4 1.35	18-11 1.47	19-5 1.59	19-11 1.72	20-5 1.85	20-10 1.99	21-10 2.26			19.2		
14-11 0.90	15-5 1.00	15-11 1.10	16-5 1.21	16-11 1.31	17-4 1.43	17-10 1.54	18-3 1.66	18-8 1.78	19-6 2.02	20-8 2.41		24.0		
25-7 1.28	26-6 1.41	27-5 1.56	28-3 1.71	29-1 1.86	29-10 2.02	30-7 2.18	31-4 2.34	32-1 2.51				12.0	2x12	
24-0 1.19	24-10 1.32	25-7 1.46	26-5 1.60	27-2 1.74	27-11 1.89	28-8 2.04	29-4 2.19	30-0 2.35				13.7		
22-2 1.10	23-0 1.22	23-9 1.35	24-5 1.48	25-2 1.61	25-10 1.75	26-6 1.89	27-2 2.03	27-10 2.18	29-1 2.48			16.0		
20-3 1.01	21-0 1.12	21-8 1.23	22-4 1.35	23-0 1.47	23-7 1.59	24-2 1.72	24-10 1.85	25-5 1.99	26-6 2.26			19.2		
18-1 0.90	18-9 1.00	19-4 1.10	20-0 1.21	20-6 1.31	21-1 1.43	21-8 1.54	22-2 1.66	22-8 1.78	23-9 2.02	25-2 2.41		24.0		

Note: The required modulus of elasticity, "E", in 1,000,000 pounds per square inch is shown below each span.

**TABLE R-3**  
**FLAT OR SLOPED RAFTERS**  
 Supporting Drywall Ceiling  
 (Flat roof or cathedral ceiling with no attic space)  
 Live Load - 40 lbs. per sq. ft.

**DESIGN CRITERIA:**

Strength - 15 lbs. per sq. ft. dead load plus 40 lbs. per sq. ft. live load determines required fiber stress.

Deflection - For 40 lbs. per sq. ft. live load. Limited to span in inches divided by 240.

RAFTER SIZE SPACING (IN)		Extreme Fiber Stress in Bending, "F <sub>b</sub> " (psi).										
		300	400	500	600	700	800	900	1000	1100	1200	1300
2x6	12.0	5-3 0.12	6-1 0.19	6-9 0.27	7-5 0.35	8-0 0.44	8-7 0.54	9-1 0.65	9-7 0.76	10-0 0.88	10-6 1.00	10-11 1.13
	13.7	4-11 0.12	5-8 0.18	6-4 0.25	6-11 0.33	7-6 0.42	8-0 0.51	8-6 0.61	8-11 0.71	9-5 0.82	9-10 0.93	10-3 1.05
	16.0	4-6 0.11	5-3 0.17	5-10 0.23	6-5 0.31	6-11 0.39	7-5 0.47	7-10 0.56	8-3 0.66	8-8 0.76	9-1 0.86	9-5 0.98
	19.2	4-2 0.10	4-9 0.15	5-4 0.21	5-10 0.28	6-4 0.35	6-9 0.43	7-2 0.51	7-7 0.60	7-11 0.69	8-3 0.79	8-8 0.89
	24.0	3-8 0.09	4-3 0.14	4-9 0.19	5-3 0.25	5-8 0.31	6-1 0.38	6-5 0.46	6-9 0.54	7-1 0.62	7-5 0.71	7-9 0.80
2x8	12.0	6-11 0.12	8-0 0.19	8-11 0.27	9-9 0.35	10-7 0.44	11-3 0.54	12-0 0.65	12-7 0.76	13-3 0.88	13-10 1.00	14-5 1.13
	13.7	6-6 0.12	7-6 0.18	8-4 0.25	9-2 0.33	9-11 0.42	10-7 0.51	11-2 0.61	11-10 0.71	12-5 0.82	12-11 0.93	13-6 1.05
	16.0	6-0 0.11	6-11 0.17	7-9 0.23	8-6 0.31	9-2 0.39	9-9 0.47	10-4 0.56	10-11 0.66	11-6 0.76	12-0 0.86	12-6 0.98
	19.2	5-6 0.10	6-4 0.15	7-1 0.21	7-9 0.28	8-4 0.35	8-11 0.43	9-6 0.51	10-0 0.60	10-6 0.69	10-11 0.79	11-5 0.89
	24.0	4-11 0.09	5-8 0.14	6-4 0.19	6-11 0.25	7-6 0.31	8-0 0.38	8-6 0.46	8-11 0.54	9-4 0.62	9-9 0.71	10-2 0.80

2x10	12.0	8.10 0.12	10.2 0.19	11.5 0.27	12.6 0.35	13.6 0.44	14.5 0.54	15.3 0.65	16.1 0.76	16.11 0.88	17.8 1.00	18.4 1.13
	13.7	8.3 0.12	9.6 0.18	10.8 0.25	11.8 0.33	12.7 0.42	13.6 0.51	14.3 0.61	15.1 0.71	15.10 0.82	16.6 0.93	17.2 1.05
	16.0	7.8 0.11	8.10 0.17	9.10 0.23	10.10 0.31	11.8 0.39	12.6 0.47	13.3 0.56	13.11 0.66	14.8 0.76	15.3 0.86	15.11 0.98
	19.2	7.0 0.10	8.1 0.15	9.0 0.21	9.10 0.28	10.8 0.35	11.5 0.43	12.1 0.51	12.9 0.60	13.4 0.69	13.11 0.79	14.6 0.89
	24.0	6.3 0.09	7.2 0.14	8.1 0.19	8.10 0.25	9.5 0.31	10.2 0.38	10.10 0.46	11.5 0.54	11.11 0.62	12.6 0.71	13.0 0.80
	24.0	10.9 0.12	12.5 0.19	13.10 0.27	15.2 0.35	16.5 0.44	17.6 0.54	18.7 0.65	19.7 0.76	20.6 0.88	21.5 1.00	22.4 1.13
2x12	12.0	10.0 0.12	11.7 0.18	12.11 0.25	14.2 0.33	15.4 0.42	16.5 0.51	17.5 0.61	18.4 0.71	19.3 0.82	20.1 0.93	20.11 1.05
	13.7	9.3 0.11	10.9 0.17	12.0 0.23	13.2 0.31	14.2 0.39	15.2 0.47	16.1 0.56	17.0 0.66	17.9 0.76	18.7 0.86	19.4 0.98
	16.0	8.6 0.10	9.10 0.15	10.11 0.21	12.0 0.28	12.11 0.35	13.10 0.43	14.8 0.51	15.6 0.60	16.3 0.69	17.0 0.79	17.8 0.89
	19.2	7.7 0.09	8.9 0.14	9.10 0.19	10.9 0.25	11.7 0.31	12.5 0.38	13.2 0.46	13.10 0.54	14.6 0.62	15.2 0.71	15.9 0.80
	24.0	7.7 0.09	8.9 0.14	9.10 0.19	10.9 0.25	11.7 0.31	12.5 0.38	13.2 0.46	13.10 0.54	14.6 0.62	15.2 0.71	15.9 0.80
	24.0	10.9 0.12	12.5 0.19	13.10 0.27	15.2 0.35	16.5 0.44	17.6 0.54	18.7 0.65	19.7 0.76	20.6 0.88	21.5 1.00	22.4 1.13

Note: The required modulus of elasticity, "E", in 1,000,000 pounds per square inch is shown below each span.

TABLE R-3 (cont.)

RAFTERS: Spans are measured along the horizontal projection and loads are considered as applied on the horizontal projection.

Extreme Fiber Stress in Bending, "F <sub>b</sub> " (psi).											RAFTER SPACING SIZE (IN)	
1400	1500	1600	1700	1800	1900	2000	2100	2200	2400	2700	(IN)	(IN)
11-4 1.26	11-9 1.40	12-1 1.54	12-6 1.68	12-10 1.83	13-2 1.99	13-6 2.15	13-10 2.31	14-2 2.48			12.0	2x6
10-7 1.18	11-0 1.31	11-4 1.44	11-8 1.57	12-0 1.72	12-4 1.86	12-8 2.01	13-0 2.16	13-3 2.32			13.7	
9-10 1.09	10-2 1.21	10-6 1.33	10-10 1.46	11-1 1.59	11-5 1.72	11-9 1.86	12-0 2.00	12-4 2.15	12-10 2.45		16.0	
8-11 0.99	9-3 1.10	9-7 1.22	9-10 1.33	10-2 1.45	10-5 1.57	10-8 1.70	11-0 1.83	11-3 1.96	11-9 2.23		19.2	
8-0 0.89	8-3 0.99	8-7 1.09	8-10 1.19	9-1 1.30	9-4 1.41	9-7 1.52	9-10 1.63	10-0 1.75	10-6 2.00	11-1 2.38	24.0	
14-11 1.26	15-5 1.40	16-0 1.54	16-5 1.68	16-11 1.83	17-5 1.99	17-10 2.15	18-3 2.31	18-9 2.48			12.0	
14-0 1.18	14-6 1.31	14-11 1.44	15-5 1.57	15-10 1.72	16-3 1.86	16-8 2.01	17-1 2.16	17-6 2.32			13.7	
12-11 1.09	13-5 1.21	13-10 1.33	14-3 1.46	14-8 1.59	15-1 1.72	15-5 1.86	15-10 2.00	16-3 2.15	16-11 2.45		16.0	
11-10 0.99	12-3 1.10	12-7 1.22	13-0 1.33	13-5 1.45	13-9 1.57	14-1 1.70	14-6 1.83	14-10 1.96	15-5 2.23		19.2	
10-7 0.89	10-11 0.99	11-3 1.09	11-8 1.19	12-0 1.30	12-4 1.41	12-7 1.52	12-11 1.63	13-3 1.75	13-10 2.00	14-8 2.38	24.0	

19-1 1.26	19-9 1.40	20-4 1.54	21-0 1.68	21-7 1.83	22-2 1.99	22-9 2.15	23-4 2.31	23-11 2.48			12.0	2x10
17-10 1.18	18-5 1.31	19-1 1.44	19-8 1.57	20-2 1.72	20-9 1.86	21-4 2.01	21-10 2.16	22-4 2.32			13.7	
16-6 1.09	17-1 1.21	17-8 1.33	18-2 1.46	18-9 1.59	19-3 1.72	19-9 1.86	20-2 2.00	20-8 2.15	21-7 2.45		16.0	
15-1 0.99	15-7 1.10	16-1 1.22	16-7 1.33	17-1 1.45	17-7 1.57	18-0 1.70	18-5 1.83	18-11 1.96	19-9 2.23		19.2	
13-6 0.89	13-11 0.99	14-5 1.09	14-10 1.19	15-3 1.30	15-8 1.41	16-1 1.52	16-6 1.63	16-11 1.75	17-8 2.00	18-9 2.38	24.0	
23-2 1.26	24-0 1.40	24-9 1.54	25-6 1.68	26-3 1.83	27-0 1.99	27-8 2.15	28-5 2.31	29-1 2.48			12.0	2x12
21-8 1.18	22-5 1.31	23-2 1.44	23-11 1.57	24-7 1.72	25-3 1.86	25-11 2.01	26-7 2.16	27-2 2.32			13.7	
20-1 1.09	20-9 1.21	21-5 1.33	22-1 1.46	22-9 1.59	23-5 1.72	24-0 1.86	24-7 2.00	25-2 2.15	26-3 2.45		16.0	
18-4 0.99	19-0 1.10	19-7 1.22	20-2 1.33	20-9 1.45	21-4 1.57	21-11 1.70	22-5 1.83	23-0 1.96	24-0 2.23		19.2	
16-5 0.89	17-0 0.99	17-6 1.09	18-1 1.19	18-7 1.30	19-1 1.41	19-7 1.52	20-1 1.63	20-6 1.75	21-5 2.00	22-9 2.38	24.0	

Note: The required modulus of elasticity, "E", in 1,000,000 pounds per square inch is shown below each span.

**TABLE R-4**  
**FLAT OR SLOPED RAFTERS**  
**Supporting Plaster Ceiling**  
 (Flat roof or cathedral ceiling with no attic space)  
 Live Load - 20 lb. per sq. ft.

**DESIGN CRITERIA:**

Strength - 15 lbs. per sq. ft. dead load plus 20 lbs. per sq. ft. live load determines required fiber stress.

Deflection - For 20 lbs. per sq. ft. live load. Limited to span in inches divided by 360.

RAFTER SIZE SPACING (IN) (IN)		Extreme Fiber Stress in Bending, "F <sub>b</sub> " (psi).									
		300	400	500	600	700	800	900	1000	1100	1200
2x6	12.0	6.7 0.18	7.7 0.28	8.6 0.40	9.4 0.52	10.0 0.66	10.9 0.80	11.5 0.96	12.0 1.12	12.7 1.29	13.2 1.48
	13.7	6.2 0.17	7.1 0.27	7.11 0.37	8.8 0.49	9.5 0.61	10.0 0.75	10.8 0.90	11.3 1.05	11.9 1.21	12.4 1.38
	16.0	5.8 0.16	6.7 0.25	7.4 0.34	8.1 0.45	8.8 0.57	9.4 0.70	9.10 0.83	10.5 0.97	10.11 1.12	11.5 1.28
	19.2	5.2 0.15	6.0 0.22	6.9 0.31	7.4 0.41	7.11 0.52	8.6 0.63	9.0 0.76	9.6 0.89	9.11 1.02	10.5 1.17
	24.0	4.8 0.13	5.4 0.20	6.0 0.28	6.7 0.37	7.1 0.46	7.7 0.57	8.1 0.68	8.6 0.79	8.11 0.92	9.4 1.04
2x8	12.0	8.8 0.18	10.0 0.28	11.2 0.40	12.3 0.52	13.3 0.66	14.2 0.80	15.0 0.96	15.10 1.12	16.7 1.29	17.4 1.48
	13.7	8.1 0.17	9.4 0.27	10.6 0.37	11.6 0.49	12.5 0.61	13.3 0.75	14.0 0.90	14.10 1.05	15.6 1.21	16.3 1.38
	16.0	7.6 0.16	8.8 0.25	9.8 0.34	10.7 0.45	11.6 0.57	12.3 0.70	13.0 0.83	13.8 0.97	14.4 1.12	15.0 1.28
	19.2	6.10 0.15	7.11 0.22	8.10 0.31	9.8 0.41	10.6 0.52	11.2 0.63	11.10 0.76	12.6 0.89	13.1 1.02	13.8 1.17
	24.0	6.2 0.13	7.1 0.20	7.11 0.28	8.8 0.37	9.4 0.46	10.0 0.57	10.7 0.68	11.2 0.79	11.9 0.92	12.3 1.04



2x10	12.0	11.1 0.18	12.9 0.28	14.3 0.40	15.8 0.52	16.11 0.66	18.1 0.80	19.2 0.96	20.2 1.12	21.2 1.29	22.1 1.48
	13.7	10.4 0.17	11.11 0.27	13.4 0.37	14.8 0.49	15.10 0.61	16.11 0.75	17.11 0.90	18.11 1.05	19.10 1.21	20.8 1.38
	16.0	9.7 0.16	11.1 0.25	12.4 0.34	13.6 0.45	14.8 0.57	15.8 0.70	16.7 0.83	17.6 0.97	18.4 1.12	19.2 1.28
	19.2	8.9 0.15	10.1 0.22	11.3 0.31	12.4 0.41	13.4 0.52	14.3 0.63	15.2 0.76	15.11 0.89	15.9 1.02	17.6 1.17
	24.0	7.10 0.13	9.0 0.20	10.1 0.28	11.1 0.37	11.11 0.46	12.9 0.57	13.6 0.68	14.3 0.79	15.0 0.92	15.8 1.04
2x12	12.0	13.5 0.18	15.6 0.28	17.4 0.40	19.0 0.52	20.6 0.66	21.11 0.80	23.3 0.96	24.7 1.12	25.9 1.29	26.11 1.48
	13.7	12.7 0.17	14.6 0.27	16.3 0.37	17.9 0.49	19.3 0.61	20.6 0.75	21.9 0.90	23.0 1.05	24.1 1.21	25.2 1.38
	16.0	11.8 0.16	13.5 0.25	15.0 0.34	16.6 0.45	17.9 0.57	19.0 0.70	20.2 0.83	21.3 0.97	22.4 1.12	23.3 1.28
	19.2	10.8 0.15	12.3 0.22	13.9 0.31	15.0 0.41	16.3 0.52	17.4 0.63	18.5 0.76	19.5 0.89	20.4 1.02	21.3 1.17
	24.0	9.6 0.13	11.0 0.20	12.3 0.28	13.5 0.37	14.6 0.46	15.6 0.57	16.6 0.68	17.4 0.79	18.2 0.92	19.0 1.04

Note: The required modulus of elasticity, "E", in 1,000,000 pounds per square inch is shown below each span.

TABLE R-4 (cont.)

RAFTERS: Spans are measured along the horizontal projection and loads are considered as applied on the horizontal projection.

Extreme Fiber Stress in Bending, "F <sub>b</sub> " (psi).									RAFTER SPACING SIZE (IN) (IN)	
1300	1400	1500	1600	1700	1800	1900	2000	2100		
13.8 1.66	14.2 1.86	14.8 2.06	15.2 2.27	15.8 2.49						12.0
12.10 1.56	13.3 1.74	13.9 1.93	14.2 2.12	14.8 2.33	15.1 2.54					13.7
11.10 1.44	12.4 1.61	12.9 1.79	13.2 1.97	13.7 2.15	13.11 2.35	14.4 2.55				16.0
10.10 1.32	11.3 1.47	11.7 1.63	12.0 1.80	12.4 1.97	12.9 2.14	13.1 2.32	13.5 2.51			19.2
9.8 1.18	10.0 1.31	10.5 1.46	10.9 1.61	11.1 1.76	11.5 1.92	11.8 2.08	12.0 2.24	12.4 2.41		24.0
18.0 1.66	18.9 1.86	19.5 2.06	20.0 2.27	20.8 2.49						12.0
16.10 1.56	17.6 1.74	18.2 1.93	18.9 2.12	19.4 2.33	19.10 2.54					13.7
15.7 1.44	16.3 1.61	16.9 1.79	17.4 1.97	17.10 2.15	18.5 2.35	18.11 2.55				16.0
14.3 1.32	14.10 1.47	15.4 1.63	15.10 1.80	16.4 1.97	16.9 2.14	17.3 2.32	17.8 2.51			19.2
12.9 1.18	13.3 1.31	13.8 1.46	14.2 1.61	14.7 1.76	15.0 1.92	15.5 2.08	15.10 2.24	16.3 2.41		24.0

23.0	23.11	24.9	25.6	26.4					12.0
1.66	1.86	2.06	2.27	2.48					
21.6	22.4	23.2	23.11	24.7	25.4				13.7
1.56	1.74	1.93	2.12	2.33	2.54				
19.11	20.8	21.5	22.1	22.10	23.5	24.1			16.0
1.44	1.63	1.79	1.97	2.15	2.35	2.55			2x10
18.2	18.11	19.7	20.2	20.10	21.5	22.0	22.7		
1.32	1.47	1.63	1.80	1.97	2.14	2.32	2.51		19.2
16.3	16.11	17.6	18.1	18.7	19.2	19.8	20.7	20.8	
1.18	1.31	1.46	1.61	1.76	1.92	2.08	2.24	2.41	24.0
28.0	29.1	30.1	31.1	32.0					
1.65	1.86	2.06	2.27	2.49					12.0
26.2	27.2	28.2	29.1	30.11	30.10				
1.56	1.74	1.93	2.13	2.33	2.54				13.7
24.3	25.2	26.0	26.11	27.9	28.6	29.4			
1.44	1.61	1.79	1.97	2.15	2.35	2.55			16.0
22.2	23.0	23.9	24.7	25.4	26.0	26.6	27.5		
1.32	1.47	1.63	1.80	1.97	2.14	2.32	2.51		19.2
19.10	20.6	21.2	21.11	22.8	23.3	23.11	24.7	25.2	
1.18	1.31	1.46	1.61	1.76	1.92	2.08	2.24	2.41	24.0

Note: The required modulus of elasticity,  $E$ , in 1,000,000 pounds per square inch is shown below each span.

**TABLE R-5**  
**FLAT OR SLOPED RAFTERS**  
**Supporting Plaster Ceiling**  
 (Flat roof or cathedral ceiling with no attic space)  
 Live Load - 30 lbs. per sq. ft.

**DESIGN CRITERIA:**  
 Strength - 15 lbs. per sq. ft. dead load plus 30 lbs. per sq. ft. live load determines required fiber stress.  
 Deflection - For 30 lbs. per sq. ft. live load. Limited to Span in inches divided by 360.

RAFTER SIZE SPACING (IN) (IN)		Extreme Fiber Stress in Bending, "F <sub>b</sub> " (psi).									
		300	400	500	600	700	890	900	1000	1100	1200
2x6	12.0	5-10 0.19	6-8 0.29	7-6 0.41	8-2 0.54	8-10 0.68	9-6 0.83	10-0 0.99	10-7 1.15	11-1 1.33	11-7 1.52
	13.7	5-5 0.18	6-3 0.27	7-0 0.38	7-8 0.50	8-3 0.63	8-10 0.77	9-5 0.92	9-11 1.08	10-5 1.25	10-10 1.42
	16.0	5-0 0.16	5-10 0.25	6-6 0.35	7-1 0.46	7-8 0.59	8-2 0.72	8-8 0.85	9-2 1.00	9-7 1.15	10-0 1.31
	19.2	4-7 0.15	5-4 0.23	5-11 0.32	6-6 0.42	7-0 0.53	7-6 0.65	7-11 0.78	8-4 0.91	8-9 1.05	9-2 1.20
	24.0	4-1 0.13	4-9 0.21	5-4 0.29	5-10 0.38	6-3 0.48	6-8 0.58	7-1 0.70	7-6 0.82	7-10 0.94	8-2 1.07
2x8	12.0	7-8 0.19	8-10 0.29	9-10 0.41	10-10 0.54	11-8 0.68	12-6 0.83	13-3 0.99	13-11 1.15	14-8 1.33	15-3 1.52
	13.7	7-2 0.18	8-3 0.27	9-3 0.38	10-1 0.50	10-11 0.63	11-8 0.77	12-5 0.92	13-1 1.08	13-8 1.25	14-4 1.42
	16.0	6-7 0.16	7-8 0.25	8-7 0.35	9-4 0.46	10-1 0.59	10-10 0.72	11-6 0.85	12-1 1.00	12-8 1.15	13-3 1.31
	19.2	6-1 0.15	7-0 0.23	7-10 0.32	8-7 0.42	9-3 0.53	9-10 0.65	10-6 0.78	11-0 0.91	11-7 1.05	12-1 1.20
	24.0	5-5 0.13	6-3 0.21	7-0 0.29	7-8 0.38	8-3 0.48	8-10 0.58	9-4 0.70	9-10 0.82	10-4 0.94	10-10 1.07

2x10	12.0	9-9 0.19	11-3 0.29	12-7 0.41	13-9 0.54	14-11 0.68	15-11 0.83	16-11 0.99	17-10 1.15	18-8 1.33	19-6 1.52
	13.7	9-1 0.18	10-6 0.27	11-9 0.38	12-11 0.50	13-11 0.63	14-11 0.77	15-10 0.92	16-8 1.08	17-6 1.25	18-3 1.42
	16.0	8-5 0.16	9-9 0.25	10-11 0.35	11-11 0.46	12-11 0.59	13-9 0.72	14-8 0.85	15-5 1.00	16-2 1.15	16-11 1.31
	19.2	7-8 0.15	8-11 0.23	9-11 0.32	10-11 0.42	11-9 0.53	12-7 0.65	13-4 0.78	14-1 0.91	14-9 1.05	15-5 1.20
	24.0	6-11 0.13	8-0 0.21	8-11 0.29	9-9 0.38	10-6 0.48	11-3 0.58	11-11 0.70	12-7 0.82	13-2 0.94	13-9 1.07
2x12	12.0	11-10 0.19	13-8 0.29	15-4 0.41	16-9 0.54	18-1 0.68	19-4 0.83	20-6 0.99	21-8 1.15	22-8 1.33	23-9 1.52
	13.7	11-1 0.18	12-10 0.27	14-4 0.38	15-8 0.50	16-11 0.63	18-1 0.77	19-3 0.92	20-3 1.08	21-3 1.25	22-2 1.42
	16.0	10-3 0.16	11-10 0.25	13-3 0.35	14-6 0.46	15-8 0.59	16-9 0.72	17-9 0.85	18-9 1.00	19-8 1.15	20-6 1.31
	19.2	9-5 0.15	10-10 0.23	12-1 0.32	13-3 0.42	14-4 0.53	15-4 0.65	16-3 0.78	17-1 0.91	17-11 1.05	18-9 1.20
	24.0	8-5 0.13	9-8 0.21	10-10 0.29	11-10 0.38	12-10 0.48	13-8 0.58	14-6 0.70	15-4 0.82	16-1 0.94	16-9 1.07

Note: The required modulus of elasticity, "E", in 1,000,000 pounds per square inch is shown below each span.

TABLE R-5 (cont.)

RAFTERS Spans are measured along the horizontal projection and loads are considered as applied on the horizontal projection.

Extreme Fiber Stress in Bending, "F <sub>b</sub> " (psi).									RAFTER SPACING SIZE (IN) (IN)
1300	1400	1500	1600	1700	1800	1900	2000	2100	
12.1 1.71	12.6 1.91	13.0 2.12	13.5 2.34	13.10 2.56					12.0
11.3 1.60	11.9 1.79	12.2 1.98	12.6 2.19	12.11 2.39					13.7
10.5 1.48	10.10 1.66	11.3 1.84	11.7 2.02	11.11 2.22	12.4 2.41				16.0
9.6 1.35	9.11 1.51	10.3 1.68	10.7 1.85	10.11 2.02	11.3 2.20	11.0 2.39	11.10 2.58		19.2
8.5 1.21	8.10 1.35	9.2 1.50	9.6 1.65	9.9 1.81	10.0 1.97	10.4 2.14	10.7 2.31	10.10 2.48	24.0
15.11 1.71	16.6 1.91	17.1 2.12	17.8 2.34	18.2 2.56					12.0
14.11 1.60	15.5 1.79	16.0 1.98	16.6 2.19	17.0 2.39					13.7
13.9 1.48	14.4 1.66	14.10 1.84	15.3 2.02	15.9 2.22	16.3 2.41				16.0
12.7 1.35	13.1 1.51	13.6 1.68	13.11 1.85	14.5 2.02	14.10 2.20	15.2 2.39	15.7 2.58		19.2
11.3 1.21	11.8 1.35	12.1 1.50	12.6 1.65	12.10 1.81	13.3 1.97	13.7 2.14	13.11 2.31	14.4 2.48	24.0

20.4	21.1	21.10	22.6	23.3					
1.71	1.91	2.12	2.34	2.56					12.0
19.0	19.8	20.5	21.1	21.9					13.7
1.60	1.79	1.98	2.19	2.39					16.0
17.7	18.3	18.11	19.6	20.1	20.8				2x10
1.48	1.63	1.84	2.02	2.22	2.41				19.2
16.1	16.8	17.3	17.10	18.4	18.11	19.5	19.11		24.0
1.35	1.51	1.68	1.85	2.02	2.20	2.30	2.58		12.0
14.4	14.11	15.5	15.11	16.5	16.11	17.4	17.10	18.3	13.7
1.21	1.35	1.50	1.65	1.81	1.97	2.14	2.31	2.48	16.0
24.8	25.7	26.6	27.5	28.3					19.2
1.71	1.91	2.12	2.34	2.56					24.0
23.1	24.0	24.10	25.7	26.5					12.0
1.60	1.79	1.98	2.19	2.39					13.7
21.5	22.2	23.0	23.9	24.5	25.2				16.0
1.48	1.65	1.84	2.02	2.22	2.41				2x12
19.6	20.3	21.0	21.8	22.4	23.0	23.7	24.2		19.2
1.35	1.51	1.68	1.85	2.02	2.20	2.30	2.58		24.0
17.5	18.1	18.9	19.4	20.0	20.6	21.1	21.8	22.2	12.0
1.21	1.35	1.50	1.65	1.81	1.97	2.14	2.31	2.48	13.7

Note: The required quantities of electricity, "E", in 1,000,000 pounds per square inch is shown below each item.

**TABLE R-6**  
**FLAT OR SLOPED RAFTERS**  
 Supporting Plaster Ceiling  
 (Flat roof or cathedral ceiling with no attic space)  
 Live Load - 40 lb. per sq. ft.

**DESIGN CRITERIA:**  
 Strength - 15 lbs. per sq. ft. dead load plus 40 lbs. per sq. ft. live load determines required fiber stress.  
 Deflection - For 40 lbs. per sq. ft. live load. Limited to span in inches divided by 360.

RAFTER SIZE	SPACING (IN)	Extreme Fiber Stress in Bending, "F <sub>b</sub> " (psi).									
		300	400	500	600	700	800	900	1000	1100	1200
2x6	12.0	5-3 0.19	6-1 0.29	6-9 0.40	7-5 0.53	8-0 0.67	8-7 0.82	9-1 0.97	9-7 1.14	10-0 1.31	10-6 1.50
	13.7	4-11 0.18	5-8 0.27	6-4 0.38	6-11 0.50	7-6 0.62	8-0 0.76	8-6 0.91	8-11 1.07	9-5 1.23	9-10 1.40
	16.0	4-6 0.16	5-3 0.25	5-10 0.35	6-5 0.46	6-11 0.58	7-5 0.71	7-10 0.84	8-3 0.99	8-8 1.14	9-1 1.30
	19.2	4-2 0.15	4-9 0.23	5-4 0.32	5-10 0.42	6-4 0.53	6-9 0.64	7-2 0.77	7-7 0.90	7-11 1.04	8-3 1.18
	24.0	3-8 0.13	4-3 0.20	4-9 0.28	5-3 0.37	5-8 0.47	6-1 0.58	6-5 0.69	6-9 0.81	7-1 0.93	7-5 1.06
	24.0	6-11 0.19	8-0 0.29	8-11 0.40	9-9 0.53	10-7 0.67	11-3 0.82	12-0 0.97	12-7 1.14	13-3 1.31	13-10 1.50
2x8	13.7	6-6 0.18	7-6 0.27	8-4 0.38	9-2 0.50	9-11 0.62	10-7 0.76	11-2 0.91	11-10 1.07	12-5 1.23	12-11 1.40
	16.0	6-0 0.16	6-11 0.25	7-9 0.35	8-6 0.46	9-2 0.58	9-9 0.71	10-4 0.84	10-11 0.99	11-6 1.14	12-0 1.30
	19.2	5-6 0.15	6-4 0.23	7-1 0.32	7-9 0.42	8-4 0.53	8-11 0.64	9-6 0.77	10-0 0.90	10-6 1.04	10-11 1.18
	24.0	4-11 0.13	5-8 0.20	6-4 0.28	6-11 0.37	7-6 0.47	8-0 0.58	8-6 0.69	8-11 0.81	9-4 0.93	9-9 1.06
	24.0	6-11 0.19	8-0 0.29	8-11 0.40	9-9 0.53	10-7 0.67	11-3 0.82	12-0 0.97	12-7 1.14	13-3 1.31	13-10 1.50



2x10	12.0	8-10 0.19	10-2 0.29	11-5 0.40	12-6 0.53	13-6 0.67	14-5 0.82	15-3 0.97	16-1 1.14	16-11 1.31	17-8 1.50
	13.7	8-3 0.18	9-6 0.27	10-8 0.38	11-8 0.50	12-7 0.62	13-6 0.76	14-3 0.91	15-1 1.07	15-10 1.23	16-6 1.40
	16.0	7-8 0.16	8-10 0.25	9-10 0.35	10-10 0.46	11-8 0.58	12-6 0.71	13-3 0.84	13-11 0.99	14-8 1.14	15-3 1.30
	19.2	7-0 0.15	8-1 0.23	9-0 0.32	9-10 0.42	10-8 0.53	11-5 0.64	12-1 0.77	12-9 0.90	13-4 1.04	13-11 1.18
	24.0	6-3 0.13	7-2 0.20	8-1 0.28	8-10 0.37	9-6 0.47	10-2 0.58	10-10 0.69	11-5 0.81	11-11 0.93	12-6 1.06
2x12	12.0	10-9 0.19	12-5 0.29	13-10 0.40	15-2 0.53	16-5 0.67	17-6 0.82	18-7 0.97	19-7 1.14	20-6 1.31	21-5 1.50
	13.7	10-0 0.18	11-7 0.27	12-11 0.38	14-2 0.50	15-4 0.62	16-5 0.76	17-5 0.91	18-4 1.07	19-3 1.23	20-1 1.40
	16.0	9-3 0.16	10-9 0.25	12-0 0.35	13-2 0.46	14-2 0.58	15-2 0.71	16-1 0.84	17-0 0.99	17-9 1.14	18-7 1.30
	19.2	8-6 0.15	9-10 0.23	10-11 0.32	12-0 0.42	12-11 0.53	13-10 0.64	14-8 0.77	15-6 0.90	16-3 1.04	17-0 1.18
	24.0	7-7 0.13	8-9 0.20	9-10 0.28	10-9 0.37	11-7 0.47	12-5 0.58	13-2 0.69	13-10 0.81	14-6 0.93	15-2 1.06

Note: The required modulus of elasticity, "E", in 1,000,000 pounds per square inch is shown below each span.

TABLE R-6 (cont.)

RAFTERS: Spans are measured along the horizontal projection and loads are considered as applied on the horizontal projection.

Extreme Fiber Stress in Bending, "F <sub>b</sub> " (psi)									RAFTER SPACING SIZE (IN) (IN)
1300	1400	1500	1600	1700	1800	1900	2000	2100	
10-11 1.69	11-4 1.89	11-9 2.09	12-1 2.31	12-6 2.53					12.0
10-3 1.58	10-7 1.77	11-0 1.96	11-4 2.16	11-8 2.36	12-0 2.57				13.7
9-5 1.46	9-10 1.63	10-2 1.81	10-6 2.00	10-10 2.19	11-1 2.38	11-5 2.58			16.0
8-8 1.34	8-11 1.49	9-3 1.65	9-7 1.82	9-10 2.00	10-2 2.18	10-5 2.36	10-8 2.55		19.2
7-9 1.19	8-0 1.33	8-3 1.48	8-7 1.63	8-10 1.79	9-1 1.95	9-4 2.11	9-7 2.28	9-10 2.45	24.0
14-5 1.69	14-11 1.89	15-5 2.09	16-0 2.31	16-5 2.53					12.0
13-6 1.58	14-0 1.77	14-6 1.96	14-11 2.16	15-5 2.36	15-10 2.57				13.7
12-6 1.46	12-11 1.63	13-5 1.81	13-10 2.00	14-3 2.19	14-8 2.38	15-1 2.58			16.0
11-5 1.34	11-10 1.49	12-3 1.65	12-7 1.82	13-0 2.00	13-5 2.18	13-9 2.36	14-1 2.55		19.2
10-2 1.19	10-7 1.33	10-11 1.48	11-3 1.63	11-8 1.79	12-0 1.95	12-4 2.11	12-7 2.28	12-11 2.45	24.0

18.4 1.69	19.1 1.89	19.9 2.09	20.4 2.31	21.0 2.53					12.0	2x10
17.2 1.58	17.10 1.77	18.5 1.96	19.1 2.16	19.8 2.36	20.2 2.57				13.7	
15.11 1.46	16.6 1.63	17.1 1.81	17.8 2.00	18.2 2.19	18.9 2.38	19.3 2.58			16.0	
14.6 1.34	15.1 1.49	15.7 1.65	16.1 1.82	16.7 2.00	17.1 2.18	17.7 2.36	18.0 2.55		19.2	
13.0 1.19	13.6 1.33	13.11 1.48	14.5 1.63	14.10 1.79	15.3 1.95	15.8 2.11	16.1 2.28	16.6 2.45	24.0	
22.4 1.69	23.2 1.89	24.0 2.00	24.9 2.31	25.6 2.53					12.0	
20.11 1.58	21.8 1.77	22.5 1.96	23.2 2.16	23.11 2.36	24.7 2.57				13.7	
19.4 1.46	20.1 1.63	20.9 1.81	21.5 2.00	22.1 2.19	22.9 2.38	23.5 2.58			16.0	
17.8 1.34	18.4 1.49	19.0 1.65	19.7 1.82	20.2 2.00	20.9 2.18	21.4 2.36	21.11 2.55		19.2	
15.9 1.19	16.5 1.33	17.0 1.48	17.6 1.63	18.1 1.79	18.7 1.95	19.1 2.11	19.7 2.28	20.1 2.45	24.0	

Note: The required modulus of elasticity, "E", in 1,000,000 pounds per square inch is shown below each span.

**TABLE TSJ-1**  
**TWO-SPAN FLOOR JOISTS**  
 40 Lbs. Per Sq. Ft. Live Load  
 (All rooms except those used for sleeping areas and attic floors)

**DESIGN CRITERIA:**  
 Deflection - For 40 lbs. per sq. ft. live load on one span and 20 lbs. per sq. ft. on other. Limited to span in inches divided by 360.  
 Strength - Live load of 40 lbs. per sq. ft. plus dead load of 10 lbs. per sq. ft. on both spans determines the required fiber stress value.

JOIST SIZE SPACING (IN)		Modulus of Elasticity, "E", in 1,000,000 psi															
		0.8	0.9	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	2.2	2.4	2.6
2x6	12.0	10-3 1060	10-8 1150	11-1 1230	11-5 1310	11-9 1390	12-1 1460	12-5 1540	12-8 1610	13-0 1680	13-3 1750	13-6 1820	13-9 1880	14-0 1950	14-2 2010	14-5 2080	14-8 2140
	13.7	9-10 1110	10-3 1200	10-7 1280	10-11 1370	11-3 1450	11-7 1530	11-10 1610	12-2 1680	12-5 1760	12-8 1830	12-11 1900	13-1 1970	13-4 2040	13-7 2100	13-9 2170	14-0 2240
	16.0	9-4 1170	9-9 1260	10-1 1350	10-5 1440	10-8 1530	11-0 1610	11-3 1690	11-6 1770	11-9 1850	12-0 1920	12-3 2000	12-6 2070	12-8 2140	12-11 2210	13-2 2280	13-4 2350
	19.2	8-9 1240	9-2 1340	9-6 1440	9-9 1530	10-1 1620	10-4 1710	10-7 1800	10-10 1880	11-1 1960	11-3 2040	11-6 2120	11-9 2200	11-11 2280	12-2 2350	12-4 2430	12-6 2500
	24.0	8-2 1330	8-6 1440	8-9 1550	9-1 1650	9-4 1750	9-7 1840	9-10 1940	10-1 2030	10-3 2120	10-6 2200	10-8 2290	10-11 2370	11-1 2450	11-3 2530	11-5 2610	11-7 2690
	2x8	12.0	13-7 1060	14-1 1150	14-7 1230	15-1 1310	15-6 1390	15-11 1460	16-4 1540	16-9 1610	17-1 1680	17-5 1750	17-9 1820	18-1 1880	18-5 1950	18-9 2010	19-0 2080
	13.7	13-0 1110	13-6 1200	14-0 1290	14-5 1370	14-10 1450	15-3 1530	15-8 1610	16-0 1680	16-4 1760	16-8 1830	17-0 1900	17-4 1970	17-7 2040	17-11 2110	18-2 2180	18-6 2240
	16.0	12-4 1170	12-10 1260	13-3 1350	13-8 1440	14-1 1530	14-6 1610	14-10 1690	15-2 1770	15-6 1850	15-10 1930	16-2 2000	16-5 2070	16-9 2150	17-0 2220	17-3 2290	17-6 2360
	19.2	11-7 1240	12-1 1340	12-6 1440	12-11 1530	13-3 1620	13-8 1710	14-0 1800	14-4 1880	14-7 1970	14-11 2050	15-2 2130	15-6 2200	15-9 2280	16-0 2360	16-3 2430	16-6 2500
	24.0	10-9 1340	11-2 1440	11-7 1550	12-0 1650	12-4 1750	12-8 1840	13-0 1940	13-3 2030	13-7 2120	13-10 2200	14-1 2290	14-4 2370	14-7 2460	14-10 2540	15-1 2620	15-4 2700

2x10	12.0	17.4 1060	18.0 1150	18.8 1230	19.3 1310	19.10 1390	20.4 1460	20.10 1540	21.4 1610	21.10 1680	22.3 1750	22.8 1820	23.1 1880	23.6 1950	23.11 2010	24.3 2080	24.8 2140
	13.7	16.7 1110	17.3 1200	17.10 1290	18.5 1370	19.0 1450	19.6 1530	20.0 1610	20.5 1680	20.10 1760	21.4 1830	21.9 1900	22.1 1970	22.6 2040	22.10 2110	23.3 2170	23.7 2240
	16.0	15.9 1170	16.4 1260	16.11 1350	17.6 1440	18.0 1530	18.6 1610	19.0 1690	19.5 1770	19.10 1850	20.3 1930	20.7 2000	21.0 2070	21.4 2150	21.9 2220	22.1 2290	22.5 2360
	19.2	14.10 1240	15.5 1340	15.11 1440	16.6 1530	16.11 1620	17.5 1710	17.10 1800	18.3 1890	18.8 1970	19.0 2050	19.5 2130	19.9 2200	20.1 2280	20.5 2360	20.9 2430	21.1 2500
	24.0	13.9 1340	14.3 1440	14.9 1550	15.3 1650	15.9 1750	16.2 1840	16.7 1940	16.11 2030	17.4 2120	17.8 2200	18.0 2290	18.4 2370	18.8 2460	19.0 2540	19.3 2620	19.7 2700
2x12	12.0	21.1 1060	21.11 1150	22.8 1230	23.5 1310	24.1 1390	24.9 1460	25.5 1540	26.0 1610	26.7 1680	27.1 1750	27.7 1820	28.1 1880	28.7 1950	29.1 2010	29.6 2080	30.0 2140
	13.7	20.2 1110	20.11 1200	21.8 1290	22.5 1370	23.1 1450	23.8 1530	24.2 1610	24.10 1680	25.5 1760	25.11 1830	26.5 1900	26.11 1970	27.4 2040	27.9 2110	28.3 2170	28.8 2240
	16.0	19.2 1170	19.11 1260	20.7 1350	21.3 1440	21.11 1530	22.6 1610	23.1 1690	23.7 1770	24.1 1850	24.7 1930	25.1 2000	25.7 2070	26.0 2150	26.5 2220	26.10 2290	27.3 2360
	19.2	18.0 1240	18.9 1340	19.5 1440	20.0 1530	20.7 1620	21.2 1710	21.8 1800	22.3 1880	22.8 1970	23.2 2050	23.7 2130	24.0 2200	24.5 2280	24.10 2360	25.3 2430	25.7 2500
	24.0	16.9 1340	17.5 1440	18.0 1550	18.7 1650	19.2 1750	19.8 1840	20.2 1940	20.8 2030	21.1 2120	21.6 2200	21.11 2290	22.4 2370	22.8 2460	23.1 2540	23.5 2620	23.9 2700

Note: The required extreme fiber stress in bending, " $F_b$ ", in pounds per square inch is shown below each span.

**TABLE TSJ-2**  
**TWO-SPAN FLOOR JOISTS**  
 30 Lbs. Per Sq. Ft. Live Load  
 (All rooms used for sleeping and attic floors)

**DESIGN CRITERIA:**  
 Deflection - For 30 lbs. per sq. ft. live load on one span and 15 lbs. per sq. ft. on other. Limited to span in inches divided by 360.  
 Strength - Live load of 30 lbs. per sq. ft. plus dead load of 10 lbs. per sq. ft. on both spans determines the required fiber stress value.

JOIST SIZE SPACING (IN)	Modulus of Elasticity, "E", in 1,000,000 psi																
	0.8	0.9	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	2.2	2.4	2.6	
12.0	11.4	11.9	12.2	12.7	13.0	13.4	13.8	14.0	14.3	14.7	14.10	15.1	15.5	15.8	15.10	16.1	
	10.30	11.0	11.90	12.70	13.40	14.20	14.90	15.60	16.30	17.00	17.60	18.30	18.90	19.50	20.10	20.70	
	10-10	11.3	11.8	12.0	12.5	12.9	13.1	13.4	13.8	13.11	14.2	14.5	14.8	14.11	15.2	15.5	
	13.7	10.70	11.60	12.50	13.30	14.10	14.80	15.60	16.30	17.00	17.70	18.40	19.10	19.70	20.40	21.00	21.70
16.0	10.3	10.8	11.1	11.5	11.8	12.1	12.5	12.8	13.0	13.3	13.6	13.9	14.0	14.2	14.5	14.8	
	11.30	12.20	13.10	14.00	14.80	15.60	16.40	17.20	17.90	18.70	19.40	20.10	20.80	21.50	22.10	22.80	
	9.8	10.1	10.5	10.9	11.1	11.5	11.8	12.2	12.5	12.8	13.2	13.4	13.7	13.9	14.1	14.3	
	19.2	12.00	13.00	13.90	14.80	15.70	16.60	17.40	18.20	19.00	19.80	20.60	21.30	22.10	22.80	23.50	24.20
24.0	9.0	9.4	9.8	10.0	10.3	10.7	10.10	11.1	11.4	11.7	11.9	12.0	12.2	12.5	12.7	12.9	
	12.90	14.00	15.00	16.00	16.90	17.80	18.60	19.60	20.50	21.30	22.20	23.00	23.80	24.50	25.30	26.10	
	14.11	15.6	16.1	16.7	17.1	17.7	18.0	18.5	18.10	19.2	19.7	19.11	20.3	20.7	20.11	21.3	
	13.7	14.3	14.10	15.5	15.11	16.4	16.10	17.3	18.0	18.4	18.9	19.1	19.5	19.9	20.0	20.4	
24.8	10.80	11.60	12.50	13.30	14.10	14.80	15.60	16.30	17.00	17.70	18.40	19.10	19.80	20.40	21.10	21.70	
	13.7	14.1	14.7	15.1	15.6	15.11	16.4	16.9	17.1	17.5	17.9	18.1	18.5	18.9	19.0	19.4	
	11.30	12.20	13.10	14.00	14.80	15.60	16.40	17.20	17.90	18.70	19.40	20.10	20.80	21.50	22.20	22.80	
	21.9	13.3	13.9	14.2	14.7	15.0	15.5	15.9	16.1	16.5	16.9	17.0	17.4	17.7	17.11	18.2	
24.0	11.10	12.4	12.9	13.2	13.7	13.11	14.3	14.7	14.11	15.3	15.6	15.10	16.1	16.4	16.7	16.10	
	12.90	14.00	15.00	16.00	16.90	17.80	18.60	19.60	20.50	21.30	22.20	23.00	23.80	24.50	25.40	26.10	

12.0	19.1	19.10	20.6	21.2	21.10	22.5	23.0	23.6	24.0	24.6	25.0	25.5	25.11	25.4	26.9	27.1
	1030	1110	1190	1270	1350	1420	1490	1560	1530	1700	1760	1830	1890	1950	2010	2070
13.7	18.3	19.0	19.8	20.3	20.11	21.5	22.0	22.6	23.0	23.5	23.11	24.4	24.9	25.2	25.7	25.11
	1080	1160	1250	1330	1410	1480	1560	1630	1700	1770	1840	1910	1980	2040	2110	2170
2x10	17.4	18.0	18.8	19.3	19.10	20.4	20.11	21.4	21.10	22.3	22.8	23.1	23.5	23.11	24.3	24.8
	1120	1220	1310	1400	1480	1560	1640	1720	1790	1870	1940	2010	2080	2150	2220	2280
19.2	16.4	16.11	17.7	18.1	18.8	19.2	19.8	20.1	20.6	20.11	21.4	21.9	22.1	22.6	22.10	23.2
	1200	1300	1390	1490	1570	1660	1740	1830	1910	1980	2060	2140	2210	2280	2350	2430
24.0	15.1	15.9	16.4	16.10	17.4	17.9	18.3	18.8	19.1	19.5	19.10	20.2	20.6	20.11	21.2	21.6
	1290	1400	1500	1600	1680	1780	1860	1970	2050	2140	2220	2300	2380	2460	2540	2610
12.0	23.2	24.1	25.0	25.10	26.7	27.3	27.11	28.7	29.3	29.10	30.5	30.11	31.6	32.0	32.6	33.0
	1030	1110	1190	1270	1350	1420	1490	1560	1630	1700	1760	1830	1890	1950	2010	2070
13.7	22.2	23.1	23.11	24.6	25.5	26.1	26.9	27.4	27.11	28.6	29.1	29.7	30.1	30.7	31.1	31.7
	1080	1160	1250	1330	1410	1480	1560	1630	1700	1770	1840	1910	1980	2040	2110	2170
16.0	21.1	21.11	22.8	23.5	24.1	24.9	25.5	26.0	26.7	27.1	27.7	28.1	28.7	29.1	29.6	30.0
	1130	1220	1310	1400	1480	1560	1640	1720	1790	1870	1940	2010	2080	2150	2220	2280
19.2	19.10	20.7	21.4	22.1	22.8	23.4	23.11	24.5	25.0	25.6	26.0	26.6	26.11	27.4	27.9	28.2
	1200	1300	1390	1490	1570	1660	1740	1830	1910	1980	2060	2140	2210	2280	2350	2430
24.0	18.5	19.2	19.10	20.6	21.1	21.8	22.2	22.8	23.2	23.8	24.2	24.7	25.0	25.5	26.2	26.10
	1290	1400	1500	1600	1690	1790	1860	1970	2050	2140	2220	2300	2380	2460	2540	2610

Note: The required extreme fiber stress in bending, "F<sub>b</sub>", in pounds per square inch is shown below each span.

DESIGN VALUES FOR JOISTS AND RAFTERS—VISUAL GRADING

These "F<sub>b</sub>" values are for use where repetitive members are spaced not more than 24 inches. For wider spacing, the "F<sub>b</sub>" values should be reduced 13%.

Values for surfaced dry or surfaced green lumber apply at 19% maximum moisture content in use.

Species and Grade	Size	Design Value in Bending "F <sub>b</sub> "			Modulus of Elasticity "E"	Grading Rules Agency
		Normal Duration	Snow Loading	7-Day Loading		
BALSAM FIR (Surfaced dry or surfaced green)						
Select Structural	2x4	1550	1780	1940	1,200,000	Northeastern Lumber Manufacturers Association
No. 1		1300	1500	1620	1,200,000	
No. 2		1100	1260	1380	1,100,000	
No. 3		600	690	750	900,000	
Appearance Stud		1150 600	1320 690	1440 750	1,200,000 900,000	
Construction Standard Utility	2x4	800 450 200	920 520 230	1000 560 250	900,000 900,000 900,000	Northern Hardwood & Pine Manufacturers Association
Select Structural	2x5	1350	1550	1690	1,200,000	(See notes 1 and 3)
No. 1 & Appearance	and	1150	1320	1440	1,200,000	
No. 2	wider	950	1090	1190	1,100,000	
No. 3		550	630	690	900,000	
Stud		550	630	690	900,000	



DOUGLAS FIR-LARCH (Surfaced dry or surfaced green)							
Dense Select Structural	2x4	2800	3220	3500	1,900,000	Western Wood Products Association (See notes 1 and 3)	
Select Structural		2400	2760	3000	1,800,000		
Dense No. 1		2400	2760	3000	1,900,000		
No. 1 & Appearance		2050	2360	2560	1,800,000		
Dense No. 2		1950	2240	2440	1,700,000		
No. 2		1650	1900	2060	1,700,000		
No. 3		925	1060	1160	1,500,000		
Stud		925	1060	1160	1,500,000		
Construction Standard	2x4	1200	1380	1500	1,500,000		West Coast Lumber Inspection Bureau
Utility		675	780	840	1,500,000		
		325	370	410	1,500,000		
Dense Select Structural	2x5	2400	2760	3000	1,900,000		
Select Structural	and	2050	2360	2560	1,800,000		
Dense No. 1	wider	2050	2360	2560	1,900,000		
No. 1 & Appearance		1750	2010	2190	1,800,000		
Dense No. 2		1700	1960	2120	1,700,000		
No. 2		1450	1670	1810	1,700,000		
No. 3		850	980	1060	1,500,000		
Stud		850	980	1060	1,500,000		

## DESIGN VALUES FOR JOISTS AND RAFTERS--VISUAL GRADING (CONT)

These "F<sub>b</sub>" values are for use where repetitive members are spaced not more than 24 inches. For wider spacing, the "F<sub>b</sub>" values should be reduced 13%.

Values for surfaced dry or surfaced green lumber apply at 19% maximum moisture content in use.

Species and Grade	Size	Design Value in Bending "F <sub>b</sub> "			Modulus of Elasticity "E"	Grading Rules Agency
		Normal Duration	Snow Loading	7-Day Loading		
EASTERN SPRUCE (Surfaced dry or surfaced green)						
Select Structural	2x4	1750	2010	2190	1,400,000	Northeastern Lumber Manufacturers Association
No. 1		1500	1720	1880	1,400,000	
No. 2		1200	1380	1500	1,200,000	
No. 3		675	780	840	1,100,000	
Appearance		1250	1440	1560	1,400,000	
Stud		675	780	840	1,100,000	
Construction	2x4	875	1010	1090	1,100,000	Northern Hardwood & Pine Manufacturers Association
Standard		500	580	620	1,100,000	
Utility		225	260	280	1,100,000	
Select Structural	2x5	1500	1720	1880	1,400,000	(See notes 1 and 3)
No. 1 & Appearance	and	1250	1440	1560	1,400,000	
No. 2	wider	1000	1150	1250	1,200,000	
No. 3		600	690	750	1,100,000	
Stud		600	690	750	1,100,000	

EASTERN WHITE PINE (Surfaced dry or surfaced green)						
Select Structural	2x4	1550	1780	1940	1,200,000	Northeastern Lumber Manufacturers Association (See note 1)
No. 1 & Appearance		1350	1550	1690	1,200,000	
No. 2		1100	1260	1380	1,100,000	
No. 3		600	690	750	1,000,000	
Construction	2x4	800	920	1000	1,000,000	NeLMA and NHPMA  (See note 1)
Standard		450	520	560	1,000,000	
Utility		200	230	250	1,000,000	
Stud		600	690	750	1,000,000	
Select Structural	2x5	1350	1550	1690	1,200,000	Northeastern Lumber Manufacturers Association (See notes 1 and 3)
No. 1 & Appearance	and	1150	1320	1440	1,200,000	
No. 2	wider	950	1090	1190	1,100,000	
No. 3		550	630	690	1,000,000	
Stud		550	630	690	1,000,000	

## DESIGN VALUES FOR JOISTS AND RAFTERS--VISUAL GRADING (CONT)

These "F<sub>b</sub>" values are for use where repetitive members are spaced not more than 24 inches. For wider spacing, the "F<sub>b</sub>" values should be reduced 13%.

Values for surfaced dry or surfaced green lumber apply at 19% maximum moisture content in use.

Species and Grade	Size	Design Value in Bending "F <sub>b</sub> "			Modulus of Elasticity "E"	Grading Rules Agency
		Normal Duration	Snow Loading	7-Day Loading		
EASTERN WHITE PINE (NORTH) (Surfaced dry or surfaced green)						
Select Structural	2x4	1550	1780	1940	1,200,000	National Lumber Grades Authority (A Canadian Agency-- See notes 1, 2 and 3)
No. 1 & Appearance		1350	1550	1690	1,200,000	
No. 2		1100	1260	1380	1,100,000	
No. 3		600	690	750	1,000,000	
Stud		600	690	750	1,000,000	
Construction Standard	2x4	800	920	1000	1,000,000	
Utility		450	520	560	1,000,000	
Utility		200	230	250	1,000,000	
Select Structural	2x5	1350	1550	1690	1,200,000	
No. 1 & Appearance	and wider	1150	1320	1440	1,200,000	
No. 2		950	1090	1190	1,100,000	
No. 3		550	630	690	1,000,000	
Stud		550	630	690	1,000,000	

HEM-FIR (Surfaced dry or surfaced green)							
Select Structural	2x4	1900	2180	2380	1,500,000	Western Wood Products Association (See notes 1 and 3)	
No. 1 & Appearance		1600	1840	2000	1,500,000		
No. 2		1350	1550	1690	1,400,000		
No. 3		725	830	910	1,200,000		
Stud		725	830	910	1,200,000		
Construction	2x4	975	1120	1220	1,200,000		
Standard		550	630	690	1,200,000		
Utility		250	290	310	1,200,000		
Select Structural	2x5	1650	1900	2060	1,500,000		West Coast Lumber Inspection Bureau
No. 1 & Appearance	and	1400	1610	1750	1,500,000		
No. 2	wider	1150	1320	1440	1,400,000		
No. 3		675	780	840	1,200,000		
Stud		675	780	840	1,200,000		
NORTHERN PINE (Surfaced dry or surfaced green)							
Select Structural	2x4	1850	2130	2310	1,400,000	Northeastern Lumber Manufacturers Association  Northern Hardwood & Pine Manufacturers Association  (See notes 1 and 3)	
No. 1		1600	1840	2000	1,400,000		
No. 2		1300	1500	1620	1,300,000		
No. 3		725	830	910	1,100,000		
Appearance		1400	1610	1750	1,400,000		
Stud		725	830	910	1,100,000		
Construction	2x4	950	1090	1190	1,100,000		
Standard		525	600	660	1,100,000		
Utility		250	290	310	1,100,000		
Select Structural	2x5	1600	1840	2000	1,400,000		
No. 1 & Appearance	and	1400	1610	1750	1,400,000		
No. 2	wider	1100	1260	1380	1,300,000		
No. 3		650	750	810	1,100,000		
Stud		650	750	810	1,100,000		

## DESIGN VALUES FOR JOISTS AND RAFTERS--VISUAL GRADING (CONT)-

These "F<sub>b</sub>" values are for use where repetitive members are spaced not more than 24 inches. For wider spacing, the "F<sub>b</sub>" values should be reduced 13%.

Values for surfaced dry or surfaced green lumber apply at 19% maximum moisture content in use.

Species and Grade	Size	Design Value in Bending "F <sub>b</sub> "			Modulus of Elasticity "E"	Grading Rules Agency
		Normal Duration	Snow Loading	7-Day Loading		
SOUTHERN PINE (Surfaced dry)						
Select Structural	2x4	2300	2640	2880	1,700,000	Southern Pine Inspection Bureau
Dense Select Structural		2700	3100	3380	1,800,000	
No. 1		1950	2240	2440	1,700,000	
No. 1 Dense		2300	2640	2880	1,800,000	
No. 2		1650	1900	2060	1,600,000	
No. 2 Dense		1900	2180	2380	1,600,000	
No. 3		900	1040	1120	1,400,000	
No. 3 Dense		1050	1210	1310	1,500,000	
Stud		900	1040	1120	1,400,000	
Construction Standard		2x4	1150	1320	1440	
Utility	300		340	380	1,400,000	
Utility	300		340	380	1,400,000	
Select Structural	2x5 and wider	2000	2300	2500	1,700,000	(See note 3)
Dense Select Structural		2350	2700	2940	1,800,000	
No. 1		1700	1960	2120	1,700,000	
No. 1 Dense		2000	2300	2500	1,800,000	
No. 2		1400	1610	1750	1,600,000	
No. 2 Dense		1650	1900	2060	1,600,000	
No. 3		800	920	1000	1,400,000	
No. 3 Dense		925	1060	1160	1,500,000	
Stud	850	980	1060	1,400,000		

SOUTHERN PINE (Surfaced at 15% moisture content-KD)						Southern Pine Inspection Bureau  (See note 3)
Select Structural	2x4	2500	2880	3120	1,800,000	
Dense Select Structural		2900	3340	3620	1,900,000	
No. 1		2100	2420	2620	1,800,000	
No. 1 Dense		2450	2820	3060	1,900,000	
No. 2		1750	2010	2190	1,600,000	
No. 2 Dense		2050	2360	2560	1,700,000	
No. 3		975	1120	1220	1,500,000	
No. 3 Dense		1150	1320	1440	1,500,000	
Stud		975	1120	1220	1,500,000	
Construction	2x4	1250	1440	1560	1,500,000	
Standard		725	830	910	1,500,000	
Utility		300	340	380	1,500,000	
Select Structural	2x5	2150	2470	2690	1,800,000	
Dense Select Structural	and	2500	2880	3120	1,900,000	
No. 1	wider	1850	2130	2310	1,800,000	
No. 1 Dense		2150	2470	2690	1,900,000	
No. 2		1500	1720	1880	1,600,000	
No. 2 Dense		1750	2010	2190	1,700,000	
No. 3		875	1010	1090	1,500,000	
No. 3 Dense		1000	1150	1250	1,500,000	
Stud		900	1040	1120	1,500,000	

DESIGN VALUES FOR JOISTS AND RAFTERS--VISUAL GRADING (CONT)

These "F<sub>b</sub>" values are for use where repetitive members are spaced not more than 24 inches. For wider spacing, the "F<sub>b</sub>" values should be reduced 13%.

Values for surfaced dry or surfaced green lumber apply at 19% maximum moisture content in use.

Species and Grade	Size	Design Value in Bending "F <sub>b</sub> "			Modulus of Elasticity "E"	Grading Rules Agency
		Normal Duration	Snow Loading	7-Day Loading		
SPRUCE-PINE-FIR (Surfaced dry or surfaced green)						
Select Structural	2x4	1650	1900	2060	1,500,000	National Lumber Grades Authority (A Canadian Agency--  See notes 1, 2 and 3)
No. 1 & Appearance		1400	1610	1750	1,500,000	
No. 2		1150	1320	1440	1,300,000	
No. 3		650	750	810	1,200,000	
Stud		650	750	810	1,200,000	
Construction	2x4	850	980	1060	1,200,000	
Standard		475	550	590	1,200,000	
Utility		225	260	280	1,200,000	
Select Structural	2x5 and wider	1450	1670	1810	1,500,000	
No. 1 & Appearance		1200	1380	1500	1,500,000	
No. 2		1000	1150	1250	1,300,000	
No. 3		575	660	720	1,200,000	
Stud		575	660	720	1,200,000	



WHITE WOODS (WESTERN WOODS) (Surfaced dry or surfaced green)						Western Wood Products Association  (See notes 1 and 3)	
Select Structural	2x4	1550	1780	1940	1,100,000		
No. 1 & Appearance		1300	1500	1620	1,100,000		
No. 2		1050	1210	1310	1,000,000		
No. 3		600	690	750	900,000		
Stud		600	690	750	900,000		
Construction	2x4	775	890	970	900,000		
Standard		425	490	530	900,000		
Utility		200	230	250	900,000		
Select Structural	2x5	1300	1500	1620	1,100,000		
No. 1 & Appearance	and	1100	1260	1380	1,100,000		
No. 2	wider	925	1060	1160	1,000,000		
No. 3		550	630	690	900,000		
Stud		550	630	690	900,000		

1. When 2-inch lumber is manufactured at a maximum moisture content of 15% (grade-marked MC-15) and used in a condition where the moisture content does not exceed 15% the design values shown for "surfaced dry or surfaced green" lumber may be increased 8% for design value in bending "F<sub>b</sub>", and 5% for modulus of elasticity "E".

2. National Lumber Grades Authority is the Canadian rules writing agency responsible for preparation, maintenance and dissemination of a uniform softwood lumber grading rule for all Canadian species.


3. Design values for stud grade in 2x5 and wider size classifications apply to 5-inch and 6-inch widths only.

## APPENDIX A

## CHAPTER Ind 22

## DETERMINING THE LEVEL OF INSULATION

Two methods are outlined for determining the level of insulation required by section Ind 22.06 using the following sample dwelling:

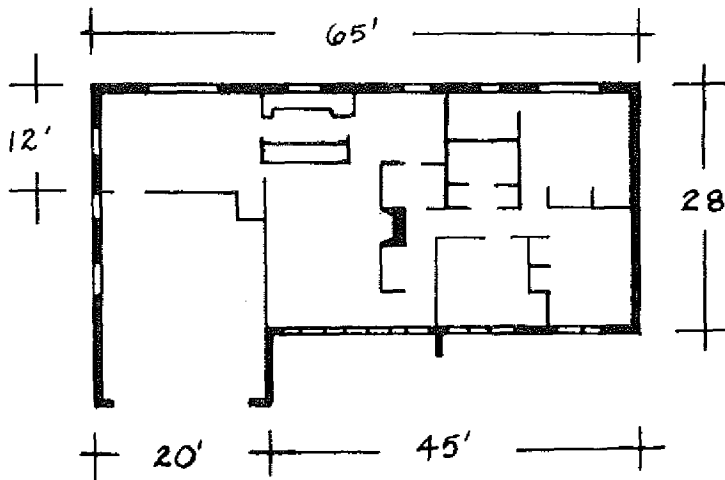

Sample dwelling: 1,500 square feet (186 lineal feet)

Gross wall area =  $8.13' \times 186$  lineal feet = 1,512.18 square feet  
 Opaque wall area = 1,301.69 square feet (20% framing, 80% cavity)  
 Box sill area =  $.81' \times 186$  lineal feet = 150.66 square feet  
 Exposed foundation wall area = 108.97 square feet  
 Basement window area = 15.65 square feet  
 Insulated window area = 172.67 square feet  
 Insulated door area = 37.82 square feet  
 Ceiling area = 1,500 square feet (10% framing, 90% cavity)

## METHOD I - ACCEPTABLE PRACTICE METHOD

The acceptable practice method outlined below can be used with minimum calculations for determining the acceptable level of insulation.

*Problem:* Using the acceptable practice method determine the level of insulation required for the 1,500 square foot dwelling in Phase I.

*Step 1:* Determine the percentage window and door area.

$$\begin{aligned} \text{Percent opening area} &= \frac{\text{Window area} + \text{Door area}}{\text{Gross wall area} + \text{Box sill area}} \times 100\% \\ &= \frac{172.67 \text{ sq. ft.} + 37.82 \text{ sq. ft.}}{1512.18 \text{ sq. ft.} + 150.66 \text{ sq. ft.}} \times 100\% \\ &= \frac{210.49 \text{ sq. ft.}}{1,662.84 \text{ sq. ft.}} \times 100\% = 12.66\% \end{aligned}$$

*Step 2:* Determine level of insulation required for the box sill and side-walls for the given window and door area from Table A-1. (Phase 1)

Using 5/8 inch plywood siding the table shows that an R-11 batt with R-1.22 fiberboard will allow up to 12.8% window and door area.

*Step 3:* Determine the percentage window area for the exposed foundation wall.

$$\begin{aligned} \text{Percent opening area} &= \frac{\text{Window area}}{\text{Total exposed foundation area}} \times 100\% \\ &= \frac{15.65 \text{ sq. ft.}}{108.97 \text{ sq. ft.} + 15.65 \text{ sq. ft.}} \times 100\% \\ &= 12.6\% \end{aligned}$$

*Step 4:* Determine the amount of exposed foundation wall: If there is 8" of wall exposed and the wall height is 8',

$$\text{Percent exposed wall} = \frac{8'' / (12'' \text{ per foot})}{8'} \times 100\% = 8.3\%$$

*Step 5:* Refer to Table A-2 to determine the level of insulation required for the foundation.

Using the requirements for less than 25% exposed foundation wall the table shows that an R-5.27 insulation can be used for up to 24.8% double glazed windows.

*Step 6:* Select the level of insulation required for the ceiling from Table A-3.

TABLE A-1  
**WALL INSULATION GUIDE**  
 (Based on  $U_o$  requirements above the foundation wall)

Insulation Type	Percent Window and Door Area					
	Phase I		Phase II (4/1/79)		Phase III (4/1/80)	
	$U_o = .14$		$U_o = .13$		$U_o = .12$	
	$\frac{3}{8}$ inch Plywood Siding	Backed Aluminum Siding	$\frac{3}{8}$ inch Plywood Siding	Backed Aluminum Siding	$\frac{3}{8}$ inch Plywood Siding	Backed Aluminum Siding
R-11 Batt	11.0	12.6	8.9	10.5	6.8	8.4
R-11 Batt, R-1.22 Fiberboard	12.8	14.0	10.8	12.0	8.7	9.9
R-11 Batt, R-5.27 Extruded Polystyrene	16.4	17.0	14.4	15.0	12.4	13.0
R-11 Batt, R-10.54 Extruded Polystyrene	18.8	19.1	16.8	17.2	14.9	15.3
R-13 Batt	12.5	13.9	10.4	11.8	8.3	9.8
R-13 Batt, R-1.22 Fiberboard	14.1	15.4	12.2	13.3	10.3	11.2
R-13 Batt, R-5.27 Extruded Polystyrene	17.0	17.5	15.0	15.6	13.1	13.6
R-13 Batt, R-10.54 Extruded Polystyrene	19.2	19.5	17.3	17.6	15.3	15.6
R-19 Batt	15.3	16.2	13.2	14.2	11.2	12.2
R-19 Batt, R-1.22 Fiberboard	16.4	17.1	14.4	15.1	12.3	13.1
R-19 Batt, R-5.27 Extruded Polystyrene	18.6	19.0	16.7	17.0	14.7	15.1
R-19 Batt, R-10.54 Extruded Polystyrene	20.1	20.4	18.2	18.5	16.3	16.6

Note: The following assumptions were used to derive this table:

1. Door area = 2% of wall and box sill area.
2. Insulated doors are used with a U-value of .47.
3. Insulated windows are used with a U-value of .56.
4. The insulation type is carried down through the box sill.

TABLE A-2  
EXPOSED FOUNDATION INSULATION

Foundation exposure	Requirement	Insulation type	Percent window area	
			Single glazed	Double glazed
Less than 25% of foundation exposed	$U_o = .25$	R-5.27	10.4	24.8
		R-11 batt	15.5	34.2
		Multi-cell insul. block (R-12.06)	16.0	35.0
More than 25% of foundation exposed	$U_o = .14$	R-11 batt	4.9	10.8
		R-13 batt	5.8	12.7
		Multi-cell insul. block (R-12.06)	5.5	12.0
	$U_o = .13$	R-11 batt	3.9	8.7
		R-13 batt	4.8	10.6
		Multi-cell insul. block (R-12.06)	4.5	9.9
	$U_o = .12$	R-11 batt	3.0	6.7
		R-13 batt	3.9	8.5
		Multi-cell insul. block (R-12.06)	3.5	7.8

TABLE A-3  
INSULATION LEVELS REQUIRED TO MEET CEILING U VALUES

$U_o$ Value	Insulation	R-Value Required	
		In Cavity	Over Framing
.033	Fiber glass batt	R-19 and R-13	R-13
	Fiber glass blown	12 in. (R-30)	6.4 in. (R-16)
	Rock wool	9.7 in. (R-29)	4.2 in. (R-13)
	Cellulose	8.4 in. (R-31)	2.9 in. (R-11)
.029	Fiber glass batt	R-38	R-19
	Fiber glass blown	13.6 in. (R-34)	8.1 in. (R-20)
	Rock wool	10.9 in. (R-33)	5.4 in. (R-16)
	Cellulose	9.5 in. (R-35)	4.0 in. (R-15)

Note: The following assumptions are used:  
 1. Fiber glass blown = R-2.5 per inch  
 2. Rock wool = R-3.0 per inch  
 3. Cellulose = R-3.7 per inch

METHOD II — SYSTEM DESIGN METHOD

The system design method is the more complex method of determining the level of insulation required by the code. This procedure may be used when it becomes necessary to combine various materials to comply with the code. If the window area is increased and the same wall insula-

tion is used, the wall section will not meet the requirements of section Ind 22.06 (6), but the system design method can be used by adding extra insulation elsewhere.

*Problem:* Using the system design method, increase the opening area to 15% and determine compliance by adding extra insulation to the walls and ceiling.

*Step 1:* Determine the inside and outside design temperatures from Tables 22.04-A and B.

Inside temperature = 70° F

Outside temperature = -20° F

$$\Delta T = T_{\text{inside}} - T_{\text{outside}} = 70 - (-20) = 90^\circ \text{ F.}$$

*Note:* Degree days may be used for system design instead of design temperatures:

Zone 1, 9,000 degree days

Zone 2, 8,000 degree days

Zone 3, 7,500 degree days

Zone 4, 7,000 degree days

*Step 2:* Using section Ind 22.06, determine the insulation values for the exterior walls above grade and the roof/ceiling for Phase I.

Exposed exterior walls above grade;  $U_o = .15$

Roof/ceiling;  $U_o = .033$

*Step 3:* Fill in the worksheet to determine requirements for building enclosure heat loss.

*Step 4:* Select the levels of insulation to be used and determine the U values for the ceiling, wall, box sill and foundation (shown in Figure A-1). Fill in the building enclosure worksheet.

*Step 5:* If the total heat loss determined through the system design method is within one percent or is less than the heat loss determined through the code requirements, the code has been satisfied.

INDUSTRY, LABOR AND HUMAN RELATIONS 157  
**R-VALUE DETERMINATION BY COMPONENT**

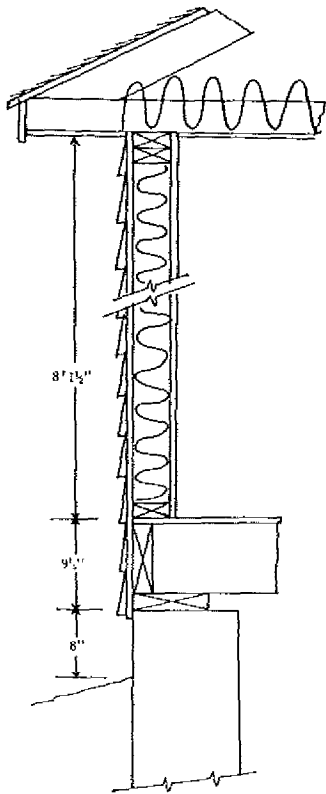


Figure A-1

<u>Ceiling</u>	<u>Cavity R</u>	<u>Joist R</u>
Top surface	.17	.17
Insulation	38.0	19.0
Wood	—	6.88
1/2" gyp. wall board	.45	.45
Bottom surface	.61	.61
	39.23	27.11
	(U=.025)	(U=.037)
<u>Wall</u>	<u>Cavity R</u>	<u>Stud R</u>
Outside surface	.17	.17
3/4" ext. siding	.77	.77
Rigid insulation	—	—
Insulation	11.00	—
Wood stud	—	4.38
1/2" gyp. wall board	.45	.45
Inside surface	.68	.68
	13.07	6.45
	(U=.070)	(U=.13)
<u>Box sill</u>	<u>R</u>	
Outside surface	.17	
3/4" ext. siding	.77	
Rigid insulation	—	
Insulation	11.00	
1 1/2" wood	1.88	
Inside surface	.68	
	14.50	
	(U=.064)	
<u>Foundation</u>	<u>R</u>	
Outside surface	.17	
8" concrete	.64	
Inside surface	.68	
Rigid insulation	5.27	
	6.76	
	(U=.15)	

**WORKSHEET FOR SYSTEM DESIGN ANALYSIS**

CODE REQUIREMENTS				
Component	U <sub>0</sub> Reqd.	Area	ΔT	Heat Loss
Walls				
Above grade	.15	1512.18	90	20,414.4
Box sill	.15	150.66	70	1,581.9
Foundation	.15	124.62	70	1,308.5
Roof/Ceiling	.033	1500.00	90	4,455.0
Floor				
Over unheated spaces				
Slab-on-grade				
<b>TOTAL</b>				<b>27,759.9</b>

SYSTEM DESIGN ALTERNATIVE				
Component	U	Area	$\Delta T$	Heat Loss
Walls				
Cavity	.070	1010.20	90	6,364.3
Solid	.13	252.60	90	2,955.4
Box sill	.064	160.68	70	676.0
Foundation	.16	108.97	70	1,114.2
Roof/Ceiling				
Cavity	.025	1350.00	90	3,037.5
Solid	.037	150.00	90	499.5
Floor				
Over unheated spaces				
Slab-on-grade				
Windows	.56	211.61	90	10,665.1
Doors	.31	87.82	90	1,055.2
Basement windows	1.13	16.65	70	1,237.9
TOTAL				27,634.1

## WORKSHEET FOR SYSTEM DESIGN ANALYSIS

CODE REQUIREMENTS				
Component	$U_o$ Req'd.	Area	$\Delta T$	Heat Loss
Walls				
Above grade				
Box sill				
Foundation				
Roof/Ceiling				
Floor				
Over unheated spaces				
Slab-on-grade				
TOTAL				





Material	Description	Density	Per inch	For thick-	
		(lb per cu ft)	thickness R-Value	ness listed R-Value	
	Medium density.....	50	1.06	—	
	High density.....	62.5	0.85	—	
	Underlayment ..... ¾ in.	40	—	0.82	
	Wood subfloor..... ¾ in.	—	—	0.94	
BUILDING PAPER	Vapor-permeable felt.....	—	—	0.06	
	Vapor-seal, 2 layers of mopped 16 lb. felt.....	—	—	0.12	
	Vapor-seal, plastic film.....	—	—	Negl.	
ROOF INSULATION	Preformed, for use above deck				
	Approximately..... ½ in.	—	—	1.39	
	Approximately..... 1 in.	—	—	2.78	
	Approximately ... 1½ in.	—	—	4.17	
	Approximately ... 2 in.	—	—	5.56	
	Approximately..... 2½ in.	—	—	6.67	
	Approximately..... 3 in.	—	—	8.33	
	Cellular glass.....	9	2.50	—	
MASONRY MATERIALS	Cement mortar.....	116	0.20	—	
	Gypsum-fiber concrete				
	87½% gypsum, 12½% wood chips.....	51	0.60	—	
	Lightweight aggregates	120	0.19	—	
	including expanded shale, clay or slate, expanded	100	0.28	—	
	slags; cinders; pumice;	80	0.40	—	
	vermiculite; also cellular	60	0.59	—	
	concretes	40	0.86	—	
		30	1.11	—	
		20	1.43	—	
	Perlite.....	40	1.08	—	
		30	1.41	—	
		20	2.00	—	
		Sand and gravel or stone ag- gregate (oven dried).....	140	0.11	—
		Sand and gravel or stone ag- gregate (not dried).....	140	0.08	—
	Stucco.....	116	0.20	—	
MASONRY UNITS	Brick, common.....	120	0.20	—	
	Brick, face.....	130	0.11	—	
	Clay tile, hollow:				
	1 cell deep..... 3 in.	—	—	0.80	
	1 cell deep..... 4 in.	—	—	1.11	
	2 cells deep..... 6 in.	—	—	1.52	
	2 cells deep..... 8 in.	—	—	1.85	
	2 cells deep..... 10 in.	—	—	2.22	
	3 cells deep..... 12 in.	—	—	2.50	
	Concrete blocks, 3 oval core:				
	Sand & gravel aggregate.....	4 in.	—	0.71	
		8 in.	—	1.11	
		12 in.	—	1.28	
	Cinder aggregate..	3 in.	—	0.86	
		4 in.	—	1.11	
		8 in.	—	1.72	
		12 in.	—	1.89	
	Lightweight aggregate (expanded shale, clay, slate or slag; pumice)	3 in.	—	1.27	
		4 in.	—	1.50	
		8 in.	—	2.00	
	12 in.	—	2.27		
Concrete blocks, rectangular core					
Sand & gravel aggregate					
2 core, 8" 36 lb	—	—	1.04		

Material	Description	Density lb per cu ft)	Per inch thickness R-Value	For thick ness listed R-Value
	Same with filled cores	—	—	1.93
	Lightweight aggregate (expanded shale, clay, slate or slag, pumice):			
	3 core, 6" 19 lb.....	—	1.65	
	Same with filled cores.....	—	2.99	
	2 core, 8" 24 lb.....	—	2.18	
	Same with filled cores.....	—	5.03	
	3 core, 12" 38 lb.....	—	2.48	
	Same with filled cores.....	—	5.82	
	Stone, lime or sand.....	—	0.08	—
	Gypsum partition tile:			
	3 x 12 x 30 in. solid.....	—	—	1.26
	3 x 12 x 30 in. 4-cell.....	—	—	1.35
	4 x 12 x 30 in. 3-cell.....	—	—	1.67
PLASTERING MATERIALS	Cement plaster, sand aggregate.....	116	0.20	—
	Sand aggregate..... 3/4 in.	—	—	0.08
	Sand aggregate..... 3/4 in.	—	—	0.15
	Gypsum plaster:			
	Lightweight aggregate..... 1/2 in.	45	—	0.32
	Lightweight aggregate..... 3/4 in.	45	—	0.39
	Lightweight aggregate on metal lath..... 3/4 in.	—	—	0.47
	Perlite aggregate.....	45	0.67	—
	Sand aggregate.....	105	0.18	—
	Sand aggregate..... 1/2 in.	105	—	0.09
	Sand aggregate..... 3/4 in.	105	—	0.11
	Sand aggregate on metal lath..... 3/4 in.	—	—	0.1
	Vermiculite aggregate.....	45	0.59	—
ROOFING	Asbestos-cement shingles.....	120	—	0.21
	Asphalt roll roofing.....	70	—	0.16
	Asphalt shingles.....	70	—	0.44
	Built-up roofing..... 3/4 in.	70	—	0.33
	Slate..... 1/2 in.	—	—	0.05
	Wood shingles, plain plastic film faced	—	0.94	—
SIDING MATERIALS (On flat surface)	Shingles:			
	Asbestos-cement.....	120	—	0.21
	Wood, 16", 7 1/2" exposure.....	—	—	0.87
	Wood, double, 16", 12" exposure.....	—	—	1.19
	Wood, plus insulating backer board..... 5/16 in.	—	—	1.40
	Siding:			
	Asbestos-cement, 1/4" lapped	—	—	0.21
	Asphalt roll siding.....	—	—	0.16
	Asphalt insulating siding (1/2" bd.).....	—	—	1.46
	Wood drop 1 x 8".....	—	—	0.79
	Wood bevel, 1/2" x 8" lapped.....	—	—	0.81

Material	Description	Density (lb per cu ft)	Per inch thickness R-Value	For thick- ness listed R-Value
	Wood bevel, 3/4 x 10" lapped.....	---	---	1.05
	Wood plywood 3/4" lapped....	---	---	0.59
	Aluminum or steel, over sheathing, hollow-backed.....	---	---	0.61
	Insulating-board backed nominal 3/4".....	---	---	1.82
	Insulating-board backed nominal 3/4" foil backed.....	---	---	2.96
	Architectural glass.....	---	---	0.10
<b>FINISH FLOORING MATERIALS</b>	Carpet and fibrous pad.....	---	---	2.08
	Carpet and rubber pad.....	---	---	1.23
	Cork tile..... 1/2 in.	---	---	0.28
	Terrazzo..... 1 in.	---	---	0.08
	Tile-asphalt, linoleum, vinyl, rubber.....	---	---	0.05
	Wood, hardwood finish..... 3/4 in.	---	---	0.08
<b>INSULATING MATERIALS</b>	Mineral fiber, fibrous form processed from rock, slag or glass			
Blanket and batt	Approx. 2 to 2 3/4" Note 1	---	---	7
	Approx. 3 to 3 1/2" Note 1	---	---	11
	Approx. 5 1/4 to 6 1/2" Note 1	---	---	19
<b>Board and Slabs</b>	Cellular glass.....	9	2.50	---
	Glass fiber, organic bonded....	4-9	4.00	---
	Expanded rubber (rigid).....	4.5	4.55	---
	Expanded polystyrene extruded, plain.....	1.8	4.00	---
	Expanded polystyrene extruded (R-12 exp.).....	2.2	5.00	---
	Expanded polystyrene extruded (R-12 exp.) (Thickness 1" and greater).....	3.5	5.26	---
	Expanded polystyrene, molded beads.....	1.0	3.57	---
	Expanded polyurethane (R-11 exp.).....	1.5	6.25	---
	Mineral fiber with resin binder.....	15	3.45	---
	Mineral fiberboard wet felted			
	Core or roof insulation.....	16-17	2.94	---
	Acoustical tile.....	18	2.86	---
	Acoustical tile.....	21	2.70	---
	Mineral fiberboard wet molded			
	Acoustical tile.....	23	2.38	---
	Wood or cane fiberboard			
	Acoustical tile..... 1/2 in.	---	---	1.25
	Acoustical tile..... 3/4 in.	---	---	1.89
	Interior finish (plank, tile)....	15	2.86	---
	Insulating roof deck			
	Approximately..... 1 1/2 in.	---	---	4.17
	Approximately..... 2 in.	---	---	5.56
	Approximately..... 3 in.	---	---	8.33
	Wood shredded (cemented in preformed slabs).....	22	1.67	---
<b>Loose Fill</b>	Cellulose insulation (milled paper or wood pulp)	2.5-3	3.70	---
	Sawdust or shavings	0.8-1.5	2.22	---
	Wood fiber, softwoods	2.0-3.5	3.33	---

Material	Description	Density lb per cu ft)	Per inch	For thick
			thickness R-Value	ness listed R-Value
	Perlite, expanded	5.0-8.0	2.70	—
	Mineral fiber (rock, slag or glass):			
	Approximately			
	3"..... Note 1	8-15	—	9
	Approximately			
	4½"..... Note 1	8-15	—	13
	Approximately			
	6¼"..... Note 1	8-15	—	19
	Approximately			
	7¼"..... Note 1	8-15	—	24
	Silica aerogel.....	7.6	5.88	—
	Vermiculite (expanded).....	7.0-8.2	2.13	—
		4.0-6.0	2.27	—
<b>WOODS</b>				
	Maples, oak and similar hardwoods.....	45	0.91	—
	Fir, pine, and similar softwoods.....	32	1.25	—
	Fir, pine, and simi- lar softwoods.....			
	¾ in. ....	32	—	0.94
	1½ in. ....	32	—	1.89
	2½ in. ....	32	—	3.12
	3½ in. ....	32	—	4.35

Note 1: R-value varies with fiber diameter. Insulation is produced by different densities; therefore, there is a wide variation in thickness for the same R-value between various manufacturers. (See Batt and Loose Fill Insulation.)

\*Reprinted with permission from ASHRAE Handbook of Fundamentals 1972.

**TABLE A-5**  
**COEFFICIENTS OF TRANSMISSION (U) OF WINDOWS, SKYLIGHTS, AND LIGHT TRANSMITTING PARTITIONS\***  
 (These values are for heat transfer from air to air.)  
 Btu per (hr) (sq ft) (F Deg)

**PART A**  
**VERTICAL PANELS (EXTERIOR WINDOWS, SLIDING PATIO DOORS AND PARTITIONS)—FLAT GLASS, GLASS BLOCK AND PLASTIC SHEET**

Description	Exterior <sup>1</sup>		Interior
	Winter	Summer	
Flat Glass			
single glass	1.13	1.06	0.73
insulating glass—double <sup>2</sup>			
3/16 in. air space	0.69	0.64	0.51
¼ in. air space	0.65	0.61	0.49
½ in. air space	0.58	0.56	0.46
½ in. air space, low emissivity coating <sup>3</sup>			
emissivity = 0.20	0.38	0.36	0.32
emissivity = 0.40	0.45	0.44	0.38
emissivity = 0.60	0.52	0.50	0.42
insulating glass—triple <sup>2</sup>			
¼ in. air spaces	0.47	0.45	0.38
½ in. air spaces	0.36	0.35	0.30
storm windows			
1 in.-4 in. air space	0.56	0.54	0.44
Glass Block <sup>4</sup>			
6 x 6 x 4 in. thick	0.60	0.57	0.46
8 x 8 x 4 in. thick	0.56	0.54	0.44
—with cavity divider	0.48	0.46	0.38
12 x 12 x 4 in. thick	0.52	0.50	0.41
—with cavity divider	0.44	0.42	0.36
12 x 12 x 2 in. thick	0.60	0.57	0.46
Single Plastic Sheet	1.09	1.00	0.70

<sup>1</sup>See Part C for adjustment for various window and sliding patio door types.  
<sup>2</sup>Double and triple refer to the number of lights of glass.  
<sup>3</sup>Coating on either glass surface facing air space; all other glass surfaces uncoated.  
<sup>4</sup>Dimensions are nominal.

\*Reprinted with permission from ASHRAE Handbook of Fundamentals.

**PART B**  
**HORIZONTAL PANELS (SKYLIGHTS)**  
**FLAT GLASS, GLASS BLOCK AND PLASTIC BUBBLES**

Description	Exterior <sup>1</sup>		Interior <sup>2</sup>
	Winter <sup>3</sup>	Summer <sup>3</sup>	
Flat Glass			
single glass	1.22	0.83	0.96
insulating glass—double <sup>2</sup>			
3/16 in. air space	0.75	0.49	0.62
¼ in. air space	0.70	0.46	0.59
½ in. air space	0.66	0.44	0.56
½ in. air space, low emissivity coating <sup>3</sup>			
emissivity = 0.20	0.46	0.31	0.39
emissivity = 0.40	0.53	0.36	0.45
emissivity = 0.60	0.60	0.40	0.50
Glass Block <sup>4</sup>			
11 x 11 x 3 in. thick with cavity divider	0.53	0.35	0.44
12 x 12 x 4 in. thick with cavity divider	0.51	0.34	0.42
Plastic Bubbles <sup>5</sup>			
single walled	1.15	0.80	—
double walled	0.70	0.46	—

<sup>1</sup>For heat flow up.

<sup>2</sup>For heat flow down.

<sup>3</sup>Based on area of opening, not total surface area.

(See following page for Part C of this table.)

**PART C**  
**ADJUSTMENT FACTORS FOR VARIOUS WINDOW AND SLIDING PATIO**  
**DOOR TYPES**  
 (Multiply U values in Parts A and B by these factors)

Description	Single Glass	Double or Tripte Glass	Storm Windows
Windows			
All Glass <sup>a</sup>	1.00	1.00	1.00
Wood Sash—80% Glass	0.90	0.95	0.90
Wood Sash—60% Glass	0.80	0.85	0.80
Metal Sash—80% Glass	1.00	1.20	1.20 <sup>b</sup>
Sliding Patio Doors			
Wood Frame	0.95	1.00	—
Metal Frame	1.00	1.10	—

<sup>a</sup>Refers to windows with negligible opaque area.

<sup>b</sup>Value becomes 1.00 when storm sash is separated from prime window by a thermal break.

**TABLE A-6**  
**COEFFICIENTS OF TRANSMISSION (U) FOR SLAB DOORS\***  
 Btu per (hr) (sq ft) (F Deg)

Thickness <sup>1</sup>	Winter			Summer, No Storm Door
	Solid Wood, No Storm Door	Storm Door <sup>2</sup>		
		Wood	Metal	
1 in.	0.64	0.30	0.39	0.61
1¼ in.	0.55	0.28	0.34	0.53
1½ in.	0.49	0.27	0.33	0.47
2 in.	0.43	0.24	0.29	0.42
Steel Door				
1¾ in.				
A <sup>3</sup>	0.59	—	—	0.58
B <sup>4</sup>	0.40	—	—	0.39
C <sup>5</sup>	0.47	—	—	0.46

<sup>1</sup>Nominal thickness.

<sup>2</sup>Values for wood storm doors are for approximately 50% glass; for metal storm doors values apply for any percent of glass.

<sup>3</sup>A = Mineral fiber core (2 lb/cu ft).

<sup>4</sup>B = Solid urethane foam core.

<sup>5</sup>C = Solid polystyrene core.

Note: Hollow core doors 1½ in. thick - R = 2.17; U = 0.46  
 1¾ in. thick - R = 2.22; U = 0.45

\*Reprinted with permission from ASHRAE Handbook of Fundamentals.

## APPENDIX B

FORMULA FOR DETERMINING  
THE OVERALL  $U_o$   
OF THE WALL

$$U_o = \frac{U_{cav} A_{cav} + U_{sol} A_{sol} + U_{win} A_{win} + U_{door} A_{door} + U_{box} A_{box} + U_{found} A_{found}}{A_o}$$

Where:

- $U_o$  = Average thermal transmittance of gross wall area  
 $A_o$  = Gross area of exterior walls.  
 $U_{cav}$  = Thermal transmittance of cavity area (usually assume 80%)  
 $A_{cav}$  = Area between wall framing where insulation may be placed.  
 $U_{sol}$  = Thermal transmittance of wood framing area.  
 $A_{sol}$  = Area of wood framing (usually assume 20%)  
 $U_{box}$  = Thermal transmittance of box sill area.  
 $A_{box}$  = Area of box sill  
 $U_{found}$  = Thermal transmittance of foundation area.  
 $A_{found}$  = Area of above grade exposed concrete.  
 $U_{win}$  = Thermal transmittance of window.  
 $A_{win}$  = Total glass area.  
 $U_{door}$  = Thermal transmittance of door.  
 $A_{door}$  = Total door area.

FORMULA FOR DETERMINING  
THE OVERALL  $U_o$   
OF THE CEILING

$$U_o = \frac{U_{cav} A_{cav} + U_{sol} A_{sol} + U_{skylight} A_{skylight}}{A_o}$$

Where:

- $U_o$  = Average thermal transmittance of gross roof/ceiling.  
 $A_o$  = Gross area of roof/ceiling assembly.  
 $U_{cav}$  = Thermal transmittance of cavity area.  
 $A_{cav}$  = Area between wood framing.  
 $U_{sol}$  = Thermal transmittance of framing.  
 $A_{sol}$  = Area of wood framing (usually assume 10%)  
 $U_{skylight}$  = Thermal transmittance of skylight elements.  
 $A_{skylight}$  = Area of skylight (including frame).

## APPENDIX C

INSULATION, EQUIPMENT  
AND CONDENSATION CONTROL

This appendix is a guide for the proper installation of insulation. The preceding appendices indicated the required amounts and types of insulation necessary to provide the various thermal resistance values for the



building envelope. In order to attain the resistance values specified, it is important that the insulation be properly installed. This appendix includes types of materials currently available and common application practices.

Condensation control should be provided in the form of vapor barriers and thermal breaks. Vapor barriers should be installed on the warm side (area heated in winter) of all walls, ceilings, and insulated floors. All metal window, skylight, and door frames should contain a thermal break.

Insulation is manufactured in many forms and types. The most commonly used materials in residential construction are batts and blankets, rigid insulation, reflective insulation, loose fill, and sprayed insulation. The following is a list of types of materials and the federal specifications governing their characteristics.

Cork board .....	FS HH-I-561
Cellular glass .....	FS HH-I-551
Duct insulation.....	FS HH-I-558b
Expanded polystyrene insulation board.....	FS HH-I-524
Fiberboard .....	FS LLL-I-535 or ASTM C-208 Class C
Insulation board (urethane) .....	FS HH-I-530
Insulation, thermal (perlite) .....	FS HH-I-574
Mineral fiber, pneumatic or poured.....	FS HH-I-1030A
Mineral fiber, insulation blanket.....	FS HH-I-521E
Perlite.....	FS HH-I-526a
Perimeter insulation.....	FS HH-I-524a Type II FS HH-I-558b Form A, Class 1 or 2
Reflective, thermal .....	FS HH-I-1552
Structural fiberboard insulation roof deck...	AIMA IB Spec. No. 1
Cellulose; vegetable or wood fiber .....	FS HH-I-515b-25
Vermiculite .....	FS HH-I-585
Vermiculite, water repellent loose fill.....	FHA UM-30
Mineral fiber, roof insulation.....	HH-I-526c

**BATTS AND BLANKETS**

These materials are usually identified on the package and on the vapor barrier facing with their "R" values. Under the federal specifications, there are 3 standard products identified as R-7, R-11, and R-19. These values are based on the insulation value of the mass. Some manufacturers offer other products such as R-8, R-13 and R-22. The specific thickness of insulation required for a specific "R" value may vary from one manufacturer to another due to differences in base materials and manufacturing processes.

*General Guidelines*


1. Install insulation so the vapor barrier faces the interior of the dwelling.
2. Vapor barriers should not be left exposed.
3. Insulate all voids of the building envelope including small spaces, gaps, around receptacles, pipes, etc.

4. Place insulation on the cold side of pipes and ducts (see Fig. 4). Insulation is not required for supply and return air ducts in heated basements and cellars.

### Ceilings

There is a variety of methods for installing blanket insulation in ceilings.

1. Fastening from below (Fig. 1b).
2. Installing unfaced (without a vapor barrier), friction-fit blankets (Fig. 2).
3. Laying the insulation in from above when the ceiling finish material is in place (Fig. 1a).

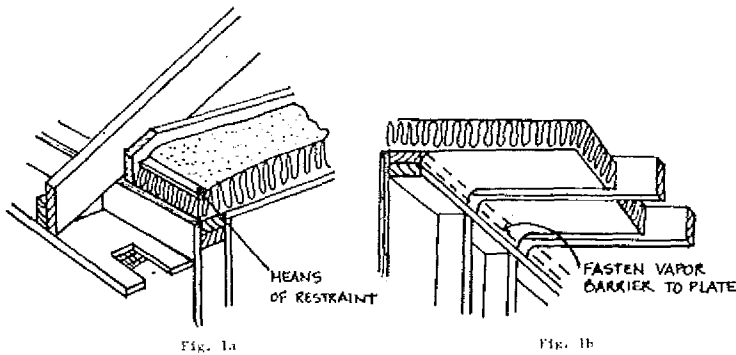

Fasten flanges to the inside of ceiling joists as shown in Fig. 1b. Extend the insulation entirely across the top plate, keeping the blanket as close to the plate as possible. Fasten vapor barrier to plate. When eave vents are used, the insulation should not block air movement from eave to space above insulation (Fig. 1a).

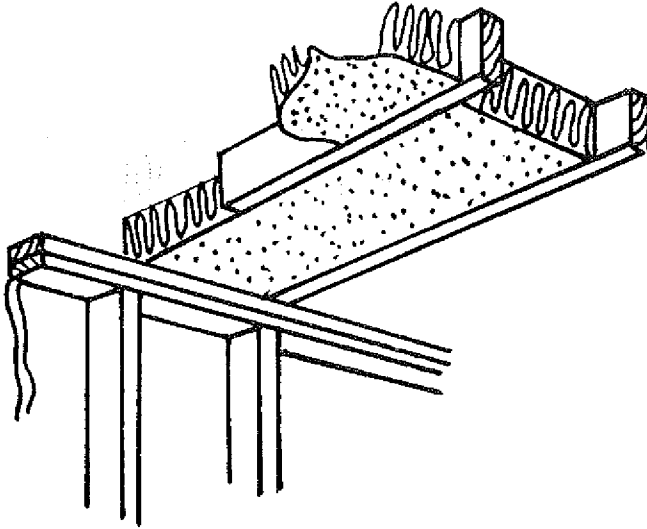


Fig. 2

Insert friction-fit blankets between ceiling joists (Fig. 2). Allow insulation to overlap the top plate of the exterior wall, but not enough to block eave ventilation. The insulation should be in contact with the top of the plate to avoid heat loss and air infiltration beneath the insulation. The required vapor barrier is not shown.

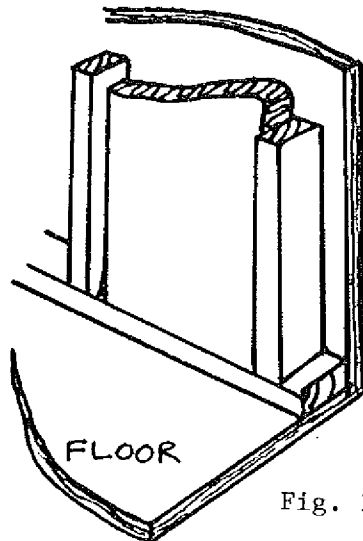


Fig. 3

Insert blankets into stud spaces. Working from the top down, space fasteners per manufacturers recommendations, fitting flanges tightly

against face of stud (Fig. 3). Cut blankets slightly over length and fasten the vapor barrier to the top and bottom plates.

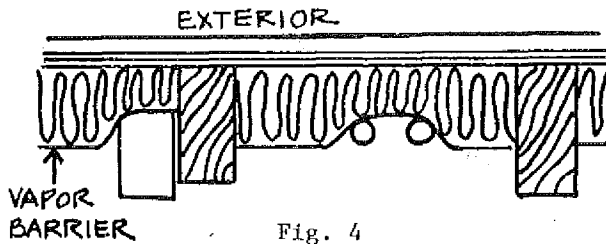


Fig. 4

Insert insulation behind (cold side in winter) pipes, ducts, and electrical boxes (Fig. 4).



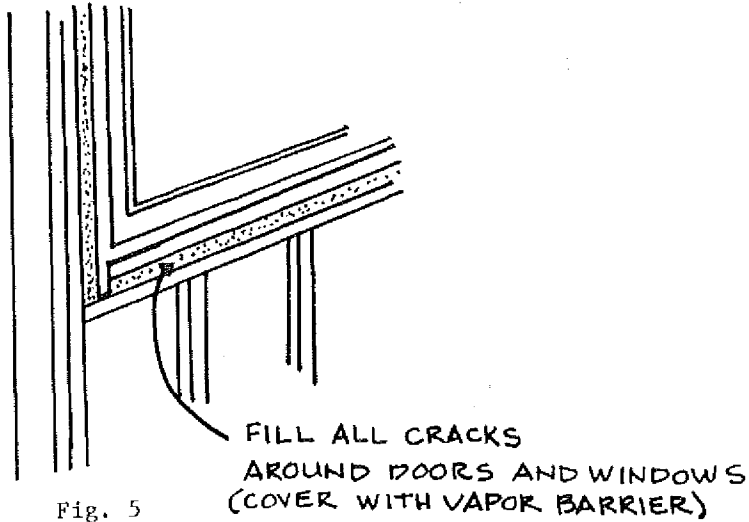


Fig. 5


Fill small spaces between rough framing and door and window heads, jambs and sills with pieces of insulation (Fig. 5).

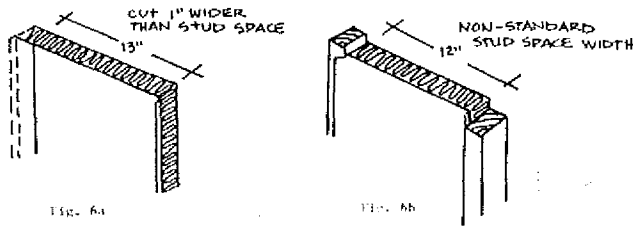

Insulate nonstandard-width stud or joist spaces by cutting the insulation and vapor barrier an inch or so wider than the space to be filled (Fig. 6a). Pull the vapor barrier on the cut side to the other stud, compressing the insulation behind it, and fasten through vapor barrier to stud face (Fig. 6b). Unfaced blankets are cut slightly oversize and fitted into place.

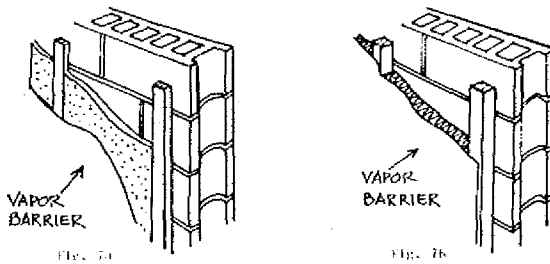

Masonry walls may be insulated by inserting insulation between fur-ring strips spaced at 16 or 24 inches o.c. (Fig. 7a and 7b). It is recommended to apply the vapor barrier to the inside surface.

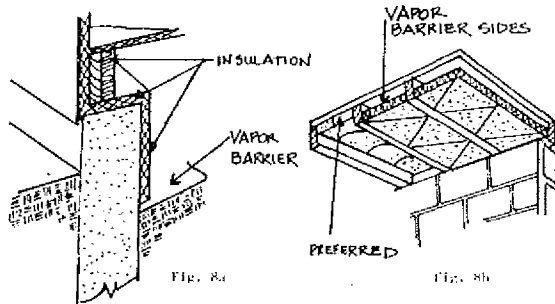*Floor and Crawl Spaces*

Floors over crawl spaces (Fig. 8a) should be insulated either by insulating the foundation walls or by placing insulation on or between the joists. Insulation should be securely fastened. In all cases, the vapor barrier side of the insulation should face the floor above; that is, be adjacent to the warm side in winter. A vapor barrier should be used to cover the ground.

*Dropped Soffits*

Insulation of dropped soffits over kitchen cabinets, bathtubs, showers, or similar areas, need special attention when they are exposed to the attic. If the dropped soffit is framed before ceiling finish material is applied, a "board" (plywood, hardboard, gypsumboard, etc.) should be installed over the cavity to support insulation.


In multiple dwellings with back-to-back kitchens or baths, it is necessary to extend ceiling finish material over dropped soffits to the party wall to avoid loss of acoustical control and to provide adequate fire stops.

*Rigid Insulation*

Rigid insulation is available in various sizes and thicknesses made of polystyrene, polyurethane, cork, cellular glass, mineral fiber (glass or rock wool), perlite, wood fiberboard, etc. They are used as insulation for masonry construction, as perimeter insulations around concrete slabs, as exterior sheathing under the weather barrier, as rigid insulations on top of roof decks, and other applications. Rigid insulations, such as polystyrene and polyurethane, are vapor barriers and, in most applications, will not require the installation of a separate barrier.

*Installation Procedures*

*Masonry walls:* Rigid insulations are applied to either face of a masonry wall (Fig. 9a and 9c) or are used as a cavity insulation between two wythes of masonry (Fig. 9b). When applied to the face of masonry walls, they are generally installed with adhesive and/or mechanical fasteners. The manufacturer's recommendation should be followed.

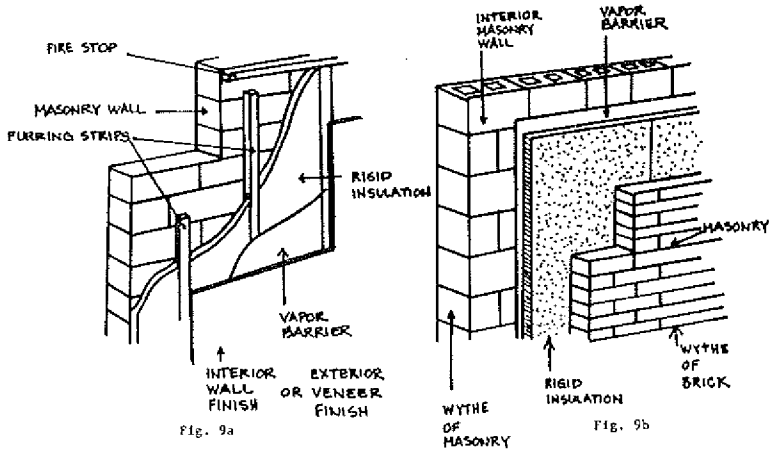

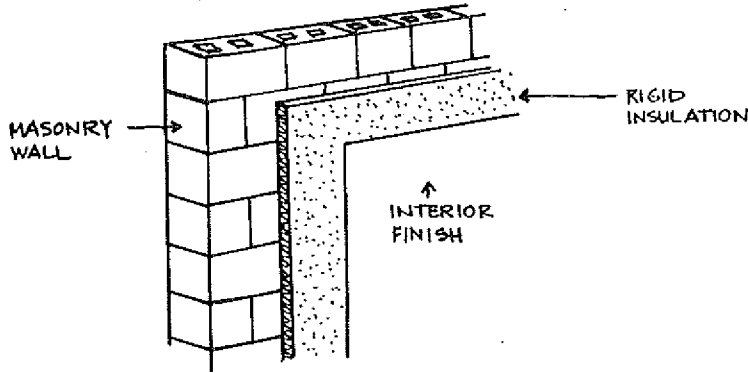


Fig. 9c

*Frame Construction:* When rigid insulation is used with frame construction (Fig. 10), it is usually applied as sheathing to the outside of the framing, and mechanically attached with nails to wood studs or to metal studs with screws or clips or other approved methods.

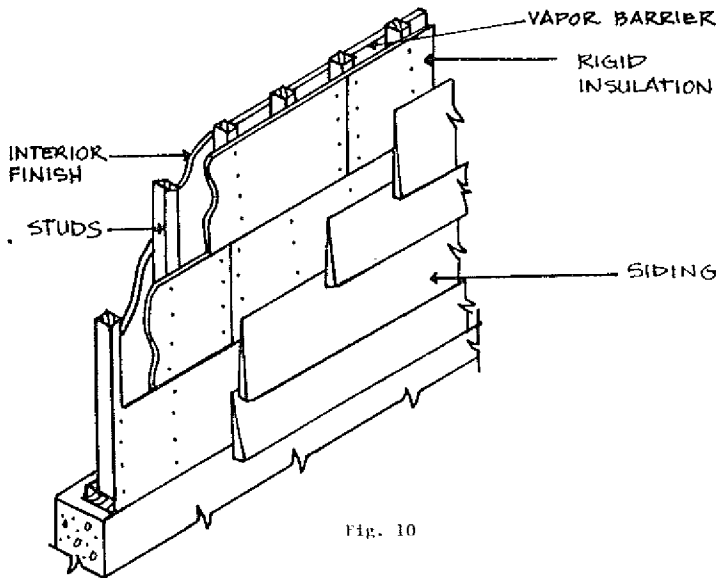


Fig. 10



*Roof Insulation:* Roof insulation boards are usually installed with an approved adhesive, hot asphalt, or may be nailed to the roof sheathing. The manufacturer's instructions should be followed.

*Slab-on-Grade:* Rigid insulation is frequently used as insulation around the perimeter of concrete slabs-on-grade (Fig. 11b, c, d) and also may be used on the inside of foundation walls adjacent to heated crawl spaces, basements or cellars (Fig. 11a). Installation is usually accomplished with adhesive and/or mechanical fasteners. Perimeter insulation should be installed against the foundation wall or extended into the interior of the building to a distance equal to the design frost line (Fig. 11b, c and d). Where the slab bears on the foundation ledge, the insulation should be a load-bearing type.

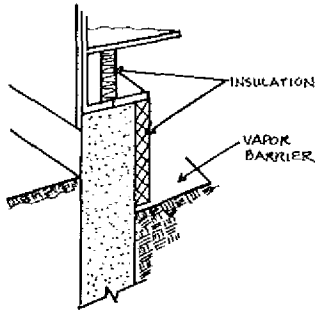


Fig. 11a




Fig. 11b

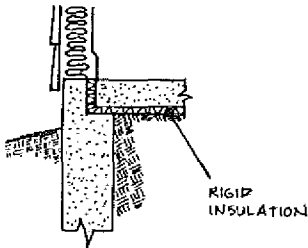


Fig. 11c


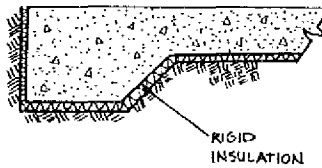


Fig. 11d

Concrete block manufacturers are currently producing several types of multi-celled block with improved insulating values. The thermal resistance of the block will vary depending upon the types of insulation used and the configuration of the cells. An example of a typical multi-celled block is shown below.

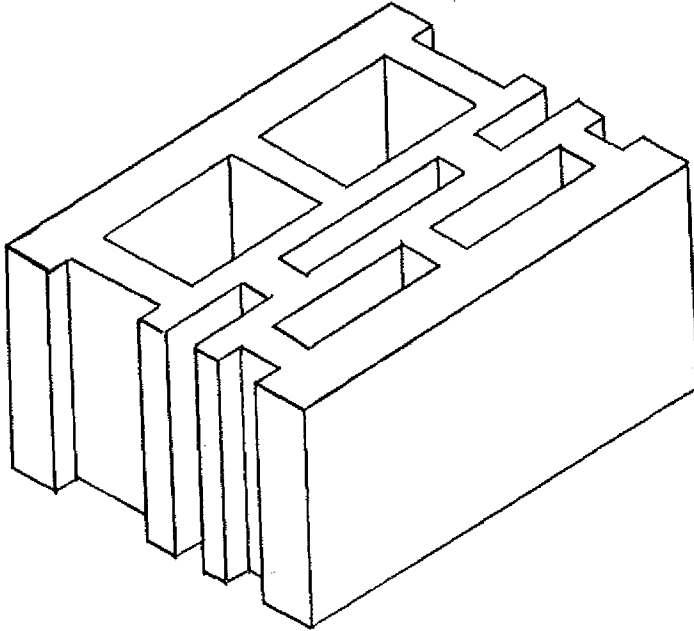

#### LOOSE FILL INSULATION

Materials of this type are those made from mineral fibers (rock or glass), cellulose materials (wood fibers or shredded paper), or other manufactured products that can easily be poured.

#### BLOWN ATTIC INSULATION

There are several factors pertaining to blown attic insulation that can cause differences in its installed thermal resistance value (R). For a given manufacturer's insulation, the installed thermal resistance (R) value depends on thickness and weight of insulating material applied per square foot. Federal specification HH-1-1030A for insulation requires that each bag of insulation be labeled to show the minimum

INSULATED CONCRETE BLOCK

thickness, the maximum net coverage, and the minimum weight of (that particular) insulation material required per square foot to produce resistance values of R-30, 22, 19, and 11. A bag label example for blown insulation is shown in Fig. 12.

The number of bags of blown insulation required to provide a given R-value to insulate an attic of a given size may be calculated from data provided by the manufacturer. If only the thickness of blown attic insulation is specified, and the density or number of bags is not, the desired or assumed thermal resistance (R) value may not be achieved. The important characteristic is weight per square foot. Thickness is the minimum thickness, not the average thickness experienced in the field.

Adequate baffling of the vent opening or insulation blocking should be provided so as to deflect the incoming air above the surface of the installed blown or poured insulation. Baffles should be made of durable material securely fastened. Baffles should be in place at the time of framing inspection.

Three blown insulations that provide R-19 are:

Material	Minimum Thickness	Maximum Net Coverage/Bag	Bags/1000 Sq. Ft.
Cellulose	5 1/4"	59 sq. ft. (40 lb. bag)	17
Glass fiber	8 3/4"	51 sq. ft. (24 lb. bag)	20
Rock wool	6 1/2"	26 sq. ft. (27 lb. bag)	38

*Bag Label Example:* The manufacturer recommends these maximum coverages at these minimum thicknesses to provide the levels of installed insulation resistance (R) values shown:

(Based on 25-pound nominal weight bag)

R-Value	Minimum Thickness	Minimum Weight per Sq. Ft.	Bags per 1000 Sq. Ft.	Maximum Net Coverage per Bag
To obtain an insulation resistance R of:	Installed insulation should not be less than:	The weight per sq. ft. of installed insulation should be not less than:	Number of bags of installed insulation per 1000 sq. ft. of net area should not be less than:	Contents of this bag should not cover more than:
R-30	13 3/4 in. thick	0.768 lbs. per sq. ft.	30	33 sq. ft.
R-22	10 in. thick	0.558 lbs. per sq. ft.	22	45 sq. ft.
R-19	8 3/4 in. thick	0.489 lbs. per sq. ft.	20	51 sq. ft.
R-11	5 in. thick	0.279 lbs. per sq. ft.	11	90 sq. ft.

Weight contents: not less than 24 lbs.

R-values are determined in accordance with ASTM C-687 and C-236

Fig. 12

REFLECTIVE INSULATION

Reflective insulation is composed of aluminum foil in one or more layers either plain or laminated to one or both sides of kraft paper for structural strength. The insulation value for reflective air spaces, which this type of insulation provides, varies widely depending on the direction of heat flow. They are much more efficient when the heat flow is down. Reflective insulations which comply with the requirements when used in a floor, may not be satisfactory in ceilings or walls, where the heat flow is

upward and horizontal, respectively. Reflective insulations are effective in controlling radiant heat energy when installed so that they face an air space. Insulation should be installed in such a manner that it is continuous, without holes or tears.

#### SPRAYED INSULATION

There are several types of insulation which are sprayed against the surface of the building materials or in cavities. Some of these are cellulose with binder, mineral wool with binder, and cellular foams. They may be sprayed directly on concrete, masonry, wood, plastic, or metal panels or may be sprayed between the framing members. Manufacturer's recommended instructions should be followed. To determine that the proper thickness is installed, either refer to the plans and specifications, or request a certification from the supplier that the insulation installed provides the required "R" value.

#### TYPICAL INSULATION THICKNESSES AND VALUES

<u>Insulation</u>	<u>Approximate R-Value</u>	<u>Thickness</u>
Fiber glass	11	3½"
Fiber glass	13	3¾"
Fiber glass	19	6"
Fiber glass	30	8"
Fiber glass	38	12"
Extruded Polystyrene Foam	5.4	1"
Extruded Polystyrene Foam	10.8	2"

#### VAPOR BARRIERS

Vapor barriers are used in conjunction with insulation to decrease the chance of moisture condensation inside the building insulation. Vapor barriers are placed on the side of the wall, ceiling or floor that is warm in winter. For equal vapor pressures, moisture vapor penetration through holes or tears in the insulation vapor barrier is proportional to the size of the opening. Holes or tears should be repaired. A snug fit of blanket flanges against the framing is necessary to prevent moisture from bypassing the vapor barrier.

#### EQUIPMENT

The installation of the heating system can contribute to inefficiencies. A furnace which is oversized by a factor of 2 will require 8 to 10% more fuel than a furnace of correct size. An installation that has uninsulated ducts passing through an unheated crawl or attic space will lose about 1.5 Btu per hour per square foot of duct per degree of temperature differential between duct air and outside air. This can amount to 40% of a furnace output under mild conditions. Undersized ducting will reduce the amount of circulating air and will affect the capacity of the furnace, but will normally have little effect upon its efficiency. Atmospheric combustion equipment that draws its combustion and stack-dilution air from the heated space will require up to 8% more fuel in a season to heat the required makeup air than sealed combustion equipment. Stack heat recovery devices can recover from about 4% at 450° F to 8% at 800° F.

The appliance manufacturer should be consulted when retrofitting the appliance with combustion air to assure that the appliance warranty is not affected.

#### *Effect of Sizing Limitation on Equipment*

Using the example on system design illustrated in Appendix A, an analysis was made to see what impact or problem the proposal for limiting the size of equipment to 15% above the design losses would have.

Example:

Total construction loss	27,760 Btu/hour
One air change per hour:	
Inside volume = 12,188 cu. ft.	
$Q = (12,188) (90) (.018) = 19,744$ Btu/hour	
Total infiltration loss	<u>19,744 Btu/hour</u> 47,504 Btu/hour

Maximum furnace size:

$$47,504 \text{ Btu/hour} + 47,504 (.15) \text{ Btu/hour} = 54,630 \text{ Btu/hour}$$

### COMBUSTION AIR FOR FIREPLACES

It is recommended that combustion air from the exterior be provided for all fireplaces. Masonry fireplaces can be made more energy efficient with combustion air terminating in the fireplace. The opening of the fireplace should be equipped with a door and the combustion air duct with a damper and a louver to minimize air leakage during periods of nonuse.

### CONDENSATION CONTROL

#### *Air Infiltration*

The department will accept infiltration losses determined by the air crack method or an overall value of ½ air change per hour.

The department will accept the use of engineered top-side moisture vent systems.

#### *Relative Humidity*

*Winter:* During the winter it is desirable to have humidity in the air in order to prevent the nostrils from becoming dry, furniture from cracking, etc. However, from an energy standpoint, it is desirable to keep the relative humidity low; the trade-off is at about 30%.

*Summer:* During the summer it is desirable to reduce the level of relative humidity in the building in relationship to the outside relative humidity. The relative humidity should be kept as high as possible in order to conserve energy, but low enough for comfort. The relative humidity should be kept above 55%, but less than 60%.