

Chapter ILHR 41

SCOPE, GENERAL RULES,
NEW AND EXISTING INSTALLATIONS

PART I—SCOPE AND DEFINITIONS

- ILHR 41.01 Scope (p. 2)
- ILHR 41.015 Petition for modification (p. 2)
- ILHR 41.016 Penalties (p. 3)
- ILHR 41.02 Definitions (p. 3)

PART II—GENERAL RULES

- ILHR 41.03 Safety rules (p. 6)
- ILHR 41.04 Reporting accidents, repairs and alterations (p. 7)
- ILHR 41.05 Notification of installation of boilers, pressure vessels and power piping (p. 7)
- ILHR 41.06 Identification of boilers and pressure vessels (p. 11)
- ILHR 41.07 Safety and safety relief valve repairs (p. 11)
- ILHR 41.08 Certificate of competency as inspector (p. 12)
- ILHR 41.09 Inservice field inspectors (p. 14)
- ILHR 41.10 Adoption of ASME standards (p. 15)
- ILHR 41.105 Adoption of miscellaneous standards (p. 17)
- ILHR 41.11 Boiler blow-down equipment (p. 18)
- ILHR 41.12 Protection of vessels supplied through pressure reducing valves (p. 19)
- ILHR 41.13 Maintenance (p. 21)
- ILHR 41.15 Manufacturer's data reports (p. 22)
- ILHR 41.16 Low-water cutoff and water feeder (p. 22)

PART III—INSPECTIONS

- ILHR 41.17 Inspection fees (p. 22)
- ILHR 41.19 Initial inspections required (p. 22)
- ILHR 41.20 Periodic inspections required (p. 23)
- ILHR 41.21 Exemptions from periodic inspections (p. 24)
- ILHR 41.22 Preparations for internal inspection (p. 25)
- ILHR 41.23 Insurance company inspections (p. 25)
- ILHR 41.24 Inspections by cities (p. 26)
- ILHR 41.25 Companies or corporations allowed to make inspections (p. 26)
- ILHR 41.26 Reporting of inspections (p. 26)
- ILHR 41.27 Inspection report forms (p. 27)
- ILHR 41.28 Certificates of operation (p. 27)
- ILHR 41.29 Condemnation (p. 28)

PART IV—NUCLEAR POWER PLANTS

- ILHR 41.30 Installation registration (p. 28)
- ILHR 41.35 Periodic inspections (p. 28)
- ILHR 41.40 Welded repair (p. 29)
- ILHR 41.45 Report of incidents (p. 29)

PART V—NEW INSTALLATIONS,
ORIGINAL CONSTRUCTION

- ILHR 41.50 ASME code vessels (p. 29)
- ILHR 41.51 Wisconsin special vessels (p. 30)
- ILHR 41.52 U.S. department of transportation—federal highway division (p. 31)
- ILHR 41.53 Noncode vessels (p. 31)
- ILHR 41.54 Multi-boiler installation (p. 32)
- ILHR 41.55 Pressure gauges for air receivers (p. 32)
- ILHR 41.56 Power piping (p. 32)
- ILHR 41.57 Organic fluid heat transfer systems (p. 32)

PART VI—EXISTING INSTALLATIONS

- ILHR 41.60 Application (p. 33)
- ILHR 41.61 Maximum allowable working pressures (p. 33)
- ILHR 41.62 Code constructed vessels (p. 33)
- ILHR 41.63 Pressure calculations for shells (p. 33)
- ILHR 41.64 Pressure calculations for flat heads and flat surfaces (p. 33)
- ILHR 41.65 Pressure calculations for dished heads (p. 34)
- ILHR 41.66 Dished head restrictions (p. 34)
- ILHR 41.67 Pressure calculation for furnaces and circular flues (p. 34)
- ILHR 41.68 Boiler plate thickness (p. 34)
- ILHR 41.69 Other methods of installing safety devices and other appliances (p. 34)
- ILHR 41.70 Factor of safety (p. 35)
- ILHR 41.71 Strength of materials (p. 35)
- ILHR 41.72 Shearing strength of rivets (p. 35)
- ILHR 41.73 Efficiency of joint (p. 36)
- ILHR 41.74 Ligament between parallel tube holes (p. 37)
- ILHR 41.75 Ligaments between diagonal tube holes (p. 37)
- ILHR 41.76 Maximum pressure for cast iron boilers (p. 37)
- ILHR 41.77 Safety or relief valves required on boilers (p. 38)
- ILHR 41.78 Safety valves for low pressure steam, miniature and power boilers (p. 38)

ILHR 41

ILHR 41.79	Water-relief valves for hot water boilers (p. 40)	ILHR 41.91	Washout and inspection openings (p. 47)
ILHR 41.80	Thermometers for hot water boilers (p. 41)	ILHR 41.92	Manholes (p. 48)
ILHR 41.81	Water glass (p. 41)	ILHR 41.94	Threaded openings (p. 49)
ILHR 41.82	Gage cocks (p. 42)	ILHR 41.95	Boiler setting and installation (p. 49)
ILHR 41.83	Water column piping (p. 42)	ILHR 41.96	Access and firing doors (p. 50)
ILHR 41.84	Pressure gages (p. 43)	ILHR 41.97	Water tube boiler doors (p. 50)
ILHR 41.85	Stop valves on pressure discharge outlets (p. 43)	ILHR 41.99	Pressure relief devices required for unfired pressure vessels (p. 50)
ILHR 41.86	Steam mains (p. 44)		
ILHR 41.87	Bottom blow-off or drain (p. 44)		
ILHR 41.88	Feed pipe (p. 45)		
ILHR 41.89	Combustion regulators for boilers (p. 47)		

Note: Chapters Ind 41 and 42 as they existed on April 30, 1961 were repealed and new chapters Ind 41 and 42 were created effective May 1, 1961. Chapter Ind 41 was renumbered to ch. ILHR 41 effective March 1, 1984.

PART I SCOPE AND DEFINITIONS

ILHR 41.01 Scope. (1) The provisions of chs. ILHR 41 and 42 shall apply to boilers and piping components associated with boilers, pressure vessels and power piping in use at places of employment and in public buildings. The provisions of these chapters are not retroactive unless specifically stated in the administrative rule.

Note: Section 101.01 (2), Stats., provides that the phrase "place of employment" means and includes every place, whether indoors or out or underground and the premises appurtenant thereto where either temporarily or permanently any industry, trade or business is carried on, or where any process or operation, directly or indirectly related to any industry, trade or business, is carried on, and where any person is, directly or indirectly, employed by another for direct or indirect gain or profit, but does not include any place where persons are employed in private domestic service which does not involve the use of mechanical power or farming. "Farming" includes those activities specified in s. 102.04 (3), Stats., and also includes the transportation of farm products, supplies or equipment directly to the farm by the operator of said farm or his employes for use thereon, if such activities are directly or indirectly for the purpose of producing commodities for market, or as an accessory to such production. When used with relation to building codes, "place of employment" does not include a previously constructed building used as a community-based residential facility as defined in s. 50.01 (1), Stats., which serves 20 or fewer unrelated residents, except for the purposes of s. 101.11, Stats.

(2) The provisions of chs. ILHR 41 and 42 shall apply to vessels used for the storage and transportation of flammable liquids, liquefied petroleum gas, anhydrous ammonia, and refrigerants unless these vessels are covered by other Wisconsin administrative codes or federal codes.

History: Cr. Register, April 1961, No. 64, eff. 5-1-74; r. and rec., Register, May, 1974, No. 221, eff. 6-1-74; am. (1), Register, May, 1978, No. 269, eff. 6-1-78; am. Register, June, 1980, No. 294, eff. 7-1-80; am. (1), Register, February, 1984, No. 338, eff. 3-1-84.

ILHR 41.015 Petition for modification. The department will consider and may grant modification to any administrative rule upon receipt of a fee and a completed petition for modification form from the owner, provided an equivalency is established in the petition for modification which meets the intent of the rule being petitioned. The department may impose specific conditions in the petition for modification to promote the protection of the health, safety and welfare of the employes or the public.

Register, February, 1984, No. 338
Boiler and Pressure Vessel Code

Violation of those conditions under which the petition for modification is granted constitutes a violation of these rules.

Note 1: Copies of the petition for modification form (SB-8) are available at no charge from the Division of Safety and Buildings, P.O. Box 7969, Madison, Wisconsin 53707.

Note 2: Section 101.02 (6), Stats., outlines the procedure for submitting petitions to the department and the department's procedures for hearing petitions.

Note 3: See ch. Ind 69 for fee requirements.

History: Cr. Register, February, 1984, No. 338, eff. 3-1-84.

ILHR 41.016 Penalties. Penalties for violations of these rules shall be assessed in accordance with s. 101.02, Stats.

Note 1: Section 101.02 (13) (a), Stats., indicates penalties will be assessed against any employer, employe, owner or other person who fails or refuses to perform any duty lawfully enjoined, within the time prescribed by the department, for which no penalty has been specifically provided, or who fails, neglects or refuses to comply with any lawful order made by the department, or any judgment or decree made by any court in connection with ss. 101.01 to 101.25, Stats. For each such violation, failure or refusal, such employe, owner or other person must forfeit and pay into the state treasury a sum not less than \$10 nor more than \$100 for each violation.

Note 2: Section 101.02 (12), Stats., indicates that every day during which any person, persons, corporation or any officer, agent or employe thereof, fails to observe and comply with an order of the department will constitute a separate and distinct violation of such order.

History: Cr. Register, February, 1984, No. 338, eff. 3-1-84.

ILHR 41.02 Definitions. The definitions of this section shall be applicable throughout this code.

(1) **ASME BOILER AND PRESSURE VESSEL CODES** are those published by the American society of mechanical engineers and will hereinafter be referred to as ASME.

(1a) **ALTERATION.** Alteration means a change in a boiler or pressure vessel that substantially alters the original design requiring consideration of the effect of the change on the original design. It is not intended that the addition of nozzles smaller than an unreinforced opening size be considered an alteration. (Also see "repair.")

(2) **BOILER.** A closed vessel intended for use in heating water or for the application of heat to generate steam or other vapor to be used externally to itself.

(a) **Low pressure boiler.** A boiler on which the safety valves are set at pressures not exceeding 15 psig.

(b) **Miniature boiler.** A miniature boiler is a power boiler or high temperature water boiler which does not exceed any of the following limits:

1. 16 inches inside diameter of shell;
2. 20 square feet heating surface (not applicable to electric boilers);
3. 5 cubic feet gross volume exclusive of casing and insulation;
4. 100 psi maximum allowable working pressure.

(c) **Portable boiler.** An internally fired boiler primarily intended for temporary location and whose construction and usage is obviously of a portable nature.

(d) *Power boiler.* A power boiler is a boiler in which steam or other vapor is generated at a pressure of more than 15 psig.

(e) *High temperature water boiler.* A high temperature water boiler is a water boiler intended for operation at pressures in excess of 160 psig or temperatures in excess of 250° F.

(2m) **BOILER EXTERNAL PIPING.** Boiler external piping means piping within the scope of ASME code section I and which requires ASME code stamping as specified in section I.

(3) **CERTIFICATE OF COMPETENCY.** A certificate issued to a boiler or pressure vessel inspector by the department.

(4) **CONDEMNED.** A boiler or pressure vessel declared to be unsafe and has an applied stamping designating its condemnation.

(5) **DEPARTMENT.** Means the department of industry, labor and human relations.

(5m) **ENFORCEMENT AUTHORITY.** Enforcement authority means the department, which is empowered to formulate definitions, rules and regulations for the safe construction, installation, inspection, operation, maintenance, repair and alteration of boilers and pressure vessels in this state.

(6) **EXISTING INSTALLATION.** Boiler and pressure vessels placed in operation or contracted for prior to January 1, 1957. (See part VI.)

(7) **EXTERNAL INSPECTION.** One made while boiler or vessel is in operation.

(8) **FUSION WELDING.** The melting together of filler metal and base metal, or of base metal only, which results in coalescence.

(8c) **HOT WATER STORAGE TANK.** A hot water storage tank is a tank used to store water that is heated indirectly by a circulating water heater or by steam or hot water circulating through coils or other heat exchange methods internal or external to the tank.

(9) **HOT WATER HEATING BOILER AND HOT WATER SUPPLY BOILER.** A boiler completely filled with water that furnishes hot water to be used externally to itself at pressures not exceeding 160 psig or at temperatures not exceeding 250° F. (A boiler exceeding either of these limits shall be classified as a power boiler.)

(9a) **INCOMPETENCE.** Incompetence means conduct which evidences a lack of ability to discharge the duty required to protect the health, safety and welfare of the public, lack of knowledge of the fundamental principles of inspection services or an inability to apply those principles or failure to maintain competency in the current practices and methods applicable to inspection services and the Boiler and Pressure Vessel Code.

(10) **INSPECTOR, AUTHORIZED OR QUALIFIED.** (a) *Field inspector.* A boiler or pressure vessel inspector who holds a valid certificate of competency issued by the department.

(b) *Shop inspector.* A boiler or pressure vessel inspector who is holding the necessary commissions and employed by a city or a state which has adopted the ASME boiler and pressure vessel code, or who is employed

by an insurance company and who, when performing shop inspections in Wisconsin, holds a certificate of competency issued by the department.

(11) **INTERNAL INSPECTION.** One made when the boiler or pressure vessel is shut down and handholes and manholes or other inspection openings are opened or removed for inspection of the interior as required by the inspector.

(11j) **JURISDICTIONAL AUTHORITY.** See "enforcement authority."

(11k) **MISCONDUCT.** Misconduct means an act performed in the discharge of enforcement duties which jeopardizes the interests of the public, including violation of federal or state laws, local ordinances or administrative rules relating to the position, preparation of deficient or falsified reports, failure to submit information or reports requested by the municipality or the department, conduct which evidences a lack of trustworthiness, misrepresentation of qualifications such as education, experience or certification, illegal entry of premises, misuse of funds, or misrepresentation of authority.

(11n) **NEGLIGENCE.** Negligence means failure entirely by omission or commission to discharge the duty required to protect the health, safety and welfare of the public.

(12) **NON-STANDARD BOILER OR NON-STANDARD PRESSURE VESSEL.** One not bearing a valid Wisconsin stamping, nor the ASME stamping, nor the National Board stamping, nor the U.S. department of transportation stamping, nor the stamping of the API-ASME, nor any stamping authorized by other applicable codes.

(13) **OWNER OR USER.** Any person, firm, or corporation owning or operating a boiler or pressure vessel.

(13p) **POWER PIPING.** Power piping means any steam piping system beyond the scope of ASME code section I and having an operating pressure in excess of 15 psig or any hot water piping system beyond the scope of ASME code section I and subject to temperatures in excess of 250° F.

(13t) **PRESSURE-TEMPERATURE RELIEVING VALVE.** A pressure-temperature relieving valve is an automatic relieving device actuated by the static pressure upstream of the valve which opens further with increase in the pressure over the opening pressure, or by the temperature of the fluid. It is used primarily for liquid service.

(14) **PRESSURE VESSEL.** A pressure vessel is a container for the containment of pressure, either internal or external. This pressure may be obtained from an external source or by the application of heat from a direct or indirect source, or any combination thereof.

(14g) **RELIEF VALVE.** A relief valve is an automatic pressure-relieving device actuated by the static pressure upstream of the valve which opens further with the increase in pressure over the opening pressure. It is used primarily for liquid service.

(15) **REPAIR.** Repair is work necessary to restore a boiler or pressure vessel to a safe operating condition.

ILHR 41

(15g) **RUPTURE DISK.** A rupture disk is a nonmechanical overpressure relief device that releases pressure when its preestablished rating is attained.

(15m) **SAFETY RELIEF VALVE.** A safety relief valve is an automatic pressure-actuated relieving device suitable for use either as a safety valve or relief valve, depending upon application.

(15n) **SAFETY VALVE.** A safety valve is an automatic pressure-relieving device actuated by the static pressure upstream of the valve and characterized by full-opening pop action. It is used for gas or vapor service.

(16) **SECONDHAND VESSEL.** A boiler or pressure vessel when both location and ownership have been changed subsequent to the original installation.

(23) **WATER HEATER.** A water heater is a closed vessel in which water is heated by the combustion of fuels, electricity, or any other source and withdrawn for use external to the system at pressures not exceeding 160 psig and shall include the apparatus by which heat is generated and all controls and devices necessary to prevent water temperatures from exceeding 210° F.

Note: For further explanation of definitions, see the current edition of the ASME Code—Section VIII—Scope.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61; am. (2) (b), (7), (10), Register, January, 1966, No. 121, eff. 2-1-66; am. (3), (4), (8) (a) and (b), (9), (10), (11), (12), (13), (14), (15), and cr. (16), Register, October, 1970, No. 178, eff. 11-1-70; r. and recr. Register, May, 1974, No. 221, eff. 6-1-74; cr. (intro.), (1) (a), (2) (e), (5m), (8t), (11j), (13p), (13t), (14g), (15g), (15m), (15n), and (23), am. (2) (b) and (d), r. and recr. (14) and (15), Register, May, 1978, No. 269, eff. 6-1-78; am. (1a) and (15), cr. (9a), (11k) and (11n), Register, June, 1980, No. 294, eff. 7-1-80; am. (18p) and cr. (2m), Register, February, 1984, No. 338, eff. 3-1-84.

PART II GENERAL RULES

ILHR 41.03 Safety rules. (1) **MAXIMUM OPERATING PRESSURE.** No boiler or pressure vessel shall be operated at a pressure in excess of the maximum operating pressure stated on its current certificate of operation.

(2) **ALTERATION TO SAFETY DEVICES.** No unauthorized person shall remove or tamper with any connected safety device nor shall any person adjust a connected safety valve to a greater relieving pressure than that allowed for the vessel as stated on its current certificate of operation.

(3) **INSTALLATION LOCATION.** Boiler and pressure vessels shall be so installed that there will be sufficient room between the vessel and any ceiling, wall, partition, or floor to facilitate the connection and operation of valves, pipes, and other appurtenances and shall be installed in a manner that will not block any inspection opening.

Note: To assure proper installation, alteration, or repair of a boiler or pressure vessel, it may be necessary to comply with other applicable Wisconsin Administrative Code sections in addition to the Wisconsin Boiler and Pressure Vessel Code. Some of the Wisconsin Administrative Code sections to be considered are as follows:

Sections ILHR 54.14, 55.29, 56.15, 57.14, 58.24, 58.62, 59.21, 60.25, 60.37, 62.32 and 62.78 (boiler room requirements).

Section ILHR 64.09 (combustion air intake requirements).

Register, February, 1984, No. 338
Boiler and Pressure Vessel Code

DEPT. OF INDUSTRY, LABOR & HUMAN RELATIONS 7
ILHR 41

Section ILHR 64.20 (installation and safety control requirements).

Sections ILHR 64.45 to 64.50 (chimney and smokestack requirements).

Section ILHR 64.51 (equipment location and protection requirements).

Wisconsin Administrative Codes may be obtained by contacting State Department of Administration, Document Sales and Distribution, 202 So. Thornton Ave., Madison, Wis. 53702.

(4) **CONTROLS AND HEAT GENERATING APPARATUS.** (a) Oil- and gas-fired and electrically heated boilers shall be equipped with suitable primary (flame safeguard) safety controls, safety limit switches, and burners or electric elements as required by a nationally recognized standard.

(b) The symbol of the certifying organization which has investigated the equipment under par. (a) as having complied with a nationally recognized standard shall be affixed to the equipment and shall be considered as evidence that the unit was manufactured in accordance with that standard. A certifying organization is one that is acceptable to the department and that provides uniform testing, examination, and listing procedures under established, nationally recognized standards.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61; am. (3), Register, January, 1966, No. 121, eff. 2-1-66; am., Register, February, 1971, No. 182, eff. 3-1-71; cr. (4), February, 1982, No. 314, eff. 3-1-82.

ILHR 41.04 Reporting accidents, repairs and alterations. (1) Whenever a boiler or pressure vessel fails and causes injury to any person, the owner or user shall report the facts involved to the department within the following 24 hours. The owner or user shall not remove or disturb the boiler or pressure vessel or any of its parts nor permit any such removal or disturbance prior to receiving authorization from the department, except for the purpose of saving human life or further property damage.

(2) The owner or user shall report any repairs or alterations of a boiler or pressure vessel as required in ch. ILHR 42. The owner or user shall also report conversions to other fuels.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61; am. Register, February, 1971, No. 182, eff. 3-1-71; r. and recr., Register, May, 1974, No. 221, eff. 6-1-74; am. (2), Register, May, 1978, No. 269, eff. 6-1-78.

ILHR 41.05 Notification of installation of boilers, pressure vessels and power piping. (1) **BOILER OR PRESSURE VESSEL INSTALLATION REGISTRATION.** (a) Installing contractors* shall register with the department the installation of any boiler or pressure vessel before the operation of the boiler or vessel. Registration shall be in writing on form DILHR SBD-6314. Owners or users making their own installations shall be considered installing contractors.

(b) Registration with the department is not required for:

1. Pressure vessels exempted from periodic inspections in s. ILHR 41.21.

2. Installations in cities of the first class if the appropriate city official has been notified.

(2) **POWER PIPING INSTALLATION REGISTRATION.** The installing contractor* of any power piping system shall file an installation registration form with the department or with the city if installed in a city of the first

Register, February, 1984, No. 338
Boiler and Pressure Vessel Code

class. (See Form SB-5204 for an example of information required on the registration form.)

*Note: Owners or users making their own installations will be considered installing contractors.

(a) *Exceptions.* 1. Registration is not required for power piping of 2 inches nominal pipe size and smaller.

2. Registration with the department is not required for installations in cities of the first class if an installation registration form has been filed with the appropriate city official.

3. Registration is not required for underground power piping systems which are not located in a walk-in tunnel.

4. Registration is not required for replacements, modifications and alterations to existing systems and for new installations which do not exceed 50 feet in length.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61; am. Register, February, 1971, No. 182, eff. 3-1-71; r. and recr., Register, May, 1974, No. 221, eff. 6-1-74; r. and recr. Register, May, 1978, No. 269, eff. 6-1-78; cr. (2) (a), Register, June, 1980, No. 294, eff. 7-1-80; r. and recr. (1), Register, February, 1982, No. 314, eff. 3-1-82; am. (1) (a) and (b) 1., r. and recr. (2) (a) 3., cr (2) (a) 4. Register, February, 1984, No. 338, eff. 3-1-84.

**BOILER AND PRESSURE VESSEL
INSTALLATION REGISTRATION**

Installing Contractors shall prepare this form in triplicate for each boiler or pressure vessel installed.

Distribute as follows:

WHITE: Attach Registration Fee of \$10.00

Make check payable to: Department of Industry, Labor & Human Relations.

Send to: Safety & Buildings Division
Box 7969, Madison, WI 53707.

YELLOW: Send to owner. **PINK:** Installer's copy.

**STATE OF WISCONSIN
DEPARTMENT OF INDUSTRY, LABOR & HUMAN RELATIONS
SAFETY AND BUILDINGS DIVISION**

(Complete appropriate portion)

BOILER: <input type="checkbox"/> POWER <input type="checkbox"/> HEATING <input type="checkbox"/> MINIATURE		
<input type="checkbox"/> PRESSURE VESSEL		
<input type="checkbox"/> NEW <input type="checkbox"/> USED		

Register, February, 1984, No. 388
Boiler and Pressure Vessel Code

NAME OF USER OR OWNER:			LOCATION OF INSTALLATION:		
STREET ADDRESS:			WIS. REGISTRATION NO.:	NATIONAL BOARD NO.:	
CITY:	STATE:	ZIP CODE:	MFR. SERIAL NO.:	OTHER NO.:	
NAME OF INSTALLING CONTRACTOR:			SIGNATURE OF INSTALLER:		DATE:
STREET ADDRESS:			CITY:	STATE:	ZIP CODE:

DILHR SBD 6314 (N. 02/81)

Register, February, 1994, No. 388
 Boiler and Pressure Vessel Code

FORM SB-5204

**POWER PIPING
 INSTALLATION REGISTRATION**

SB-5204

Installing contractor shall prepare this form in triplicate
 and distribute as follows:

- White - Send to Dept. of Industry, Labor &
 Human Relations, Safety & Buildings
 Division, P.O. Box 7946, Madison,
 Wisconsin 53707,
 or City of Milwaukee, if applicable.
- Yellow - Send to owner.
- Pink - Retain for file.

**STATE OF WISCONSIN
 DEPARTMENT OF INDUSTRY, LABOR AND HUMAN
 RELATIONS
 SAFETY AND BUILDINGS DIVISION**

Complete appropriate portion.

Description of system

Name of user or owner			Location of installation			
Street Address						
City	State	Zip				
Safety valve settings - power source		Capacity	PSIG			
1.	_____	_____	Maximum allowable pressure _____			
2.	_____	_____	Test pressure _____			
3.	_____	_____	Date tested _____			
Name of installing contractor		Street address	City	State	Zip	
I certify this system was installed and tested in accordance with s. ILHR 41.56 of the Wisconsin Administrative Code.						
Date installation completed	Signature of installer			Title	Date registered	

10
 ILHR 41
 WISCONSIN ADMINISTRATIVE CODE

DEPT. OF INDUSTRY, LABOR & HUMAN RELATIONS 11
ILHR 41

ILHR 41.06 Identification of boilers and pressure vessels. (1) The owner or user of a boiler or pressure vessel shall number each vessel in some permanent manner and in an accessible location.

(2) Pressure vessels subject to periodic inspections and all heating and power boilers as defined in s. ILHR 41.02 shall be identified by a registration number supplied by the department. The registration number shall be affixed to the vessel by an authorized inspector at a location which can be easily viewed.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61; r. and recr. Register, February, 1971, No. 182, eff. 3-1-71; am. (2), Register, May, 1974, No. 221, eff. 6-1-74; am. (2), Register, February, 1984, No. 338, eff. 3-1-84.

ILHR 41.07 Safety and safety relief valve repairs. (1) **DEFINITIONS.** (a) Repair of a safety valve or safety relief valve means the replacement, remachining or cleaning of any critical part; lapping of seat and disc or any other operation which may affect the flow passage, capacity, function or pressure retaining integrity; and disassembly, reassembly and adjustments which affect the safety valve or safety relief valve function.

(b) Safety valves and safety relief valves on which the seals have been broken shall be subject to the requirements for repairs.

(c) The initial installation, testing and adjustments of a new safety valve or safety relief valve on a boiler or pressure vessel are not considered a repair if made by the manufacturer or assembler of the valve.

(2) **AUTHORIZED REPAIRS.** Repairs to safety valves and safety relief valves shall be performed by an organization in possession of one or more of the following:

(a) ASME V, HV or UV code symbol stamp;

(b) National Board VR stamp covering the work to be performed; or

(c) An owner's program of maintenance and repair performed by trained and qualified people and authorized by the department.

(3) **AUTHORIZED ADJUSTMENTS.** The department may authorize properly trained and qualified employees of boiler or pressure vessel users to make adjustments to set pressure and blowdown to safety valves and safety relief valves owned by them provided the adjusted settings and capacities and the date of the adjustment are recorded on a metal tag secured to the seal wire. All external adjustments shall be resealed showing the identification of the organization making the adjustments.

(4) **NAMEPLATES.** (a) Except as provided in sub. (3), when a safety valve or safety relief valve is repaired, a metal repair nameplate stamped with the information required by par. (b) shall be welded or otherwise permanently attached to the valve either above, adjacent to or below the original stamping. On small valves, a metal tag showing the repair nameplate information may be securely attached to the repaired valve.

(b) The information on the valve repair nameplate shall include the name of the repair organization, its department authorization number or symbol stamp number, and the date of repair. The nameplate shall be as shown in Figure 41.07. If the set pressure has been changed, it as well as the new capacity, shall be indicated and the set pressure and capacity

Register, February, 1984, No. 338
Boiler and Pressure Vessel Code

marked out but left legible on the original nameplate or stamping. The new capacity shall be based on that for which the valve was originally certified. Only the current repair nameplate need be attached to the valve with the original or duplicate nameplate.

(5) **ILLEGIBLE OR MISSING NAMEPLATES.** (a) When the information on the original manufacturer's nameplate or stamping is illegible, the manufacturer's nameplate or stamping shall be augmented by a nameplate stamped "duplicate" which contains all information required by the applicable section of the ASME Code, except the "V" or "UV" symbol and the NB mark. The repair organization nameplate, with the serialized "VR" stamp and other required data specified in sub. (4) (b), shall make the repairer responsible to the owner and the department that the information on the duplicate nameplate data is correct. If the owner specifies a set pressure or blowdown change, these new parameters and new capacity shall be stamped on the duplicate nameplate in addition to appearing on the valve repairer's nameplate.

(b) When the original valve manufacturer's nameplate is missing, the repair organization shall not be authorized to perform repairs to the valve under the "VR" program unless the valve can be positively identified and original nameplate data can be obtained from the original valve manufacturer, the repairer's inhouse sources or the National Board capacity certification. Valves that can be positively identified shall be equipped with a duplicate nameplate as described in par. (a) as well as the repairer's "VR" stamped nameplate. The repairer's responsibilities for data accuracy as identified in par. (a) shall apply.

Figure 41.07

VALVE REPAIR NAMEPLATE

_____ (name of valve repair firm)	
_____ (set pressure)	_____ (capacity)
No. _____	_____ (date of repair)
(Authorization no. or symbol stamp no.)	

Note 1: The nameplate should be stamped with the valve repair symbol stamp.

Note 2: Capacity should be indicated only when set pressure has been changed.

History: Cr. Register, February, 1984, No. 338, eff. 11-1-84.

ILHR 41.08 Certificate of competency as inspector. (1) **CERTIFICATE REQUIRED.** An inspection report covering a boiler or pressure vessel may be recognized and accepted only when the inspector holds a valid certificate of competency as a boiler or pressure vessel inspector issued by the department.

Register, February, 1984, No. 338
 Boiler and Pressure Vessel Code

(2) **ELIGIBILITY.** (a) The applicant for a certificate of competency as a boiler or pressure vessel inspector shall be an employe of the state, a municipality or an insurance company; or owners or operators of boilers and pressure vessels authorized to make their own inspections.

(3) **QUALIFICATIONS.** The applicant shall have one of the following combinations of education and experience requirements:

(a) A degree in engineering plus one year experience in design, construction, operation or inspection of high pressure boilers and pressure vessels; or

(b) An associate degree in mechanical technology, plus 2 years experience in design, construction, operation or inspection of high pressure boilers and pressure vessels; or

(c) A high school education or the equivalent plus 3 years experience in high pressure boiler and pressure vessel construction or repair; or in charge of high pressure boiler and pressure vessel operation; or in the inspection of high pressure boilers and pressure vessels.

(4) **APPLICATION.** (a) All applications for certification or recertification shall be made to the department together with the payment of the application and examination fees.

(b) Upon receipt of the application form, the department shall review and evaluate the application and make all necessary notifications to the applicant.

(5) **ISSUANCE OF CERTIFICATE.** Certificates of competency for a boiler or pressure vessel inspector will be issued by the department to eligible applicants successfully passing the examinations prescribed by and conducted by the department. The certificate shall bear the name of the applicant, certificate number and expiration date. The certificate shall be valid for a period of one year from the date of issuance.

(a) Applicants failing the examination may apply to retake the examination.

(b) Holders of certificates who do not apply for renewal in any 5-year period may be required to pass a scheduled examination.

(6) **RENEWAL OF CERTIFICATE.** Upon receipt of written notice of expiration, certification may be renewed. The request for renewal, together with the payment of the renewal fee, shall be filed with the department on or before January 1 of the calendar year for which the certificate is to be valid.

(7) **DENIAL OF CERTIFICATE.** (a) *Notice of denial.* Upon denial of certification or recertification, the department shall notify the applicant in writing stating the reasons for denial. The notice of denial shall be made by certified mail sent to the address filed with the application. Service will be verified by the certified mail receipt.

(b) **HEARING.** Upon receipt of denial, any applicant may submit a written request for hearing. The right to hearing shall be waived if the applicant fails to submit the request within 30 days. Hearings will be conducted by the department and the proceedings recorded.

(8) **SUSPENSION OR REVOCATION OF CERTIFICATION.** The department may suspend or revoke the certification of any inspector for any of the following reasons:

- (a) Fraud or deceit in obtaining certification.
- (b) Any negligence, incompetence or misconduct in the discharge of the duties required under this chapter.
- (c) Conviction of a criminal charge, misdemeanor or local regulation substantially related to the circumstances of the certified inspection activity or adjudication of mental incompetence by the courts.

(9) **RECIPROCITY.** A certificate of competency may be granted by the department to a boiler or pressure vessel inspector who holds a certificate issued by the national board of boiler and pressure vessel inspectors or a certificate of competency from a city or state which has adopted the ASME Boiler and Pressure Vessel Code and which holds a written examination similar to that required by the department.

(10) **SUSPENSION AND REVOCATION PROCEEDINGS.** (a) *Investigation and notification.* The department will investigate alleged violations at its own initiative or upon the filing of a complaint. If it is determined that no further action is warranted, the department will notify the persons affected. If the department determines that there is probable cause for suspension, it shall order a hearing and notify, by mail, the persons affected.

(b) *Response.* Upon receipt of hearing notice, the charged party may respond to the charges in writing. Failure to respond within 30 days or failure to appear at the hearing may result in the charges being taken as true.

(c) *Hearings.* All hearings will be conducted by persons selected by the department.

(d) *Findings.* Any findings shall be in writing and shall be binding unless appealed to the secretary of the department.

(e) *Appeals.* All appeal arguments shall be submitted in writing.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61; r. and recr. Register, February, 1971, No. 182, eff. 3-1-71; am. (1), (3) (c), (4) (a), (6) (a) 1. and 3., Register, May, 1974, No. 221, eff. 6-1-74; am. (2) (b) and (5) (a), r. (6) (a) 3., Register, May, 1978, No. 269, eff. 6-1-78; r. and recr., Register, June, 1980, No. 294, eff. 7-1-80; am. (3) (a) and (b), (5) (b), Register, February, 1984, No. 338, eff. 3-1-84.

ILHR 41.09 In-service field inspectors. (1) **ELIGIBILITY.** The applicant for an in-service field inspector authorization shall be an employe of the department, a municipality or an insurance company; or owners or operators of boilers and pressure vessels authorized to make their own inspections.

(2) **QUALIFICATIONS.** The applicant shall have one of the following education and experience qualifications:

(a) A bachelor's degree in engineering from an accredited college or university, which is deemed to be the equivalent of 2 years experience in design, construction, operation or inspection of high pressure boilers and pressure vessels; or

Register, February, 1984, No. 338
Boiler and Pressure Vessel Code

(b) An associate degree in mechanical technology plus one year of actual experience in design, construction, operation or inspection of high pressure boilers and pressure vessels; or

(c) A high school diploma or equivalent plus 2 years of practical experience in the construction, installation, repair, operation, maintenance or inspection of high pressure boilers and pressure vessels.

(3) APPLICATION. (a) All applications for an in-service field inspector authorization shall be made to the department together with the payment of the application and examination fees.

(b) Upon receipt of the application form, the department shall review and evaluate the application and make all necessary notifications to the applicant.

(4) ISSUANCE OF AUTHORIZATION. In-service field inspector authorizations will be issued by the department to eligible applicants successfully passing the examination prescribed by and conducted by the department. The authorization shall bear the name of the applicant, authorization number and expiration date. The authorization shall be valid for a period of 15 months from the date of issue.

(a) Applicants failing the examination may apply to retake the examination.

(b) The authorization shall be nonrenewable.

(5) INSPECTION WORK. (a) The in-service field inspector authorization may be utilized by the holder only while in the continuous employ of the authorized inspection agency by whom employed at the time of application.

(b) The authorized in-service field inspector may perform only field inspection work and such work shall be performed while accompanied by an authorized field inspector during the first 90 days of employment and under the direct supervision of an authorized field inspector for the following 12 months.

(c) If the authorized inspection agency specified in par. (a) is an insurance company, then the authorized in-service field inspector may perform field inspection work only upon objects covered by such insurance company.

(d) Inspection of repairs and alternations shall be performed by an authorized inspector in possession of a certificate of competency.

(6) APPLICATION FOR CERTIFICATE OF COMPETENCY. Upon completion of one year of experience as an authorized in-service field inspector while in the continuous employ of the authorized inspection agency by whom employed at the time of application, the holder of a valid authorization, through such employer, may apply for a certificate of competency.

History: Cr. Register, February, 1984, No. 338, eff. 3-1-84.

ILHR 41.10 Adoption of ASME standards. (1) The standards, amendments and errata issued by the American society of mechanical engineers as listed in Table 41.10-A are hereby incorporated by reference into this code.

(2) Pursuant to s. 227.025, Stats, consent has been granted to incorporate by reference the rules contained in the standards, amendments and errata listed in Table 41.10-A.

(a) Copies are on file in the offices of the department, the secretary of state and the revisor of statutes.

(b) Copies may be procured for personal use from the American Society of Mechanical Engineers, United Engineering Center, 345 East 47th St., New York, New York 10017.

(c) Copies may be on file at public and university libraries.

TABLE 41.10-A

		As amended by Summer Addenda issued June 30th and Winter Addenda issued December 31st of each respective year: S-Summer; W-Winter.			
		ASME	1980	1981	1982
1. Section	I	Power Boilers, 1980 Edition	S W	S W	S W
2. Section	II	Material Specifications, 1980 Edition	S W		
	a.	Part A—Ferrous Material	S W	S W	S W
	b.	Part B—Nonferrous Material	S W	S W	S W
	b.	Part C—Welding Rods, Electrodes and Filler Metals	S —	S W	S W
3. Section	III	Nuclear Power Plant Components, 1980 Edition			
	a.	Division 1 and Division 2 General Requirements Subsection NCA	S W	S W	S W
		Division 1			
	a.	Subsection NB—Class 1 Components	S W	S W	S W
	b.	Subsection NC—Class 2 Components	S W	S W	S W
	c.	Subsection ND—Class 3 Components	S W	S W	S W
	d.	Subsection NE—Class MC Components	S W	S W	S W
	e.	Subsection NF—Component Supports	S W	S W	S W
	f.	Subsection NG—Core Support Structures	S W	S W	S W
	g.	Appendices	S W	S W	S W
		Division 2			
	a.	Concrete Reactor Vessels and Containments	S W	S W	S W
4. Section	IV	Heating Boilers, 1980 Edition	S W	S W	S W
5. Section	V	Nondestructive Examination, 1980 Edition	S W	S W	S W
6. Section	VIII	Pressure Vessels, 1980 Edition			
	a.	Division 1—Pressure Vessels	S W	S W	S W
	b.	Division 2—Alternative Rules	S W	S W	S W
7. Section	IX	Welding and Brazing Qualifications, 1980 Edition	S W	S W	S W
8. Section	X	Fiberglass-Reinforced Plastic Pressure Vessels, 1980 Edition	— W	S W	S —
9. Section	XI	Rules for Inservice Inspection of Nuclear Power Plant Components, Division 1, 1980 Edition	— W	S W	S W
		ANSI			
10.	Power Piping (ANSI B31.1, 1980 edition)				

History: Cr. Register, May, 1974, No. 221, eff. 6-1-74; r. and recr. Register, April, 1975, No. 232, eff. 5-1-75; r. and recr. table Register, May, 1976, No. 245, eff. 6-1-76; r. and recr. table Register, March, 1977, No. 255, eff. 4-1-77; am. table Register, September, 1978, No. 273, eff. 10-1-78; am. table Register, June, 1980, No. 294, eff. 7-1-80; r. and recr. table, cr. (2) (c), Register, February, 1982, No. 314, eff. 3-1-82; am. table Register, August, 1982, No. 320, eff. 9-1-82; am. table Register, February, 1984, No. 338, eff. 3-1-84.

ILHR 41.105 Adoption of miscellaneous standards, (1) CONSENT TO INCORPORATE. Pursuant to s. 227.025, Stats., the attorney general and the

Register, February, 1984, No. 338
Boiler and Pressure Vessel Code

revisor of statutes have consented to the incorporation by reference of the following standards:

(a) ANSI Z21.10.1-1981 Gas Water Heaters, Volume I Automatic Storage Water Heaters with Inputs of 75,000 Btu per Hour or Less, with Addenda Z21.10.1a-1982.

(b) ANSI Z21.10.3-1981 Gas Water Heaters, Volume III Circulating Tank, Instantaneous and Large Automatic Storage Water Heaters, with Addenda Z21.10.3a-1982.

(c) ANSI Z21.56-1979 Gas-Fired Swimming Pool Heaters, with Addenda Z21.56a-1981 and Z21.56b-1982.

(d) UL 174-1977 Household Electric Storage Tank Water Heaters.

(e) UL 732-1974 Oil-Fired Water Heaters.

(f) UL 795-1982 Commercial-Industrial Gas-Heating Equipment, with revisions dated March 25, 1982.

(g) UL 1453-1982 Electric Booster and Commercial Storage Tank Water Heaters, with revisions dated July 27, 1982.

(2) **INTERIM AMENDMENTS.** Interim amendments of the standards listed in sub. (1) shall have no effect in the state until such time as this section is correspondingly revised to reflect those changes.

(3) **AVAILABILITY OF STANDARDS.** The standards in reference may be obtained at a reasonable cost by writing to the following addresses:

(a) American National Standards Institute, Inc., 1430 Broadway, New York, NY 10018.

(b) Underwriters' Laboratories, Inc., 333 Pfingsten Road, Northbrook, IL 60062.

(4) **FILING OF STANDARDS.** Copies of the standards in reference are on file in the offices of the department, the secretary of state and the revisor of statutes.

History: Cr. Register, February, 1984, No. 338, eff. 3-1-84.

ILHR 41.11 Boiler blow-down equipment. (1) The blow-down from a boiler or boilers that enters a sewer system or blow-down which is considered a hazard to life or property shall pass through some form of blow-off equipment that will reduce pressure and temperature as required herein-after.

(2) The temperature of the water leaving the blow-off equipment shall not exceed 140° F.

(3) The pressure of the blow-down leaving any type of blow-off equipment shall not exceed 5 psi.

(4) The blow-off piping and fittings between the boiler and the blow-off tank shall comply with ss. ILHR 41.50 and 41.51 of this code.

(5) The tank shall be designed in accordance with ss. ILHR 41.50 and 41.51 of this code for a working pressure of at least one-fourth the maximum working pressure of the boiler to which it is connected.

(6) All blow-off equipment, except centrifugal blow-down separators, shall be fitted with openings to facilitate cleaning and inspection and shall have:

- (a) A pressure gauge graduated from 0-25 psi;
- (b) A thermometer well located near the water outlet connection and in contact with the retained water in the tank;
- (c) A gauge glass at least ½ inch in diameter. The lower connection to the glass shall be at a point about 6 inches below the water line; the upper connection about 6 inches above;
- (d) A drain connection at least 2-inch standard pipe size;
- (e) Connections designed so that freezing will not close the inlet, the outlet, or the vent;
- (f) Vent piping, full size, piped to the outside atmosphere and discharged to a safe location.

Note: Blow-off equipment designed in accordance with the boiler blow-off equipment code issued by the National Board of Boiler and Pressure Vessel Inspectors, 1973 edition, will meet the requirements of this section. Other methods of designing blow-off equipment may be used if approved by the department.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61; r. and recr. (6), Register, May, 1974, No. 221, eff. 6-1-74.

ILHR 41.12 Protection of vessels supplied through pressure reducing valves. (1) The following formula shall be used for determining the sizes of safety and relief valves on pressure vessels such as pressure cookers, indirect hot water heaters, equipment in heating systems, etc., which are supplied through pressure reducing valves from boilers carrying a higher steam pressure. Where a pressure reducing valve is supplied by a boiler, the capacity of the safety valve or valves on the low pressure side of the system need not exceed the capacity of the boiler.

$$RVC = \frac{1}{2} \times OC \times VSPA$$

Where RVC = relief valve capacity, lbs. of steam per hour.

OC = orifice capacity, lbs. of steam per hour per sq. in. (See Table 1.)

VSPA = valve size pipe area, sq. in. (See Table 2.)

(a) The actual flow coefficient provided by the pressure-reducing valve manufacturer may be used in place of the coefficient ½ in the above formula. The coefficient used shall be the largest obtainable by internal trim change of the valve.

(b) In using Table 1, the pressure-reducing valve inlet pressure is the maximum allowable working pressure of the piping system to the inlet side of the pressure-reducing valve.

TABLE 1. ORIFICE RELIEVING CAPACITIES, POUNDS PER SQUARE INCH

Outlet pres. psig	Pressure-reducing valve inlet pressure, psig															
	400	350	300	250	200	175	150	125	100	85	75	60	50	40	30	25
250.....	21000	17100	10800	—	—	—	—	—	—	—	—	—	—	—	—	—
200.....	21350	18250	15350	10900	—	—	—	—	—	—	—	—	—	—	—	—
175.....	21350	18250	16000	12600	7250	—	—	—	—	—	—	—	—	—	—	—
150.....	21350	18250	16200	13400	9540	6750	—	—	—	—	—	—	—	—	—	—
125.....	21350	18250	16200	13600	10800	8780	6220	—	—	—	—	—	—	—	—	—
110.....	21350	18250	16200	13600	11000	9460	7420	4550	—	—	—	—	—	—	—	—
100.....	21350	18250	16200	13600	11000	9760	7970	5630	—	—	—	—	—	—	—	—
85.....	21350	18250	16200	13600	11000	9760	8480	6640	4070	—	—	—	—	—	—	—
75.....	21350	18250	16200	13600	11000	9760	8480	7050	4980	3150	—	—	—	—	—	—
60.....	21350	18250	16200	13600	11000	9760	8480	7200	5750	4540	3520	—	—	—	—	—
50.....	21350	18250	16200	13600	11000	9760	8480	7200	5920	5000	4230	2680	—	—	—	—
40.....	21350	18250	16200	13600	11000	9760	8480	7200	5920	5140	4630	3480	2470	—	—	—
30.....	21350	18250	16200	13600	11000	9760	8480	7200	5920	5140	4630	3860	3140	2210	—	—
25.....	21350	18250	16200	13600	11000	9760	8480	7200	5920	5140	4630	3860	3340	2580	1485	—
15.....	21350	18250	16200	13600	11000	9760	8480	7200	5920	5140	4630	3860	3340	2830	2320	1800
10.....	21350	18250	16200	13600	11000	9760	8480	7200	5920	5140	4630	3860	3340	2830	2320	2060
5.....	21350	18250	16200	13600	11000	9760	8480	7200	5920	5140	4630	3860	3340	2830	2320	2060

Note: The following formulas shall be used in connection with this table to calculate the required relieving capacity of safety valves installed on the low-pressure side of pressure-reducing valves. Use the formula that requires the larger relieving capacity. The actual flow coefficient provided by the pressure-reducing valve manufacturer may be used in place of the coefficient 1/2 in the following formula.

where: $W = \frac{1}{2} AC$ or $W = \frac{1}{2} A_1 C$

- W = required safety valve relieving capacity in pounds of steam per hour
- A = internal area in square inches of the pipe size of the pressure-reducing valve (use pipe areas of Table 2)
- A₁ = internal area in square inches of the pipe size of the bypass line around the pressure-reducing valve
- C = orifice relieving capacity, pounds of steam per hour per square inch for the given inlet and outlet pressures of the pressure-reducing valve (from this Table)

Register, February, 1984, No. 338
Boiler and Pressure Vessel Code

TABLE 2.—INTERNAL PIPE AREA

Nominal pipe size, inches	STANDARD WEIGHT PIPE		
	Actual external diameter, inches	Approx. internal diameter, inches	Approx. internal area, square inches
3/8	0.675	0.49	0.19
1/2	0.840	0.62	0.30
3/4	1.050	0.82	0.53
1	1.315	1.05	0.86
1 1/4	1.660	1.38	1.50
1 1/2	1.900	1.61	2.04
2	2.375	2.07	3.36
2 1/2	2.875	2.47	4.78
3	3.5	3.07	7.39
3 1/2	4.0	3.55	9.89
4	4.5	4.03	12.73
5	5.563	5.05	19.99
6	6.625	6.07	28.89
8	8.625	8.07	51.15
10	10.750	10.19	81.55
12	12.750	12.09	114.80

Note: In applying these rules, the area of the pipe is always based upon standard weight pipe and the inlet size of the pressure-reducing valve.

(2) The following formula shall be used to determine the steam flow rate through the bypass when pressure reducing valves are arranged with a valved bypass which also acts as a potential steam source hazard in case the bypass is left open.

$$RVC = \frac{1}{2} \times OC \times BPA.$$

Where RVC = relief valve capacity, lbs. of steam per hour.

OC = orifice capacity, lbs. of steam per hour per square inch. (See Table 1.)

BPA = bypass pipe area, square inch. (See Table 2.)

(3) The larger of the relief valve capacities calculated by the formulas in subs. (1) and (2) shall be used for selecting the relief valve for the vessel.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61; am. Register, January, 1966, No. 121, eff. 2-1-66; r. and recr. (1) and Table 1, Register, February, 1971, No. 182, eff. 3-1-71; r. (1) second "Note" following Table 2 including referenced formulas that follow this note and cr. (1) (a) and (b), Register, May, 1971, No. 185, eff. 6-1-71; renun. (1) (a) and (b) to be (2) and (3) and am. (3), cr. (1) (a) and (b), am. Table 2, Register, February, 1984, No. 338, eff. 3-1-84.

ILHR 41.13 Maintenance. (1) All boilers and pressure vessels shall be installed and maintained in such a manner as to prevent excessive corrosion and deterioration.

(2) The inspector shall note conditions during internal inspection, external inspection, or hydrostatic pressure test and shall order such

Register, February, 1984, No. 338
Boiler and Pressure Vessel Code

ILHR 41

changes or repairs as will place the boiler or pressure vessels in a safe working condition.

Note: Sections VI and VII, ASME Boiler and Pressure Vessel Code, "Recommended Rules for the Care and Operation of Heating Boilers" and "Recommended Rules for Care of Power Boilers" are excellent guides for boiler owners and operators.

Note: This section applies to both new and existing installations.

History: Cr. Register, February, 1971, No. 182, eff. 3-1-71; am. Register, June, 1980, No. 294, eff. 7-1-80.

ILHR 41.15 Manufacturer's data reports. The owner or user shall retain the manufacturer's data reports, except data reports for boilers and pressure vessels exempt from ASME code construction requirements. See s. ILHR 41.50.

History: Cr. Register, May, 1974, No. 221, eff. 6-1-74; r. and recr. Register, May, 1978, No. 269, eff. 6-1-78.

ILHR 41.16 Low-water cutoff and water feeder. (1) Every automatically fired power boiler which does not have a full-time attendant and every automatically fired low-pressure steam boiler shall be equipped with an automatic low-water fuel cutoff or other device which will perform a similar function, so located as to automatically cut off the fuel supply when the surface of the water falls to the lowest safe water line. If a water-feeding device is installed, it shall be so constructed that the water inlet valve cannot feed water into the boiler through the float chamber and so located as to supply requisite feed water. The lowest safe water line shall be not lower than the lowest visible part of the water glass.

(2) Designs embodying a float and float bowl, or probe control installed in a bowl or chamber externally to the boiler shall have a vertical straightway valved drain pipe at the lowest point in the water equalizing pipe connections by which the bowl or chamber and the equalizing pipe can be flushed and the device tested.

Note: See s. ILHR 41.54 for hot water heating boilers.

History: Cr. Register, May, 1974, No. 221, eff. 6-1-74.

PART III INSPECTIONS

ILHR 41.17 Inspection fees. Each inspection, test, or service performed by the department shall be paid for at rates established in ch. Ind 69, Fee Schedule. (The owner is responsible for the payment of fees.)

History: Cr. Register, May, 1974, No. 221, eff. 6-1-74.

ILHR 41.19 Initial inspections required. (1) **BOILER AND PRESSURE VESSEL INSPECTIONS.** (a) Except as provided in par. (b), boilers and pressure vessels shall be inspected by an authorized inspector before they are placed in operation.

(b) The inspections specified in par. (a) are not required for pressure vessels exempted from periodic inspections in s. ILHR 41.21.

(c) Where the boilers or pressure vessels specified in par. (a) are installed in a city of the first class and inspections are made by the city, such city shall keep a record of the inspections and shall submit a copy to the department.

Register, February, 1984, No. 338
Boiler and Pressure Vessel Code

(d) Where the inspections specified in par. (a) are performed by an authorized inspector other than a department inspector, such authorized inspector shall file an inspection report with the department and shall affix the Wisconsin registration number as required in s. ILHR 41.06.

(2) **POWER PIPING INSPECTIONS.** (a) Except as provided in pars. (b), (c) and (d), all power piping systems beyond the scope of ASME code section I and required to be constructed in accordance with the ANSI standard for power piping as listed in Table 41.10-A, shall be inspected by an authorized inspector employed by the department or by the city if installed in a city of the first class.

(b) The inspections specified in par. (a) are not required for power piping of 2 inches nominal pipe size and smaller.

(c) The inspections specified in par. (a) are not required for power piping replacements, modifications and alterations to existing systems and for new installations which do not exceed 50 feet in length.

(d) The inspections specified in par. (a) are not required for underground power piping systems which are not located in a walk-in tunnel.

(e) It shall be the responsibility of the installing contractor to notify the department or the city of the first class at the start of construction so that inspections may be arranged. The department or the city shall be given a minimum of 48 hours notice to arrange for inspection.

(f) Power piping inspections shall be made after the piping material is delivered to the job site and prior to the start of the installation. Power piping systems shall not be insulated or placed in service without receiving an inspection.

(g) Evidence shall be provided to the authorized inspector that all prefabricated piping complies with the ANSI standard for power piping as listed in Table 41.10-A.

(h) The owner of the power piping system may request power piping inspections in addition to the minimum inspections.

(i) Inspection fees for the power piping inspections shall be assessed by the department or by the city of the first class.

History: Cr. Register, May, 1974, No. 221, eff. 6-1-74; am. (1) (intro.) and cr. (1) (c), Register, May 1978, No. 269, eff. 6-1-78; renum. from Ind 41.14 and r. and recr. Register, February, 1984, No. 338, eff. 3-1-84, except (2), eff. 8-1-84.

ILHR 41.20 Periodic inspections required. (1) **ALL INSPECTIONS.** The authorized inspectors of the department, upon presenting appropriate credentials to the owner, operator, or agent in charge, are authorized:

(a) To enter without delay and at reasonable times any factory, plant, establishment, construction site, or other area, workplace or environment where work is performed by an employe of an employer; and

(b) To inspect and investigate during regular working hours and at other reasonable times, and within reasonable limits and in a reasonable manner, any such place of employment and all pertinent conditions, structures, machines, apparatus, devices, equipment, and materials therein, and to question privately any such employer, owner, operator, agent or employe.

(2) **CONTACTING REPRESENTATIVE.** The inspector before making an inspection shall contact a representative of the employer and a representative authorized by the employees who shall be given an opportunity to accompany the inspector during the physical inspection of any workplace under sub. (1) for the purpose of aiding such inspection.

(a) Where there is no authorized employee representative, the inspector shall consult with a reasonable number of employees concerning matters of health and safety in the workplace.

Note: The department policy is not to give advance notice, but in the scheduling and in the act of inspecting it may not always be possible to avoid advance notice or to obtain accompaniment as, for example, inside boilers or in precarious locations of elevator installations, but otherwise these rules will be diligently observed.

(3) **INSPECTION OF BOILERS.** Except as regulated in ss. ILHR 41.20 (5) and 41.21, boilers shall be subjected to either a regular internal or external inspection at least once every 12 months by a qualified inspector.

(a) *When internal inspection is not possible.* Where an internal inspection is not possible because of the construction of the boiler, an external inspection will be acceptable.

(4) **INSPECTION OF PRESSURE VESSELS.** Except as regulated in s. ILHR 41.21, pressure vessels shall be subjected to a regular internal or external inspection at least once every 36 months by a qualified inspector.

(5) **INSPECTION OF LOW PRESSURE STEAM AND HOT WATER HEATING BOILERS.** Except as regulated in s. ILHR 41.21, low pressure steam and hot water heating boilers shall be subjected to a regular external or internal inspection at least once every 36 months by a qualified inspector.

(6) **INSPECTION OF SAFETY VALVES AND SAFETY RELIEF VALVES.** The inspectors shall satisfy themselves that safety valves and safety relief valves have been tested at least once per year.

(7) **EXTENSION OF PERIOD BETWEEN INSPECTIONS.** If operating conditions require, an extension of periods between inspections of boilers, pressure vessels, safety valves and safety relief valves may be approved by the department upon a written request from the owner or user for an extension.

Note: For inspection fees, see ch. Ind 69.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61; am. (2), (3), (4), Register, October, 1970, No. 173, eff. 11-1-70; renum. (1), (2), (3), (4) to be (3), (4), (5) and (6) and cr. (1) and (2), Register, April, 1973, No. 208, eff. 5-1-73; r. and recr. (3), (4), (5) and r. (6), Register, May, 1974, No. 221, eff. 6-1-74; am. (2) (intro.), (4) and (5), Register, May, 1978, No. 269, eff. 6-1-78; cr. (6) and (7), Register, February, 1982, No. 314, eff. 3-1-82; am. (6), Register, February, 1984, No. 338, eff. 3-1-84.

ILHR 41.21 Exemptions from periodic inspections. (1) The following will not be subject to periodic inspection:

(a) Boilers or pressure vessels which receive regular inspections by United States government inspectors.

(b) Heating boilers located in private residences or in apartment buildings having less than 3 living units.

(c) Expansion tanks for hot water heating boilers having an operating pressure of less than 50 psig with no limitation on size.

Register, February, 1984, No. 338
Boiler and Pressure Vessel Code

- (d) Boilers used exclusively for agricultural purposes.
- (e) Pressure vessels having an inside diameter not exceeding 6 inches with no limit on pressure.
- (f) Pressure vessels having a volume of less than 5 cubic feet and an operating pressure of less than 250 psig.
- (g) Pressure vessels with a volume of less than 1-½ cubic feet with no limit on pressure.
- (h) Pressure vessels having an internal or external operating pressure of not more than 15 psig with no limitations on size.
- (i) Hot water supply boilers, water heaters and hot water storage tanks.
- (j) Vessels used for the storage or processing cold water, including those with air cushions.
- (k) Pressure vessels which are used in accordance with the regulations of the U.S. department of transportation.

(2) EXCEPTION. In individual cases, the boilers and pressure vessels exempted in sub. (1) will be subject to inspection by or on order of the department upon complaint of any person or upon initiative of the department when there is reasonable cause to suspect that the construction, installation, maintenance or operation of the vessel is not in keeping with the general purpose and intent of this code.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61; r. and recr. Register, February, 1971, No. 182, eff. 3-1-71; am. (1) (b), (i) and (j), Register, May, 1974, No. 221, eff. 6-1-74; r. and recr. Register, May, 1978, No. 269, eff. 6-1-78; r. (1) (b) and (f), renum. (1) (c) to (e), (g) to (m) to be (1) (b) to (d) and (e) to (k) and am. (1) (b), Register, February, 1984, No. 338, eff. 3-1-84.

ILHR 41.22 Preparation for internal inspection. The owner or user of a boiler or a pressure vessel subject to inspection shall prepare the vessel for internal inspection after due notice from the inspector. To prepare a vessel for an internal inspection all manhole plates, all wash-out plugs, and a sufficient number of handhole plates to permit a satisfactory inspection shall be removed. The shell and heads shall be thoroughly cleaned and exposed when so requested. Each steam boiler shall be thoroughly drained of water and all fire side surfaces cleaned before an internal inspection is made.

Note: The following precautionary procedure is the recommended preparation for inspection:

Before opening the manhole or manholes and entering any part of a boiler which is connected to a common header with other boilers, the required steam or water system stop valves should be closed, tagged, and preferably padlocked, and drain valves or cocks between the two closed stop valves opened. The feed valves should be closed, tagged, and preferably padlocked, and drain valves or cocks located between the two valves opened. After draining the boiler, the blowoff valves should be closed, tagged and preferably padlocked. Blowoff lines, where practicable, should be disconnected between pressure parts and valves. All drains and vent lines should be opened.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61; r. and recr. Register, February, 1971, No. 182, eff. 3-1-71.

ILHR 41.23 Insurance company inspections. (1) Periodic inspections of boilers and pressure vessels by insurance companies may be accepted by the department under the following conditions:

Register, February, 1984, No. 338
Boiler and Pressure Vessel Code

ILHR 41

(a) The boiler and pressure vessel inspectors employed by the insurance company shall hold certificates of competency issued by the department.

(b) The insurance company shall report inspections of boilers and pressure vessels to the department as required in s. ILHR 41.26.

(c) The inspection procedures used by the insurance company shall conform to the regulations of this code.

(d) The insurance company shall report to the department within 30 days when insurance coverage is started or discontinued on a boiler or pressure vessel. The reason for discontinuing the coverage shall be given on the report. If the boiler or pressure vessel is installed in a city of the first class and inspections are made by the city, the report shall also be provided to the city.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61; r. and recr. Register, February, 1971, No. 182, eff. 3-1-71; am. (1) (a), (b) and (d), Register, May, 1974, No. 221, eff. 6-1-74; am. (1) (d), Register, February, 1984, No. 338, eff. 3-1-84.

ILHR 41.24 Inspections by cities. (1) Periodic inspections of boilers and pressure vessels by cities of the first class may be accepted by the department under the following conditions:

(a) The boiler and pressure vessel inspectors employed by the city shall hold certificates of competency issued by the department.

(b) The city shall keep a record of such periodic inspections and shall submit a copy to the department.

(c) The inspection procedures used by the city shall conform to the regulations of this code.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61; r. and recr. Register, February, 1971, No. 182, eff. 3-1-71; am. (1) (a) and (b), Register, May, 1974, No. 221, eff. 6-1-74.

ILHR 41.25 Companies or corporations allowed to make inspections. (1) Periodic inspections by companies or corporations of boilers or pressure vessels which they own or operate may be accepted by the department under the following conditions:

(a) The boiler and pressure vessel inspectors employed by the company or corporation shall hold certificates of competency issued by the department.

(b) The company or corporation shall report inspections of boilers and pressure vessels to the department as required in s. ILHR 41.26.

(c) The inspection procedures used by the company or corporation shall conform to the regulations of this code.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61; r. and recr. Register, February, 1971, No. 182, eff. 3-1-71; am. (1) (a) and (b), Register, May, 1974, No. 221, eff. 6-1-74.

ILHR 41.26 Reporting of inspections. (1) Reports of periodic internal or external inspections of boilers and pressure vessels shall be sent to the department within 15 days from the date of inspection.

(2) External inspections shall be reported only when either of the following conditions is found:

Register, February, 1984, No. 338
Boiler and Pressure Vessel Code

(a) An internal inspection is not possible because of the construction of the vessel. In such cases the first inspection shall be reported to the department in the same manner as an internal inspection. The report shall be marked "external" and the reason for making an external inspection instead of an internal shall be given.

(b) When violations of this code or unsafe conditions involving the safety of the vessel are found. This report shall be made on forms acceptable to the department and shall explain the violation or unsafe condition with references to code section numbers. A copy of the recommendations to the owner or user of the vessel shall accompany the report to the department.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61; am. (1), Register, February, 1971, No. 182, eff. 3-1-71; am., Register, May, 1974, No. 221, eff. 6-1-74; am. (2) (b), Register, June, 1980, No. 294, eff. 7-1-80.

ILHR 41.27 Inspection report forms. (1) An internal or external boiler inspection that conforms to periodic inspection requirements (ILHR 41.20) shall be reported to the department on inspection forms acceptable to the department or national board of boiler and pressure vessel inspectors standard form.

(2) A pressure vessel inspection that conforms to periodic inspection requirements (ILHR 41.20) shall be reported to the department on inspection forms acceptable to the department or national board of boiler and pressure vessel inspectors standard form.

(a) Multiple vessels on a single report. A group of pressure vessels of the same design and use that are interconnected or are operated so as to form a unit, machine, or apparatus may be included in a single report. The report shall contain the number, description, and use of the vessel and shall be reported to the department on inspection forms acceptable to the department or national board of boiler and pressure vessel inspectors standard form.

(3) The inspection report shall be legible and complete as possible. A manufacturer's data report of boiler or pressure vessel shall be available to inspector for first inspection.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61; r. and recr. Register, February, 1971, No. 182, eff. 3-1-71; am. (1) and (2), Register, May, 1974, No. 221, eff. 6-1-74; am. (1) and (2), Register, June, 1980, No. 294, eff. 7-1-80.

ILHR 41.28 Certificates of operation. (1) The owner or user of the boiler or pressure vessel shall be responsible for obtaining and maintaining a valid certificate of operation.

(2) After each periodic internal or external inspection a certificate of operation shall be issued to the owner or user of the boiler or pressure vessel by the department or by the city authorized by that agency.

(3) The certificate of operation shall give the maximum operating pressure as determined using the regulations of the code.

(4) The certificate of operation shall be valid until the next required periodic inspection.

ILHR 41

(5) The certificate of operation shall be kept on file on the premises by the owner or user of the boiler or pressure vessel and shall be available when called for by a deputy of the department.

Note: See ch. Ind 69, Fee Schedule, for amount of fee to be paid to the department for all certificates of operation.

History: Cr. Register, April, 1961, No. 64 eff. 5-1-61; am. (1), (4) and (5), Register, January, 1966, No. 121, eff. 2-1-66; am. (1), (2), (3) and (4) and r. (5), Register, October, 1970, No. 178, eff. 11-1-70; am. (1) and (4), Register, May, 1974, No. 221, eff. 6-1-74; renum. (1) to (4) to be (2) to (5) and cr. (1), Register, February, 1984, No. 338, eff. 3-1-84.

ILHR 41.29 Condemnation. (1) The condemnation of a boiler or pressure vessel shall be a function of the department only. Any boiler or pressure vessel declared by an authorized inspector to be unsafe and beyond repair shall be referred to the department for condemnation proceedings.

(2) Any boiler or pressure vessel confirmed by the department to be unsafe for further use shall be stamped as follows:

"CONDEMNED"

"Arrowhead Stamp x Wisconsin x Arrowhead Stamp"

Letters shall be at least $\frac{3}{8}$ " high and arrowheads shall be $\frac{1}{2}$ " wide.

(3) It shall be unlawful for any person, firm, partnership or corporation to use, operate, or offer for sale for operation within the state any condemned boiler or pressure vessel.

History: Cr. Register, October, 1970, No. 178, eff. 11-1-70; am. (1) and (2), Register, May, 1974, No. 221, eff. 6-1-74.

**PART IV
NUCLEAR POWER PLANTS**

ILHR 41.30 Installation registration. (1) **OWNER REPORT FILING BEFORE OPERATION.** The owner of any nuclear class pressure vessel within the scope of ASME code section III, except as regulated in s. ILHR 41.21, shall file a copy of form N-3, ASME data report, with the department before operating the pressure vessel.

(2) **REGISTRATION OF BOILERS, PRESSURE VESSELS, AND POWER PIPING.** All other boilers, pressure vessels, and power piping at nuclear power plants shall be registered with the department as required by s. ILHR 41.06. The installation inspection shall meet the requirements of s. ILHR 41.19.

Note: Large groups of vessels may be reported in summary form in lieu of individual reports for each vessel.

History: Cr. Register, May, 1978, No. 269, eff. 6-1-78; am. (2) Register, February, 1984, No. 338, eff. 3-1-84.

ILHR 41.35 Periodic inspections. (1) **IN-SERVICE INSPECTION PROGRAM.** The owner or user shall place on file with the department an in-service inspection plan as required by section XI of the ASME code listed in Table 41.10-A. The department shall be notified at least 10 days prior to all planned shutdowns which include in-service inspections.

Note: A copy of the in-service inspection plan accepted by the Nuclear Regulatory Commission will be acceptable to the department in satisfying the filing of an in-service inspection plan required by this code.

Register, February, 1984, No. 338
Boiler and Pressure Vessel Code

(2) **STATEMENT OF INSPECTION SERVICE CONTRACT.** The owner or user shall file a statement with the department indicating possession of an arrangement with an authorized inspection agency to provide inspection services under section XI of the ASME code listed in Table 41.10-A. The statement must include the name and address of the current authorized inspection agency.

(3) **IN-SERVICE INSPECTION REPORT.** Within 90 days after each in-service inspection, the owner or user shall submit an owner's data report for in-service inspection (NIS-1) describing the inspections performed under section XI of the ASME code listed in Table 41.10-A.

(4) **FREQUENCY OF INSPECTION.** Pressure vessels located within a nuclear containment may be inspected as part of the in-service inspection. The vessels shall be inspected at least once every 36 months.

Note: Extension of period between inspections. If operating conditions require, longer periods between inspections may be approved by the department upon receipt of a written request for an extension.

History: Cr. Register, May, 1978, No. 269, eff. 6-1-78.

ILHR 41.40 Welded repair. (1) RECORD OF REPAIR. The owner or the owner's agent shall furnish the department, within 90 days, a record of repair (form SB-190) when any component within the scope of ASME code section XI is repaired by welding.

Note #1: No other supporting documents are required to be submitted to meet this requirement.

Note #2: Multiple repairs to the same object may be reported on a single report form.

(2) **RECORD OF MODIFICATIONS, REPLACEMENT, ADDITIONS OR ALTERATIONS.** When modifications, replacements, additions or alterations are made by welding, the requirement stated in sub. (1) shall apply.

(3) **EXEMPTION.** Piping, valves and fittings of 2-inch nominal pipe size and smaller are exempt from the requirements of this section.

History: Cr. Register, May, 1978, No. 269, eff. 6-1-78.

ILHR 41.45 Report of incidents. The owner or the owner's agent shall report to the department any incident involving pressure-retaining components within the scope of section XI of the ASME code which requires notification to the U.S. nuclear regulatory commission. The report shall be filed coincident with the report to the U.S. nuclear regulatory commission.

Note: It is the intent of the department to avoid conflicts with the requirements of the U.S. nuclear regulatory commission.

PART V NEW INSTALLATIONS ORIGINAL CONSTRUCTION

ILHR 41.50 ASME code vessels. Except as regulated in ss. ILHR 41.51, 41.52 and 41.53, boilers and pressure vessels installed after the effective date of this section shall be constructed and installed in accordance with the ASME standards adopted under s. ILHR 41.10. Electric boilers shall

Register, February, 1984, No. 338
Boiler and Pressure Vessel Code

be constructed and installed in accordance with ASME section I or IV as applicable.

Note: The department will recognize the applicable "case interpretations" of the ASME Boiler and Pressure Vessel Code as being acceptable.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61; r. and recr. Register, December, 1962, No. 84, eff. 1-1-63; am. Register, August, 1964, No. 104, eff. 9-1-64; am. Register, January, 1966, No. 121, eff. 2-1-66; am. Register, March, 1966, No. 123, eff. 4-1-66; r. and recr., Register, November, 1970, No. 179, eff. 12-1-70; am. (1) intro. par., Register, March, 1971 No. 183, eff. 4-1-71; r. and recr., Register, May, 1974, No. 221, eff. 6-1-74; am. Register, May, 1978, No. 269, eff. 6-1-78; am. Register, February, 1984, No. 338, eff. 3-1-84.

ILHR 41.51 Wisconsin special vessels. (1) Where it is not possible or practical to construct a boiler or pressure vessel in strict compliance with s. ILHR 41.50, the department may grant a modification to the owner or user to permit the installation of the vessel as a Wisconsin special within the state of Wisconsin. The department will consider a modification request upon receipt of a completed petition for modification form and the required fee. The modification may be granted under the following conditions:

(a) When the method of designing or constructing the vessel is not covered by the ASME codes listed in s. ILHR 41.10, the department may approve the installation of the vessel if adequate proof of comparable safety of the design or construction is shown.

1. Complete plans, calculations, and specifications in duplicate shall be submitted to and approved by the department before the vessel is installed.

2. The vessel shall be stamped "Wisconsin Special".

3. All other applicable requirements of the ASME codes listed in s. ILHR 41.10 shall be met.

(b) When the vessel is to be built by an owner for the owner's use, the department may waive the stamping required by the ASME codes listed in s. ILHR 41.10.

1. Complete plans, calculations, and specifications in duplicate shall be submitted to and approved by the department before the vessel is installed.

2. The vessel shall be stamped "Wisconsin Special".

3. All other applicable requirements of the ASME codes listed in s. ILHR 41.10 shall be met.

(c) When a small number of vessels is to be built by a manufacturer, the department may waive the stamping required by the ASME codes listed in s. ILHR 41.10.

1. Complete plans, calculations, and specifications in duplicate shall be submitted to and approved by the department before the vessel is installed.

2. The vessel shall be stamped "Wisconsin Special".

3. All other applicable requirements of the ASME codes listed in s. ILHR 41.10 shall be met.

(2) The provisions of this section shall not apply to Wisconsin special vessels accepted by the department before the effective date of this section.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61; r. and recr., Register, February, 1971, No. 182, eff. 3-1-71; r. and recr., Register, May, 1974, No. 221, eff. 6-1-74; am. (1) (intro.), Register, February, 1984, No. 338, eff. 3-1-84.

ILHR 41.52 U.S. department of transportation—federal highway division. Pressure vessels carrying the stamping of the D.O.T. will be considered comparable to a vessel meeting the requirements of s. ILHR 41.50. When such vessels are used in the state of Wisconsin, it shall be the responsibility of the owner of the vessels to have the construction records of the vessels available for inspection by the department.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61; am. Register, February, 1971, No. 182, eff. 3-1-71; am., Register, May, 1974, No. 221, eff. 6-1-74.

ILHR 41.53 Noncode vessels. (1) EXEMPTED VESSELS. The following vessels are not required to be constructed and installed in accordance with the codes listed in Table 41.10-A:

(a) Water heaters used exclusively for hot water service and hot water storage tanks, provided such apparatus meets the requirements of the applicable standards listed in s. ILHR 41.105. Water heaters or hot water storage tanks bearing the stamp, monogram or other evidence of approval of the applicable standard, or bearing the ASME stamp, shall be considered as conforming with the provisions of this chapter. Water heaters or hot water storage tanks not so identified shall:

1. Have their design submitted for approval by the department for approval;

2. Withstand a hydrostatic pressure of 300 psig or their rated hydrostatic test pressure if greater than this amount without developing leakage or permanent distortion; and

3. Be equipped with suitable primary flame safeguard, safety controls, limit switches and burners, or electric elements as required by the applicable standards listed in s. ILHR 41.105.

(b) Vessels for containing water under pressure for domestic supply, including those having an air space for expansion;

(c) Pressure vessels used for the storage of water at water temperatures not exceeding 210° F. Such vessels may contain a steam or hot water coil or heat exchanger, provided the steam is at or below a pressure of 15 psig and the hot water is at or below a pressure of 160 psig and a temperature of 250° F; and

(d) Pressure vessels used for water conditioning and filtration.

(2) **VESSEL IDENTIFICATION.** The vessels listed in sub. (1) (b), (c) and (d) shall be identified with the manufacturer's name, a serial number, the allowable working pressure and the year fabricated.

(3) **PRESSURE-RELIEF REQUIREMENTS.** (a) Except as provided in par. (b), the vessels listed in sub. (1) shall meet the pressure-relief device requirements of the ASME codes listed in Table 41.10-A.

Register, February, 1984, No. 338
Boiler and Pressure Vessel Code

ILHR 41

(b) Water heaters and hot water storage tanks shall be equipped with pressure-temperature relief devices:

1. Listed by AGA, UL, or ASME when heat inputs are less than or equal to 200,000 Btu per hour and temperatures do not exceed 210° F; and
2. Listed by ASME when heat inputs exceed 200,000 Btu per hour.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61; am. (1) (intro. par.) and (1) (a), Register, May 1974, No. 221, eff. 6-1-74; am. (1) (c) and r. and recr. (1) (intro.) and (a), Register, May, 1978, No. 269, eff. 6-1-78; r. and recr. Register, February, 1984, No. 338, eff. 3-1-84.

ILHR 41.54 Multi-boiler installation. (1) HOT WATER HEATING BOILERS. When hot water heating boilers are installed in multiples with a common header and a common return, isolation valves may be eliminated between units and they may be considered one boiler provided:

- (a) No single unit exceeds 500,000 Btu per hour output;
- (b) Each unit has a pressure-relief device as required by the ASME code listed in Table 41.10-A or the common header has a pressure-relief device(s) with sufficient relieving capacity for all units in the installation;
- (c) Each unit has operating controls and safety controls acceptable to the department; and
- (d) The fuel supply to each unit is shut off by a low water cutoff in the event of low water in the system.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61; r. and recr. Register, May, 1978, No. 269, eff. 6-1-78.

ILHR 41.55 Pressure gauges for air receivers. (1) Air receivers shall be equipped with an indicating pressure gauge so located as to be readily visible.

- (2) The dial of the pressure gauge shall be graduated to approximately double the pressure at which the safety valve is set, but not less than one and one-half times that pressure.

History: Cr. Register, May, 1974, No. 221, eff. 6-1-74.

ILHR 41.56 Power piping. Power piping, as defined in s. ILHR 41.02 (13p), and boiler external piping within the scope of Section I of the ASME code listed in Table 41.10-A, shall be installed in accordance with the ANSI standard for power piping, including addenda, listed in Table 41.10-A. This section applies to new systems as well as all replacements, modifications and alterations to existing systems.

History: Cr. Register, September, 1978, No. 273, eff. 10-1-78; am. Register, February, 1984, No. 338, eff. 3-1-84.

ILHR 41.57 Organic fluid heat transfer systems. Boilers and coil type heaters which utilize organic thermal fluids as a heat transfer media shall be designed, constructed and installed in accordance with the ASME standards adopted under s. ILHR 41.10.

History: Cr. Register, February, 1984, No. 338, eff. 3-1-84.

PART VI
EXISTING INSTALLATIONS

ILHR 41.60 Application. (1) The provisions of ss. ILHR 41.60 through 41.99 shall apply to boilers installed prior to January 1, 1957.

(2) Pressure vessels installed prior to January 1, 1957 shall meet the requirements of s. ILHR 41.99, pressure relief devices for pressure vessels.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61; am. (2), Register, May, 1974, No. 221, eff. 6-1-74.

ILHR 41.61 Maximum allowable working pressures. (1) The maximum allowable working pressure on a boiler is the safe pressure at which the boiler may be operated as determined by the provisions of ss. ILHR 41.60 through 41.99, inclusive, of this code.

(2) No boiler shall be operated at a pressure in excess of the maximum allowable working pressure for such boiler.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61.

ILHR 41.62 Code constructed vessels. Any boiler that has been constructed and stamped in accordance with the rules and regulations of the ASME boiler and pressure vessel code, or other recognized codes, or has the standard stamping of another state that has adopted the standard of construction of the ASME boiler and pressure vessel code, shall be allowed and may be operated at the maximum working pressure stamped on its shell providing the vessel is unaltered, in good working order, and not deteriorated by age or corrosion. For unstamped boilers, the operating pressure shall be determined by using ss. ILHR 41.63 through 41.76, inclusive.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61.

ILHR 41.63 Pressure calculations for shells. The maximum allowable working pressure to be allowed on the shell of a boiler shall be determined from the following formula:

$$P = \frac{T.S. \times t \times E}{R \times F.S.}$$

where P = maximum allowable working pressure, pounds per square inch,

T.S. = tensile strength of shell plate, pounds per square inch,

t = minimum thickness of shell plates, inches,

E = efficiency of longitudinal joint—method of determining which is given in s. ILHR 41.73,

R = inside radius of the outside course of the shell,

F.S. = lowest factor of safety allowed by s. ILHR 41.70.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61.

ILHR 41.64 Pressure calculations for flat heads and flat surfaces. The maximum allowable working pressure on flat surfaces of boilers shall be determined by the following formula:

$$P = \frac{T.S. \times t^2}{0.5 \times d^2 \times F.S.}$$

Register, February, 1984, No. 338
Boiler and Pressure Vessel Code

ILHR 41

where P = maximum allowable working pressure, pounds per square inch,

T.S. = tensile strength of plate, pounds per square inch,

t = thickness of plate, inches,

d = diameter of head or shortest unsupported span of head or maximum pitch between stays, inches,

F.S. = lowest factor of safety allowed by s. ILHR 41.70.

Note: No allowance will be made for the holding power of flanges.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61.

ILHR 41.65 Pressure calculations for dished heads. The maximum allowable working pressure on unstayed dished heads shall be determined by the following formula:

Pressure on concave side (plus head)

$$P = \frac{2 \times T.S. \times E \times t}{8.33 \times L}$$

Pressure on convex side (minus head)

$$P = \frac{2 \times T.S. \times E \times t \times 0.6}{8.33 \times L}$$

where t = thickness of plate, inches,

P = maximum allowable working pressure, pounds per square inch,

T.S. = tensile strength, pounds per square inch,

L = radius to which the head is dished, measure on the concave side of the head, inches,

E = efficiency of weakest joint used in forming the head (exclusive of the joint to the shell); for seamless heads, E = 1.00.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61.

ILHR 41.66 Dished head restrictions. Dished heads without skirts or flanges shall not be used for any pressure.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61.

ILHR 41.67 Pressure calculation for furnaces and circular flues. The maximum allowable working pressure on furnaces of vertical boilers and circular flues shall be determined as indicated in ss. ILHR 41.50 and 41.51.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61.

ILHR 41.68 Boiler plate thickness. (1) The minimum thickness of any boiler plate under pressure shall be 1/4 inch except that boiler plate in stayed surfaces shall be 5/16 inch thick minimum.

(2) Seamless shells for miniature boilers may be constructed of 3/16 inch boiler plate.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61.

ILHR 41.69 Other methods of installing safety devices and other appliances. Where the ASME codes listed in s. ILHR 41.10 permit other

Register, February, 1984, No. 338
Boiler and Pressure Vessel Code

methods of installing safety devices and other appliances on boilers, these methods may be used on existing boilers.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61; am. Register, May, 1974, No. 221, eff. 6-1-74.

ILHR 41.70 Factor of safety. Maximum allowable working pressure shall be determined by using a factor of safety of at least 5 except as provided in s. ILHR 41.62.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61.

ILHR 41.71 Strength of materials. When the tensile strength of materials is not known, it shall be taken as 55,000 pounds per square inch for steel and 45,000 pounds per square inch for wrought iron, 30,000 pounds per square inch for copper and 10,000 pounds per square inch for cast iron. The resistance to crushing of mild steel shall be taken as 95,000 pounds per square inch of cross sectional area.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61; am. Register, February, 1984, No. 338, eff. 3-1-84.

ILHR 41.72 Shearing strength of rivets. (1) MAXIMUM PER SQUARE INCH. The maximum shearing strength of rivets per square inch of cross-sectional area shall be taken as follows:

	Ultimate strength Pounds per Square inch
Iron rivets in single shear	38,000
Iron rivets in double shear	76,000
Steel rivets in single shear	44,000
Steel rivets in double shear	88,000

(2) RIVET DIMENSIONS AFTER DRIVING. When the diameter of the rivet holes in the longitudinal joints of a boiler is not known, the diameter and cross-sectional area of rivets, after driving, shall be taken from Table 3.

Register, February, 1984, No. 338
Boiler and Pressure Vessel Code

ILHR 41

TABLE 3

Thickness of Plate	1/4" 0.25"	9/32" 0.2812"	5/16" 0.3125"	11/32" 0.34375"	3/8" 0.375"	3/8" 0.375"	13/32" 0.40625"
Diameter of Rivet after Driving	11/16"	11/16"	3/4"	3/4"	3/4" up to and including 2" pitch	13/16" Over 2" pitch	13/16"
Cross sectional area of rivet after driving	0.3712 sq. in.	0.3712 sq. in.	0.4418 sq. in.	0.4418 sq. in.	0.4418 sq. in.	0.5185 sq. in.	0.5185 sq. in.
Thickness of Plate	7/16" 0.4375"	7/16" 0.4375"	15/32" 0.46875"	1/2" 0.5"	9/16" 0.5625"	5/8" 0.625"	
Diameter of Rivet after Driving	7/8" up to and including 2-1/4" pitch	15/16" over 2-1/4" pitch	15/16"	15/16"	1-1/16"	1-1/16"	
Cross sectional area of rivet after driving	0.6013 sq. in.	0.6903 sq. in.	0.6903 sq. in.	0.6903 sq. in.	0.8866 sq. in.	0.8866 sq. in.	

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61; am. table, Register, February, 1982, No. 314, eff. 3-1-82.

ILHR 41.73 Efficiency of joint. The efficiency of a joint is the ratio which the strength of the joint bears to strength of the solid plate, and shall be determined as follows:

(1) For riveted joints, calculate according to ss. ILHR 41.50 and 41.51 using the values stated in ss. ILHR 41.71 and 41.72.

(2) For welded joints, calculate by reference to Table 4.

TABLE 4

MAXIMUM ALLOWABLE EFFICIENCIES FOR FUSION
WELDED JOINTS

Type of Joint	Limitations	Maximum Joint Efficiency (Per Cent)
Double-Welded Butt Joint	None	80
Single-Welded Butt Joint with Backing Strip	Longitudinal joints not over 1-1/4" thick. No thickness limitations on circumferential joints.	80
Single-Welded Butt Joint without Backing Strip	Circumferential joints only not over 5/8" thick.	70
Double-Welded Full-Fillet Lap Joint	Longitudinal joints not over 3/8" thick. Circumferential joints not over 5/8" thick.	60
Single-Welded Full-Fillet Joints with Plug Welds	Circumferential joints only not over 5/8" thick and for attachments of heads not over 24" outside diameter to shells not over 5/8" thick.	50
Single-Full Fillet Joint without Plug Welds	For attachments to heads convex to pressure to shell not over 5/8" thick, only with use of fillet weld on inside shell; for attachments to heads having pressure on either side, with fillet weld on outside of head flange only, to shells not over 24" inside diameter and not over 1/4" required thickness.	50
Forged Weld	None	70
Brazed Steel	None	80
Brazed Copper	None	90

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61.

ILHR 41.74 Ligament between parallel tube holes. When a shell or drum is drilled for tube holes in a line parallel to the axis of the shell or drum, the efficiency of the ligament between the tube holes shall be determined as shown in ss. ILHR 41.50 and 41.51.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61.

ILHR 41.75 Ligaments between diagonal tube holes. When a shell or drum is drilled for tube holes in a line diagonal with the axis of the shell or drum, the efficiency of the ligament between the tube holes shall be determined as shown in ss. ILHR 41.50 and 41.51.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61.

ILHR 41.76 Maximum pressure for cast iron boilers. (1) The maximum allowable working pressure on a steam boiler constructed wholly or principally of cast iron shall not exceed 15 pounds per square inch.

Register, February, 1984, No. 338
Boiler and Pressure Vessel Code

ILHR 41

(2) The maximum allowable working pressure on boilers, the tubes of which are secured to cast iron headers, shall not exceed 160 pounds per square inch.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61.

ILHR 41.77 Safety or relief valves required on boilers. Every boiler shall have one or more safety or relief valves set at or below the maximum allowable working pressure. On power boilers the remaining valves may be set at a higher pressure in accordance with s. ILHR 41.78.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61.

ILHR 41.78 Safety valves for low pressure steam, miniature and power boilers. (1) Every boiler shall be provided with safety valve capacity sufficient to discharge all the steam that can be generated without an increase over the maximum allowable working pressure or to which the valve is set, except a 6% increase while the valve is discharging for power and miniature boilers, and a 5 pound per square inch increase while the valve is discharging for low pressure steam boilers.

(2) The steam generating capacity of a boiler in pounds of steam per hour may be determined by one of the following:

(a) Manufacturer's maximum output rating.

(b) Pounds of steam

$$\text{per hour} = \frac{\text{Maximum Btu input per hour} \times 0.75}{1000}$$

(c) Actual evaporation test.

(d) For power boilers, heating boilers and miniature boilers, on the basis of boiler heating surface or waterwall heating surface as given in Table 5.

TABLE 5
MINIMUM POUNDS OF STEAM PER HOUR
PER SQUARE FOOT OF SURFACE¹

Surface	Firetube Boilers	Watertube Boilers
Boiler heating surface		
Hand-fired ²	5	6
Stoker-fired.....	7	8
Oil, gas, or pulverized fuel fired.....	8	10
Waterwall heating surface		
Hand-fired ²	8	8
Stoker-fired.....	10	12
Oil, gas, or pulverized fuel fired.....	14	16

1. The minimum safety valve or safety relief valve relieving capacity for electric boilers shall be 3½ lb/hr/kw input.

2. When a boiler is fired only by a gas having a heat value not in excess of 200 Btu/cu ft, the minimum safety valve or safety relief valve relieving capacity may be based on the values given for hand-fired boilers.

Register, February, 1984, No. 338
Boiler and Pressure Vessel Code

(3) On power boilers one of more safety valves on the boiler proper shall be set at or below the maximum allowable working pressure. The remaining valves may be set within a range of 3% above the maximum allowable working pressure, but the range of setting of all of the valves on a boiler shall not exceed 10% of the highest pressure to which any valve is set.

(4) Safety valves shall be constructed in accordance with the standards as specified in s. ILHR 41.50.

(5) When 2 or more safety valves are used on a boiler, they may be mounted either separately or as twin valves made by placing individual valves on Y-bases, or duplex, triplex, or multiplex valves having 2 or more valves in the same body casing. The valves shall be made of equal sizes, if possible, and in any event if not of the same size, the smaller of the 2 valves shall have a relieving capacity of at least 50% of that of the larger valve.

(6) The safety valve or valves shall be connected to the boiler independent of any other steam connection, and attached as close as practical to the boiler, without any unnecessary intervening pipe or fitting. Every safety valve shall be connected so as to stand in an upright position, with spindle vertical, when possible.

(7) The opening or connection between the boiler and the safety valve or valves shall have at least the area of the inlet of the valve or valves. No valve of any description shall be placed between the required safety valve or valves and the boiler, nor on the discharge pipe between the safety valve and the atmosphere. When a discharge pipe is used, the cross-sectional area shall be not less than the full area of the valve outlet or of the total of the areas of the valve outlets discharging thereinto, and shall be as short and straight as possible and so arranged to avoid undue stresses on the valve or valves.

(a) All safety-valve discharges shall be so located or piped as to be carried clear from running boards, platforms, or otherwise carried to a safe location.

(b) Provision for gravity drain shall be made in the discharge pipe, at or near each safety valve, and where water or condensation may collect.

(8) (a) The spring in a safety valve in service for pressures up to and including 250 pounds shall not be used for any pressure more than 10% above or 10% below that for which it was designed. For higher pressures, the spring shall not be used for any pressure more than 5% above or 5% below that for which it was designed.

(b) If the operating conditions of a valve are changed so as to require a new spring for a different pressure, the valve shall be adjusted by the manufacturer or their authorized representative who shall furnish and install a new name plate.

(9) Every superheater shall have one or more safety valves near the outlet. The discharge capacity of the safety valve or valves on an attached superheater may be included in determining the number and size of the safety valves for the boiler, provided there are no intervening valves between the superheater safety valve and the boiler, and provided the discharge capacity of the safety valve or valves on the boiler, as

distinct from the superheater, is at least 75% of the aggregate valve capacity required. A soot-blower connection may be attached to the same outlet from the superheater that is used for the safety valve connection.

(10) (a) Every boiler shall have outlet connections for the required safety valve or valves, independent of any other outside steam connection. The area of the boiler opening or openings shall be at least equal to the aggregate areas of inlet connections of all of the safety valves to be attached thereto. An internal collecting pipe, splash plate or pan may be used, provided the total area for inlet of steam thereto is not less than twice the aggregate areas of the inlet connections of the attached safety valves. The holes in such collection pipes shall be at least $\frac{1}{4}$ " in diameter and the least dimension in any other form of opening for inlet of steam shall be $\frac{1}{4}$ ".

(b) If safety valves are attached to a separate steam drum or dome, the opening between the boiler proper and the steam drum or dome shall be not less than required by par. (a).

(c) When boilers allowed different pressures are connected to a common steam main and all safety valves are not set at the lowest pressure allowed, no safety valve shall be set to exceed by more than 50% the lowest pressure allowed.

(d) For conditions exceeding those specified in par. (c), the case shall be referred to the department for decision.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61; am. (4) and (10) (d), Register, May, 1974, No. 221, eff. 6-1-74; am. (4), Register, February, 1982, No. 314, eff. 3-1-82; am. (2) (d) and r. and recr. Table 5, Register, February, 1984, No. 338, eff. 3-1-84.

ILHR 41.79 Water-relief valves for hot water boilers. (1) Each hot water boiler shall have one or more relief valves of the spring loaded type, without disk guides on the pressure side of the valve. The valves shall be set to relieve at a pressure at or below the maximum allowable working pressure of the boiler.

(2) Relief valves shall be constructed in accordance with the standards as specified in s. ILHR 41.50.

(3) Water-relief valves shall be attached directly or as close as possible to the boiler without any unnecessary intervening pipe or fitting. A water-relief valve shall not be connected to an internal pipe in the boiler. Water-relief valve shall be connected so as to stand upright with the spindle vertical when possible.

(4) No shut-off of any description shall be placed between the water-relief valve and the boiler, nor on discharge pipes between such valve and the atmosphere.

(5) When a discharge pipe is used its area shall be not less than the area of the valve or aggregate area based on the nominal diameters of the valves with which it connects. The discharge pipe shall be pitched away from the valve to prevent water from lodging in the upper part of the valve or in the pipe. The water-relief valve shall be so located and piped that there will be no danger of scalding attendants.

Register, February, 1984, No. 338
Boiler and Pressure Vessel Code

(6) The required water-relief valve capacity for any hot water boiler shall be equal to the maximum Btu output at the boiler nozzle or shall be equal to the boiler heating surface multiplied by 5000.

(7) The water-relief valve capacity for each hot water boiler shall be such that the valve or valves will relieve all the pressure that can be generated by the boiler without allowing the pressure to rise more than 3 pounds above the maximum allowable working pressure of the boiler.

(8) Every boiler shall have proper outlet connections for the required water-relief valves, independent of any other connection outside the boiler. The area of the opening or openings shall be at least equal to the aggregate area based on the nominal diameters of all of the water-relief valves with which it connects.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61; am. (2), Register, May, 1974, No. 221, eff. 6-1-74; am. (2), Register, February, 1982, No. 314, eff. 3-1-82.

ILHR 41.80 Thermometers for hot water boilers. Every hot-water boiler shall have a thermometer so located and connected that it shall be easily readable when observing the water pressure or altitude. The thermometer shall be so located that it shall at all times indicate the temperature in degrees Fahrenheit of the water in the boiler, at or near the outlet.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61.

ILHR 41.81 Water glass. Every low pressure steam, miniature and power boiler shall have at least one water glass, equipped with a valved drain, the lowest visible part of which shall be at or above the following location except that in all cases it shall be so placed as to give adequate protection to those parts of a boiler proper subject to the heat of the products of combustion:

(1) Horizontal return tubular boilers—not less than 4 inches above the upper surface of the upper row of tubes except when the distance between the uppermost surface of the tubes and the top of the steam space is 13 inches or less the distance may be reduced to 2 inches.

(2) Locomotive type boilers—3 inches above the highest part of the crown sheet.

(3) Vertical fire tube boilers—not less than $\frac{1}{2}$ the length of the tube above the lower tube sheets.

(4) Water tube boilers—as specified by the manufacturer.

(5) Scotch marine type boilers—3 inches above the combustion chamber top.

Note: For Dry Back, see sub. (1).

(6) Cast iron boilers—as specified by the manufacturer.

(7) Other types and designs—for other types and new designs the location shall be fixed by the manufacturer subject to approval by the department.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61; am. (7), Register, May, 1974, No. 221, eff. 6-1-74.

ILHR 41

ILHR 41.82 Gage cocks. (1) Every steam boiler, except those exempted below, shall have 3 gage cocks located within the range of the visible portion of the water glass.

(2) The following boilers shall not be required to have gage cocks:

- (a) Boilers which do not have a definite water level.
- (b) Boilers which have 2 water glasses spaced not less than 2 feet apart on the same horizontal line.
- (c) Boilers which have 2 remote water level indicators in addition to the required water glass.
- (d) Miniature boilers.

(3) The following boilers shall be required to have only 2 gage cocks:

- (a) Low pressure steam boilers.
- (b) Locomotive type boilers not over 36 inches in diameter.
- (c) Firebox or water leg boilers in which the water heating surface does not exceed 50 square feet.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61.

ILHR 41.83 Water column piping. (1) No connections shall be placed on pipes connecting the water column to the boiler except connections for damper regulator, feed water regulator, steam gage or drains.

(2) The minimum size of the pipes connecting the water column to a boiler shall be 1 inch. Water-glass fittings or gage cocks may be connected directly to the boiler.

(3) The water connections to the water column of a boiler, when practicable, shall be provided with a cross at each right-angle turn to facilitate cleaning. The water column shall be fitted with a drain cock or drain valve with a suitable connection to the ashpit or other safe point of waste, and if the water connection thereto has a rising bend or pocket which cannot be drained by means of the water column drain, an additional drain shall be placed in this connection in order that it may be blown off to clear any sediment from the pipe.

(4) The steam connection to the water column of a horizontal-return tubular boiler shall be taken from the top of the shell or the upper part of the head; the water connection shall be taken from the front head at a point not less than 6 inches below the center line of the shell. For the firebox types of boilers, the water connection to the water column shall be taken at a point not less than 6 inches below the lowest water line or as near thereto as possible, and in no case less than 18 inches above the mud ring.

(5) When shut-offs are used on the connections to a water column, they shall be either outside-screw-and-yoke type valves or stop cocks with levers permanently fastened thereto and marked in line with their passage. Where stop cocks are used they shall be of a type with the plug held in place by a guard or gland.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61.

Register, February, 1984, No. 338
Boiler and Pressure Vessel Code

ILHR 41.84 Pressure gages. (1) (a) Every boiler shall be provided with a pressure gage connected to the upper part of the boiler and so arranged that the gage cannot be shut off from the boiler except that a shut-off valve or cock shall be placed close to the gage or a second shut-off valve or cock close to the boiler to permit removal for testing while the boiler is in operation.

(b) For steam boilers, the gage may also be connected to the water column or water column steam connection. For steam boilers, a siphon or equivalent device of sufficient capacity to keep the gage tube filled with water shall be provided.

(2) The dial of the pressure gage shall be graduated to at least one and one-half times the pressure at which the safety or relief valve is set except as follows:

(a) On low pressure steam boilers the gage shall be graduated to at least 30 pounds per square inch.

(b) On hot water boilers the pressure or altitude gage shall be graduated to at least one and one-half times the maximum allowable working pressure.

(3) (a) For low pressure steam boilers, the travel of the pointer from zero to 30 pounds per square inch shall be at least 4 inches.

(b) Effective stops shall be provided for the indicating pointer at the lowest and highest pressure points.

(4) The pressure gage dial shall at all times be protected by a transparent cover and shall be kept clear at all times. This gage should be so located as to be readily visible to the operator.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61.

ILHR 41.85 Stop valves on pressure discharge outlets. (1) Each pressure discharge outlet on miniature and power boilers, except safety or relief valve outlets, shall be fitted with one or more stop valves located as near to the boiler as practicable. When 2 or more low pressure steam boilers are connected to a common header, a stop valve shall be provided in the steam outlet of each boiler as near to the boiler as practicable.

(2) When 2 stop valves are placed in the steam connection between a power boiler and the steam main there shall be a free blow drain between them. The discharge of this drain valve shall be visible to the operator while manipulating the valve.

(3) (a) When a stop valve is so located that water can accumulate, drains shall be provided.

(b) Each dry pipe or similar apparatus shall have two holes drilled into it. These holes shall be not less than $\frac{1}{2}$ " diameter each and shall be kept open so that the condensation can escape.

(4) Each superheater shall be equipped with at least one drain so located as will most effectively provide for the proper operation of the apparatus.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61.

Register, February, 1984, No. 338
Boiler and Pressure Vessel Code

ILHR 41

ILHR 41.86 Steam mains. Provision shall be made for the expansion and contraction of steam mains connected to boilers by providing substantial anchorage at suitable points so that there shall be no undue strain transmitted to the boiler. Steam reservoirs shall be used on steam mains when heavy pulsations of the steam currents cause vibration of the boiler shell plates.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61.

ILHR 41.87 Bottom blow-off or drain. (1) Connected to the lowest space practicable of each boiler, there shall be a bottom blow-off pipe fitted with a valve or cock. The valves shall be of straightway or angle construction and cocks shall have the plugs held in place with a gland or guard. Straightway globe valves of the ordinary type or valves of such type that dams or pockets can exist for the collection of sediment, shall not be used on such connections.

(2) A surface blow-off shall not exceed 2½ inch pipe size and the internal and external pipes, when used, shall form a continuous passage, but with clearance between their ends and arranged so that the removal of either will not disturb the other. A properly designed steel bushing or a flanged connection shall be used.

(3) (a) Each boiler shall have a bottom blow-off pipe, fitted with a valve or cock, in direct connection with the lowest water space practicable. The maximum size of pipe and fittings shall be 2½ inches and the minimum size shall be 1 inch except that for boilers with 100 square feet of water heating surface or less and low pressure steam boilers the minimum size of pipe and fittings may be ¾ inch. Straightway globe valves of the ordinary type or valves of such type that dams or pockets can exist for the collection of sediment, shall not be used on such connections.

(b) The bottom blow-off pipe for low pressure steam, miniature, and hot water boilers may be connected to return connections which are the same size or larger than the size herein specified. In such case, the blow-off shall be so located that the connection may be completely drained.

(4) A bottom blow-off cock shall have the plug held in place by a guard or gland. The end of the plug shall be distinctly marked in line with the passage.

(5) (a) For power boilers, the bottom blow-off pipe or pipes shall be of wrought iron or steel and shall be at least extra heavy.

(b) The fittings between a power boiler and the required bottom blow-off valve or valves shall be of steel, cast steel or malleable iron and shall be not less than extra heavy construction for pressures not exceeding 150 pounds per square inch.

(c) For pressures exceeding 150 pounds per square inch such fitting shall be of steel construction and not less than extra heavy.

(d) Cast iron pipe and fittings shall not be used in the bottom blow-off pipe between the boiler and the bottom blow-off valve or valves.

(6) (a) On all boilers except those used for traction and portable purposes, when the maximum allowable working pressure exceeds 125 pounds per square inch, each bottom blow-off pipe shall have 2 slow-

opening valves, or one slow-opening valve and a cock, and such valves, or valve and cock, shall be at least extra heavy construction. On a boiler having multiple blow-off pipes a single master valve may be placed on the common blow-off pipe from the boiler, in which case only one valve on each individual blow-off is required. Two independent valves, or a valve and a cock may be combined in one body provided the combined fitting is the equivalent of 2 independent valves, or a valve and a cock, so that the failure of one to operate could not affect the operation of the other.

(b) Every traction and portable boiler shall have a bottom blow-off valve; when the maximum allowable working pressure exceeds 125 pounds per square inch, the blow-off valve shall be at least extra heavy.

(c) For pressures exceeding 200 pounds per square inch the valves or cocks shall be of steel construction.

(d) The blow-off valve or valves shall be the full size of the blow-off pipe.

(7) A bottom blow-off pipe when exposed to direct furnace heat shall be protected by fire brick or other heat resisting material so arranged that the pipe may be inspected.

(8) An opening in the boiler setting for a blow-off pipe shall be arranged to provide for free expansion and contraction.

(9) See s. ILHR 41.11 for required boiler blow-down equipment.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61.


ILHR 41.88 Feed pipe. (1) (a) Each low pressure steam, miniature and power boiler shall have the feed pipe fitted with a check valve near the boiler and a stop valve between the check valve and the boiler. Single low pressure steam boiler installations of the gravity return type which do not have a stop valve in the steam outlet line will not be required to have a stop valve in the return pipe.

(b) On low pressure steam boilers, the return pipe loop connection shown in Fig. 1 may be used in place of the check valve.

(2) (a) The feed water shall be introduced into a boiler in such a manner that the water will not be discharged directly against surfaces exposed to gases of high temperature, or to direct radiation from the fire, or close to riveted joints of shell or furnace sheets.

(b) Where horizontal return tubular boilers are fed through the front, a boiler bushing or its equivalent shall be used and the feed water shall discharge at about three-fifths the length of the boiler from the front head, and above the second row of tubes from the top.

Fig. 1
 RETURN PIPE LOOP CONNECTION

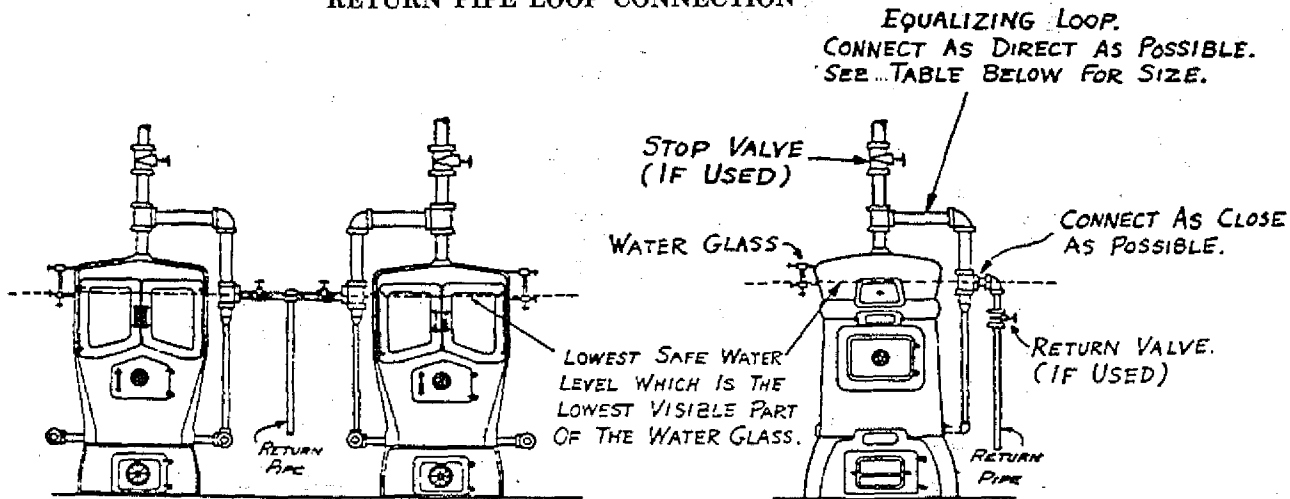

<u>GRATE AREA, OR</u> <u>Sq. Ft.</u>	<u>SAFETY VALVE</u> <u>CAP. LBS/HR</u>	<u>EQUALIZING LOOP</u> <u>SIZE, INCHES</u>
4 OR LESS	250 OR LESS	1 1/2
OVER 4 TO 15	251 TO 2000 Inc.	2 1/2
OVER 15	OVER 2000	4

(3) When 2 or more power boilers are fed from a common source, there shall be a globe or regulating valve on the branch to each boiler, between the check valve and the source of supply. When 2 or more low pressure steam boilers, using a gravity return system are fed from a common source, one check valve may be placed on the main return pipe with a stop valve on the branch return to each boiler. Wherever globe valves are used on feed piping, the inlet shall be under the disk of the valve.

(4) (a) Means shall be provided for feeding a boiler against the maximum allowable working pressure or the pressure at which the safety valve is set to blow.

(b) Where a source of feed is available at a sufficient pressure to feed the boiler against a pressure 6% higher than that at which the safety valve is set to blow, this may be considered one of the means.

(5) Every boiler and its piping system shall be provided with a water supply line from an outside source of water supply in order to replace the water leaving the system through leakage, process work, or other reasons.

(a) A stop and check valve shall be provided in the water supply line with the stop valve closest to the boiler.

(b) On low pressure steam and hot water boilers, the water supply line shall be connected to the boiler return or feed piping system and not directly to the boiler.

(c) On low pressure steam, miniature, and hot water boilers, the water supply line pressure shall be high enough to feed the boiler or the system against the maximum allowable working pressure of the boiler.

(6) A heater for oil or other liquid harmful to boiler operation shall not be installed directly in the steam or water space within a boiler. Where an external type heater for such service is used, positive means such as double-transfer heaters or indicators such as fuel-oil indicators or sight glasses shall be provided to prevent the introduction into the boiler of oil or other liquid harmful to boiler operation.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61.

ILHR 41.89 Combustion regulators for boilers. (1) A temperature combustion regulator, which will control the rate of combustion to prevent the temperature of the water from rising above 250° F. at or near the outlet, or a thermostatic device which will relieve the pressure on the boiler when the temperature exceeds 250° F. shall be used on all hot water boilers.

(2) When a pressure combustion regulator is used on a steam boiler, it shall operate to prevent the steam pressure from rising above the maximum allowable working pressure for the boiler.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61.

ILHR 41.91 Washout and inspection openings. (1) All boilers shall be provided with suitable manhole or handhole openings, except special types where they are manifestly not needed or used.

(2) All horizontal fire tube boilers shall be required to have the following manhole or handhole openings:

(a) A manhole in the front head below the tubes for:

1. Horizontal return tubular power boilers over 54 inches in diameter.
2. Horizontal return tubular low pressure steam or hot water boilers over 60 inches in diameter.
3. For smaller boilers a handhole may be used in place of the manhole.

(b) A manhole in the upper part of the shell or head for:

1. Horizontal return tubular, fire box and locomotive power boilers over 48 inches.
2. Scotch marine power boilers over 54 inches in diameter.
3. Low pressure steam boilers over 60 inches in diameter.
4. For smaller boilers a handhole may be used in place of the manhole.

(c) Locomotive and fire box boilers shall also have the following handhole or washout openings:

1. One at each of the 4 corners of the lower portion of the water leg.
2. One in the front head at or about the line of the crown sheet.
3. One near the throat sheet of power boilers where possible.
4. One in the rear head of power boilers below the tubes.

(3) (a) A vertical fire tube boiler, except boilers 24 inches or less in diameter shall have not less than 4 handholes located as follows: 2 in the shell at or about the line of the crown sheet or lower tube sheet; 2 in the shell at the lower part of the water leg.

(b) Vertical fire tube boilers 24 inches or less in diameter shall have 3 one-inch diameter washout plugs except that boilers not exceeding 12 inches internal diameter having less than 10 square feet of water heating surface need not have more than 2 such washout plugs, one of which may be used for the attachment of the bottom blow-off valve. The threads of the washout plugs shall be of non-ferrous material.

(4) Where handholes are provided, such handholes shall not be less than 2½ inches by 3½ inches in size.

(5) Washout plugs, except for vertical fire tube boilers, shall be not less than 1½ inch pipe size and shall have threads of non-ferrous materials.

(6) Every cast iron boiler shall be provided with washout openings to permit the removal of any sediment that may accumulate therein. Washout openings may be used for return pipe connection if the washout plug is placed in a tee so that the plug is directly opposite and as close as possible to the opening in the boiler.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61.

ILHR 41.92 Manholes. Where manholes are provided, such manholes shall be not less than 11 inches by 15 inches, or 10 inches by 16 inches in

Register, February, 1984, No. 338
Boiler and Pressure Vessel Code

size. A circular manhole opening shall be not less than 15 inches in diameter.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61.

ILHR 41.94 Threaded openings. (1) All pipe threads shall conform to the American Pipe Thread standard and all connections one inch pipe size or over shall have not less than the number of threads given in Table 6. For smaller pipe connections there shall be at least 4 threads in the opening.

(2) If the thickness of the shell of the boiler is not sufficient to give such number of threads a construction shall be employed which will provide at least the required number of threads.

TABLE 6
MINIMUM NUMBER OF PIPE THREADS FOR CONNECTIONS
TO BOILERS

Size of pipe connections, inches	1 & 1½	1½ & 2	2½ to 4 incl	4½ to 6 incl	7 & 8	9 & 10	12
Number of threads, per inch	11½	11½	8	8	8	8	8
Minimum number of threads required for opening	4	5	7	8	10	12	13
Minimum thickness of material required to give above number of threads, inches.....	0.348	0.435	0.875	1	1.25	1.5	1.6265

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61.

ILHR 41.95 Boiler setting and installation. (1) A horizontal return tubular boiler over 72 inches in diameter shall be supported from steel hangers by the outside suspension type of setting, independent of the boiler side walls. The hangers shall be so designed that the load is properly distributed between the rivets attaching them to the shell and so that no more than 2 of these rivets come in the same longitudinal line on each hanger. The distance girthwise of the boiler from the centers of the bottom rivets to the center of the top rivets attaching the hangers shall be not less than 12 inches. The other rivets used shall be spaced evenly between these points. If more than 4 hangers are used they shall be set in 4 pairs.

(2) A horizontal return tubular boiler over 54 inches and up to and including 72 inches in diameter, shall be supported by the outside suspension type of setting, or at 4 points by not less than 8 steel or cast iron brackets, set in pairs. A horizontal return tubular boiler up to and including 54 inches in diameter shall be supported by the outside suspension type of setting, or by not less than 2 steel or cast iron brackets on each side.

(3) Lugs or hangers, when used to support a boiler of any type shall be properly fitted to the surfaces to which they are attached. If riveted, the shearing and crushing stresses on the rivets used for attaching the lugs or hangers shall not exceed 8% of the strength given in s. ILHR 41.72.

ILHR 41

Where it is impractical to use rivets, studs with not less than 10 threads per inch may be used. In computing the shearing stress, the area at the bottom of the thread shall be used. Strength welding may be used, if done in accordance with ss. ILHR 41.50 and 41.51.

(4) Wet bottom stationary boilers shall have a space of not less than 12 inches between the bottom of the boiler and the floor line, with access for inspection.

(5) The upper surface of the fire grate of an internally fired boiler of the open bottom locomotive, vertical fire tube or similar type, shall not be below the water space in the water leg, except where the rivets at the bottom of the water leg are protected from the action of the fire and products of combustion.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61.

ILHR 41.96 Access and firing doors. The minimum size of an access door to be placed in a boiler setting shall be 12 inches by 16 inches or equivalent area, 11 inches to be the least dimension in any case.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61.

ILHR 41.97 Water tube boiler doors. A water tube boiler shall have the firing doors, furnace inspection doors and clinker doors of the inward opening type, unless such doors are provided with latching or fastening devices or otherwise so constructed as to prevent them, when closed, from being blown open by pressure on the furnace side.

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61.

ILHR 41.99 Pressure relief devices required for unfired pressure vessels.

(1) Every unfired pressure vessel shall be provided with or protected by a pressure relief device set to relieve at or below the maximum allowable working pressure of the vessel.

(2) The relieving capacity of the pressure relief device shall be equal to or greater than the input to the vessel or shall be great enough to prevent the pressure in the vessel from rising more than 10% above the maximum allowable working pressure of the vessel.

(3) Safety valves and safety relief valves shall be constructed in accordance with the standards as specified in s. ILHR 41.50.

(4) Rupture disks may be used in lieu of safety valves on vessels containing substances that may render a safety valve inoperative, or where a loss of valuable material by leakage should be avoided, or contamination of the atmosphere by leakage of noxious gases must be avoided. Such rupture disks shall be tested, marked, and installed in accordance with the ASME codes listed in s. ILHR 41.10.

(5) When hot water supply is heated indirectly by steam in a coil or pipe a water relief valve of at least one inch in diameter, set to relieve at or below the maximum allowable working pressure of the tank shall be used.

(6) Each safety or relief valve shall have a full size direct connection to the pressure vessel. When an escape pipe is used it shall be full sized and fitted with an open drain, to prevent water lodging in the upper part of the safety or relief valve or escape pipe. When a pressure vessel is fitted

with 2 safety or relief valves on one connection, this connection to the pressure vessel shall have a cross-sectional area equal to or greater than the combined area of the 2 safety or relief valves. No valve of any description shall be placed between the safety or relief valve and the pressure vessel, nor on the escape pipe between the safety or relief valve and the atmosphere.

(7) When an elbow is placed on a safety or relief valve escape pipe it shall be located close to the safety or relief valve outlet, or the escape pipe shall be securely anchored and supported.

(8) When the capacity of the safety valve on an existing tank for containing gases is not known, the relieving capacity of such safety valve shall be determined from Table 7. Such safety valves shall not exceed 4 inches in diameter.

TABLE 7
MAXIMUM FREE AIR SUPPLIED IN CUBIC FEET PER MINUTE FOR
DIFFERENT SIZES OF SAFETY VALVES AT STATED PRESSURES

Diameter of Valve (inches)	Gage pressure, pounds							
	50	100	150	200	250	300	350	400
1/4								53
1/2	20	32	42	51	59	67	74	111
3/4	37	59	78	96	112	127	141	176
1	58	94	124	152	178	202	224	248
1-1/4	84	135	180	221	259	293	325	
1-1/2	114	186	248	302	354	400	444	
2	189	306	410	501	592	668	741	
2-1/2	282	457	613	750	880	998	1114	
3	393	638	856	1050	1230	1398	1557	

Diameter of Valve (inches)	Gage pressure, pounds							
	500	600	800	1000	1200	1600	2000	2400
1/4	61	70	84	97	109	128	147	167
1/2	129	147	177	205	230	270	304	330
3/4	224	232	242	346	386	423	474	518
1	286	324	390	450	500	586		
1-1/4	374		509					
1-1/2	472		634					
2								
2-1/2								
3								

History: Cr. Register, April, 1961, No. 64, eff. 5-1-61; am. (3) and (4), Register, May, 1974, No. 221, eff. 6-1-74; am. (3), Register, February, 1982, No. 314, eff. 3-1-82.