

before the filing date as required by the federal regulations. In addition to this annual report and at the same time, the operators shall report the number of leaks which were found in customer owned facilities by either a survey or complaint during the preceding calendar year.

History: Cr. Register, May, 1972, No. 197, eff. 6-1-72.

**PSC 135.07 Over-pressure protection.** Over-pressure protection is required by subsection 192.197 of this chapter and shall apply to all installations. All present installations where such protection is not provided shall be changed so that 100% compliance will be attained by the end of the first testing cycle after January 1, 1968 as provided in s. PSC 134.30.

History: Cr. Register, May, 1972, No. 197, eff. 6-1-72.

**PSC 135.09 Adoption of federal minimum safety standards.** (1) The federal department of transportation, office of pipeline safety, pursuant to the Natural Gas Pipeline Safety Act of 1968 (49 U.S.C. 1675,—et seq.) has established minimum safety standards for pipeline facilities and the transportation of gas, as set forth in part 192 and part 193 in title 49, Code of Federal Regulations. In accordance with the Natural Gas Pipeline Safety Act of 1968 and requirements of the federal department of transportation, such minimum safety standards are hereby adopted as state safety standards. (The numbering system and sequence used in said minimum safety standards are herein used for convenience and clarity.) Additions have been made to the minimum safety standards of the federal department of transportation as adopted herein and follow the section of the adopted federal standards to which the additions directly relate or if the additions do not directly relate to any particular adopted federal standard the additions are inserted in the numbering sequence within the appropriate subpart. In all cases the additions appear in italics preceded by *PSC 192* plus the appropriate section number. Copies of the publications referred to are available for inspection at the office of the public service commission, the secretary of state and the revisor of statutes or may be procured for personal use from the addresses listed in Appendix A—Incorporated by Reference, I. Lists of organizations and addresses, which follows section *PSC 192.753*.

(2) All gas utilities shall file with the commission a copy of the operating and maintenance plans which are required by section PSC 135.09 -- 192.603. Each change in such plans shall be filed with this commission within 20 days after the change is made.

#### WISCONSIN CODE ADOPTION OF PART 192 IN TITLE 49 CODE OF FEDERAL REGULATIONS WITH ADDITIONS

Sec.		Sec.	
Subpart A—General		*192.55	Steel pipe.
192.1	Scope of part.	*192.57	Cast iron or ductile iron pipe.
192.3	Definitions.	*192.59	Plastic pipe.
192.5	Class locations.	192.61	Copper pipe.
192.7	Incorporation by reference.	192.63	Marking of materials.
192.9	Gathering lines.	192.65	Transportation of pipe.
192.11	Petroleum gas systems.		
192.13	General.	Subpart C—Pipe Design	
192.14	Conversion to service subject to this part.	192.101	Scope.
192.15	Rules of regulatory construction.	192.103	General.
		192.105	Design formula for steel pipe.
Subpart B—Materials		192.107	Yield strength ( <i>S</i> ) for steel pipe.
192.51	Scope.	192.109	Nominal wall thickness ( <i>t</i> ) for steel pipe.
*192.53	General.	192.111	Design factor ( <i>F</i> ) for steel pipe.

Register, January, 1985, No. 349

## PSC 135

192.113	Longitudinal joint factor ( <i>E</i> ) for steel pipe.	Subpart E—Welding of Steel in Pipelines
192.115	Temperature derating factor ( <i>T</i> ) for steel pipe.	192.221 Scope.
192.117	Design of cast iron pipe.	*192.223 General.
192.119	Design of ductile iron pipe.	192.225 Qualifications of welding procedures.
192.121	Design of plastic pipe.	192.227 Qualification of welders.
192.123	Design limitations for plastic pipe.	192.229 Limitations on welders.
*192.125	Design of copper pipe.	192.231 Protection from weather.
		192.233 Miter joints.
		192.235 Preparation for welding.
		192.237 Preheating.
		192.239 Stress relieving.
		192.241 Inspection and test of welds.
		*192.243 Nondestructive testing.
		192.245 Repair or removal of defects.
		*192.246 <i>Precautions to avoid explosions of gas-air mixtures or uncontrolled fires during construction operations.</i>
Subpart D—Design of Pipeline Components		Subpart F—Joining of Materials Other Than by Welding
192.141	Scope.	192.271 Scope.
192.143	General requirements.	192.273 General.
192.144	Qualifying metallic components.	192.275 Cast iron pipe.
192.145	Valves.	192.277 Ductile iron pipe.
192.147	Flanges and flange accessories.	*192.279 Copper pipe.
192.149	Standard fittings.	*192.281 Plastic pipe.
192.151	Tapping.	192.283 Plastic pipe; qualifying joining procedures.
192.153	Components fabricated by welding.	192.285 Plastic pipe; qualifying persons to make joints.
192.155	Welded branch connections.	192.287 Plastic pipe; inspection of joints.
192.157	Extruded outlets.	Subpart G—General Construction Requirements for Transmission Lines and Mains
192.159	Flexibility.	192.301 Scope.
192.161	Supports and anchors.	192.303 Compliance with specifications or standards.
*192.163	Compressor stations: design and construction.	192.305 Inspection: general.
192.165	Compressor stations: liquid removal.	*192.307 Inspection of materials.
192.167	Compressor stations: emergency shutdown.	*192.309 Repair of steel pipe.
192.169	Compressor stations: pressure limiting devices.	192.311 Repair of plastic pipe.
*192.171	Compressor stations: additional safety equipment.	*192.313 Bends and elbows.
*192.173	Compressor stations: ventilation.	192.315 Wrinkle bends in steel pipe.
192.175	Pipe-type and bottle-type holders.	192.317 Protection from hazards.
192.177	Additional provisions for bottle-type holders.	*192.319 Installation of pipe in a ditch.
192.179	Transmission line valves.	*192.321 Installation of plastic pipe.
*192.181	Distribution line valves.	*192.323 Casing.
*192.183	Vaults: structural design requirements.	*192.325 Underground clearance.
192.185	Vaults: accessibility.	192.327 Cover.
*192.187	Vaults: sealing, venting, and ventilation.	Subpart H—Customer Meters, Service Regulators, and Service Lines
*192.189	Vaults: drainage and waterproofing.	192.351 Scope.
192.191	Design pressure of plastic fittings.	*192.353 Customer meters and regulators: location.
192.193	Valve installation in plastic pipe.	*192.355 Customer meters and regulators: protection from damage.
*192.195	Protection against accidental over-pressuring.	192.357 Customer meters and regulators: installation.
*192.197	Control of the pressure of gas delivered from high-pressure distribution systems.	192.359 Customer meter installations: operating pressure.
*192.199	Requirements for design of pressure relief and limiting devices.	192.361 Service lines: installation.
192.201	Required capacity of pressure relieving and limiting stations.	
192.203	Instrument, control, and sampling pipe and components.	
*192.204	<i>Pipelines on private right-of-way of electric transmission lines.</i>	

## Subpart C—Pipe Design

## 192.101 Scope.

This subpart prescribes the minimum requirements for the design of pipe.

## 192.103 General.

Pipe must be designed with sufficient wall thickness, or must be installed with adequate protection, to withstand anticipated external pressures and loads that will be imposed on the pipe after installation.

## 192.105 Design formula for steel pipe.

(a) The design pressure for steel pipe is determined in accordance with the following formula:

$$P = \frac{2St}{D} \times F \times E \times T$$

$P$  = Design pressure in pounds per square inch gage.

$S$  = Yield strength in pounds per square inch determined in accordance with 192.107.

$D$  = Nominal outside diameter of the pipe in inches.

$t$  = Nominal wall thickness of the pipe in inches. If this is unknown, it is determined in accordance with 192.109. Additional wall thickness required for concurrent external loads in accordance with 192.103 may not be included in computing design pressure.

$F$  = Design factor determined in accordance with 192.111.

$E$  = Longitudinal joint factor determined in accordance with 192.113.

$T$  = Temperature derating factor determined in accordance with 192.115.

(b) If steel pipe that has been subjected to cold expansion to meet the SMYS is subsequently heated, other than by welding or stress relieving as a part of welding, the design pressure is limited to 75 percent of the pressure determined under paragraph (a) of this section if the temperature of the pipe exceeds 900°F (482°C) at any time or is held above 600°F (316°C) for more than 1 hour.

192.107 Yield strength ( $S$ ) for steel pipe.

(a) For pipe that is manufactured in accordance with a specification listed in section I of Appendix B of this part, the yield strength to be used in the design formula in 192.105 is the SMYS stated in the listed specification, if that value is known.

(b) For pipe that is manufactured in accordance with a specification not listed in section I of Appendix B to this part or whose specification or tensile properties are unknown, the yield strength to be used in the design formula in 192.105 is one of the following:

(1) If the pipe is tensile tested in accordance with section IID of Appendix B to this part, the lower of the following:

(i) 80 percent of the average yield strength determined by the tensile tests.

(ii) The lowest yield strength determined by the tensile tests, but not more than 52,000 p.s.i.

(2) If the pipe is not tensile tested as provided in subparagraph (1) of this paragraph 24,000 p.s.i.

**192.109 Nominal wall thickness (*t*) for steel pipe.**

(a) If the nominal wall thickness for steel pipe is not known, it is determined by measuring the thickness of each piece of pipe at quarter points on one end.

(b) However, if the pipe is of uniform grade, size, and thickness and there are more than 10 lengths, only 10 percent of the individual lengths, but not less than 10 lengths, need be measured. The thickness of the lengths that are not measured must be verified by applying a gage set to the minimum thickness found by the measurement. The nominal wall thickness to be used in the design formula in 192.105 is the next wall thickness found in commercial specifications that is below the average of all the measurements taken. However, the nominal wall thickness used may not be more than 1.14 times the smallest measurement taken on pipe less than 20 inches in outside diameter, nor more than 1.11 times the smallest measurement taken on pipe 20 inches or more in outside diameter.

**192.111 Design factor (*F*) for steel pipe.**

(a) Except as otherwise provided in paragraphs (b), (c), and (d) of this section, the design factor to be used in the design formula in 192.105 is determined in accordance with the following table:

<i>Class location</i>	<i>Design factor (F)</i>
1.....	0.72
2.....	0.60
3.....	0.50
4.....	0.40

(b) A design factor of 0.60 or less must be used in the design formula in 192.105 for steel pipe in Class 1 locations that:

(1) Crosses the right-of-way of an unimproved public road, without a casing;

(2) Crosses without a casing, or makes a parallel encroachment on, the right-of-way of either a hard surfaced road, a highway, a public street, or a railroad;

(3) Is supported by a vehicular, pedestrian, railroad, or pipeline bridge; or

(4) Is used in a fabricated assembly, (including separators, mainline valve assemblies, cross-connections, and river crossing headers) or is used within five pipe diameters in any direction from the last fitting of a fabricated assembly, other than a transition piece or an elbow used in place of a pipe bend which is not associated with a fabricated assembly.

(c) For Class 2 locations, a design factor of 0.50, or less, must be used in the design formula in 192.105 for uncased steel pipe that crosses the right-of-way of a hard surfaced road, a highway, a public street, or a railroad.

(d) For Class 1 and Class 2 locations, a design factor of 0.50, or less, must be used in the design formula in H 192.105 for—

(1) Steel pipe in a compressor station, regulating station, or measuring station; and

(2) Steel pipe, including a pipe riser, on a platform located offshore or in inland navigable waters.

#### 192.113 Longitudinal joint factor (E) for steel pipe.

The longitudinal joint factor to be used in the design formula in s. 192.105 is determined in accordance with the following table:

Specification	Pipe class	Longitudinal joint factor (E)
ASTM A 53	Seamless.....	1.00
	Electric resistance welded.....	1.00
	Furnace butt welded.....	.60
ASTM A 106	Seamless.....	1.00
ASTM A 134	Electric fusion arc welded.....	.80
ASTM A 135	Electric resistance welded.....	1.00
ASTM A 139	Electric fusion welded.....	.80
ASTM A 211	Spiral welded steel pipe.....	.80
ASTM A 333	Seamless.....	1.00
	Electric resistance welded.....	1.00
ASTM A 381	Double submerged arc welded.....	1.00
ASTM A 671	Electric-fusion-welded.....	1.00
ASTM A 672	Electric-fusion-welded.....	1.00
ASTM A 691	Electric-fusion-welded.....	1.00
API 5 L	Seamless.....	1.00
	Electric resistance welded.....	1.00
	Electric flash welded.....	1.00
	Submerged arc welded.....	1.00
	Furnace butt welded.....	.60
API 5 LX	Seamless.....	1.00
	Electric resistance welded.....	1.00
	Electric flash welded.....	1.00
	Submerged arc welded.....	1.00
API 5 LS	Electric resistance welded.....	1.00
	Submerged arc welded.....	1.00
Other	Pipe over 4 inches.....	.80
Other	Pipe 4 inches or less.....	.60

If the type of longitudinal joint cannot be determined, the joint factor to be used must not exceed that designated for "Other".

#### 192.115 Temperature derating factor (T) for steel pipe.

The temperature derating factor to be used in the design formula in 192.105 is determined as follows:

PSC 135

Gas temperature in degrees Fahrenheit	Temperature derating factor (T)
250 or less -----	1.000
300 -----	0.967
350 -----	0.933
400 -----	0.900
450 -----	0.867

For intermediate gas temperatures, the derating factor is determined by interpolation.

#### 192.117 Design of cast iron pipe.

Cast iron pipe must be designed in accordance with ANSI C101-67.

#### 192.119 Design of ductile iron pipe.

(a) Ductile iron pipe must be designed in accordance with ANSI A21.50 using the following values in the design equations:

$s$  (design hoop stress) = 16,800 p.s.i.

$f$  (design bending stress) = 36,000 p.s.i.

(b) Ductile iron pipe must be grade (60-42-10) and must conform to the requirements of ANSI A21.52.

#### 192.121 Design of plastic pipe.

The design pressure for plastic pipe is determined in accordance with the following formula, subject to the limitations of s. 192.123:

$$P = 2S \frac{t}{(D-t)} \times 0.32$$

$P$  = Design pressure, gage, kPa (psi).

$S$  = For thermoplastic pipe the long-term hydrostatic strength determined in accordance with the listed specification at a temperature equal to 23° C (73° F), 38° C (100° F), 49° C (120° F), or 60° C (140° F); for reinforced thermosetting plastic pipe, 75,800 kPa (11,000 psi).

$t$  = Specified wall thickness, mm (in.).

$D$  = Specified outside diameter, mm (in.).

#### 192.123 Design limitation for plastic pipe.

(a) The design pressure may not exceed 689 kPa (100 p.s.i.g.) for plastic pipe used in—

- (1) Distribution systems; or
- (2) Classes 3 and 4 locations.

(b) Plastic pipe may not be used where operating temperatures of the pipe will be—

- (1) Below minus 29° C (-20° F); or

(2) In the case of thermoplastic pipe, above the temperature at which the long-term hydrostatic strength used in the design formula under s. 192.121 is determined, except that pipe manufactured before May 18, 1978, may be used at temperatures up to 30° C (100° F); or in the case of reinforced thermosetting plastic pipe, above 66° C (150° F).

(c) The wall thickness for thermoplastic pipe may not be less than 1.57 millimeters (0.062 in.).

(d) The wall thickness for reinforced thermosetting plastic pipe may not be less than that listed in the following table:

<i>Nominal size in inches</i>	<i>Minimum wall thickness in millimeters (inches)</i>
2 -----	1.52 (0.060)
3 -----	1.52 (0.060)
4 -----	1.78 (0.070)
6 -----	2.54 (0.100)

#### 192.125 Design of copper pipe.

(a) Copper pipe used in mains must have minimum wall thickness of 0.065 inches and must be hard drawn.

(b) Copper pipe used in service lines must have a minimum wall thickness as specified for type "L" pipe in ASTM B 88.

(c) Copper pipe used in mains and service lines may not be used at pressures in excess of 100 p.s.i.g.

(d) Copper pipe that does not have an internal corrosion resistant lining may not be used to carry gas that has an average hydrogen sulfide content of more than 0.3 grains per 100 standard cubic feet of gas.

*PSC 192.125 (e) Fillings in copper piping. It is recommended that fittings in copper piping and exposed to the soil, such as service tees, pressure control fittings, etc., be made of bronze, copper or brass.*

### Subpart D—Design of Pipeline Components

#### 192.141 Scope.

This subpart prescribes minimum requirements for the design and installation of pipeline components and facilities. In addition, it prescribes requirements relating to protection against accidental overpressuring.

#### 192.143 General Requirements.

Each component of a pipeline must be able to withstand operating pressures and other anticipated loadings without impairment of its serviceability with unit stresses equivalent to those allowed for comparable material in pipe in the same location and kind of service. However, if design based upon unit stresses is impractical for a particular component, design may be based upon a pressure rating established by the manufacturer by pressure testing that component or a prototype of the component.

#### PSC 192.144 Qualifying metallic components.

Notwithstanding any requirement of this subpart which incorporates by reference an edition of a document listed in Appendix A of this part, a metallic component manufactured in accordance with any other edition of that document is qualified for use under this part if —

(a) It can be shown through visual inspection of the cleaned component that no defect exists which might impair the strength or tightness of the component; and

(b) The edition of the document under which the component was manufactured has equal or more stringent requirements for the following as an edition of that document currently or previously listed in Appendix A:

- (1) Pressure testing;
- (2) Materials; and
- (3) Pressure and temperature ratings.

#### 192.145 Valves.

(a) Each valve must meet the minimum requirements, or the equivalent, of API 6A, API 6D, MSS SP-70, MSS SP-71, or MSS SP-78. A valve may not be used under operating conditions that exceed the applicable pressure-temperature ratings contained in those standards.

(b) Each valve must be able to meet the anticipated operating conditions.

(c) No valve having shell components made of ductile iron may be used at pressures exceeding 80% of the pressure ratings for comparable steel valves at their listed temperature. However, a valve having shell components made of ductile iron may be used at pressures up to 80% of the pressure ratings for comparable steel valves at their listed temperature, if—

(1) The temperature-adjusted service pressure does not exceed 1,000 p.s.i.g.; and

(2) Welding is not used on any ductile iron component in the fabrication of the valve shells or their assembly.

(d) No valve having pressure containing parts made of ductile iron may be used in the gas pipe components of compressor stations.

#### 192.147 Flanges and flange accessories.

(a) *General requirements.* Each flange or flange accessory must meet the minimum requirements of ANSI B16.5, MSS SP-44, or ANSI B16.24, or the equivalent.

(b) Each flange assembly must be able to withstand the maximum pressure at which the pipeline is to be operated and to maintain its physical and chemical properties at any temperature to which it is anticipated that it might be subjected in service.

#### 192.149 Standard fittings.

(a) The minimum metal thickness of threaded fittings may not be less than specified for the pressures and temperatures in the applicable standards referenced in this part, or their equivalent.

(b) Each steel butt-welding fitting must have pressure and temperature ratings based on stresses for pipe of the same or equivalent material. The actual bursting strength of the fitting must at least equal the computed bursting strength of pipe of the designated material and wall



thickness, as determined by a prototype that was tested to at least the pressure required for the pipeline to which it is being added.

**192.151 Tapping.**

(a) Each mechanical fitting used to make a hot tap must be designed for at least the operating pressure of the pipeline.

(b) Where a ductile iron pipe is tapped, the extent of full-thread engagement and the need for the use of outside-sealing service connections, tapping saddles, or other fixtures must be determined by service conditions.

(c) Where a threaded tap is made in cast iron or ductile iron pipe, the diameter of the tapped hole may not be more than 25% of the nominal diameter of the pipe unless the pipe is reinforced, except that

(1) Existing taps may be used for replacement service, if they are free of cracks and have good threads; and

(2) A 1¼-inch tap may be made in a 4-inch cast iron or ductile iron pipe, without reinforcement.

However, in areas where climate, soil and service conditions may create unusual external stresses on cast iron pipe, unreinforced taps may be used only on 6-inch or larger pipe.

**192.153 Components fabricated by welding.**

(a) Except for branch connections and assemblies of standard pipe and fittings joined by circumferential welds, the design pressure of each component fabricated by welding, whose strength cannot be determined, must be established in accordance with paragraph UG-101 of section VIII of the ASME Boiler and Pressure Vessel Code.

(b) Each prefabricated unit that uses plate and longitudinal seams must be designed, constructed, and tested in accordance with the ASME Boiler and Pressure Vessel Code, except for the following:

(1) Regularly manufactured butt-welding fittings.

(2) Pipe that has been produced and tested under a specification listed in Appendix B to this part.

(3) Partial assemblies such as split rings or collars.

Next page is numbered 213

1. The first part of the document discusses the importance of maintaining accurate records of all transactions and activities. It emphasizes that this is essential for ensuring transparency and accountability in the organization's operations.

2. The second part of the document outlines the various methods and tools used to collect and analyze data. It highlights the need for consistent and reliable data collection processes to support informed decision-making.

3. The third part of the document focuses on the role of technology in modern data management. It discusses how advanced software solutions can streamline data collection, storage, and analysis, thereby improving efficiency and accuracy.

4. The fourth part of the document addresses the challenges associated with data security and privacy. It stresses the importance of implementing robust security measures to protect sensitive information from unauthorized access and breaches.

5. The fifth part of the document explores the ethical implications of data collection and analysis. It discusses the need for transparency in data practices and the importance of obtaining informed consent from individuals whose data is being collected.

6. The sixth part of the document provides a summary of the key findings and recommendations. It reiterates the importance of a data-driven approach and offers practical advice for organizations looking to optimize their data management processes.

(

)

(b) Welding must be performed by welders who are qualified under 192.227 and 192.229 for the welding procedures to be used.

PSC 192.223 (c) *Prior to welding in or around a structure or area containing gas facilities, a thorough check shall be made to determine the possible presence of a combustible gas mixture. Welding shall begin only when safe conditions are indicated.*

#### 192.225 Qualifications of welding procedures.

(a) Each welding procedure must be qualified under Section IX of the ASME Boiler and Pressure Vessel Code or Section 2 of the API Standard 1104, whichever is appropriate to the function of the weld, except that a welding procedure qualified under an earlier edition previously listed in Appendix A may continue to be used but may not be requalified under the earlier edition.

(b) When a welding procedure is being qualified under section IX of the ASME Boiler and Pressure Vessel Code, the following steels are considered to fall within the P-Number 1 grouping for the purpose of the essential variable and do not require separate qualification of welding procedures:

(1) Carbon steels that have a carbon content of 0.32 (heat analysis) or less.

(2) Carbon steels that have a carbon equivalent ( $C + \frac{1}{4} Mn$ ) of 0.65 percent (heat analysis) or less.

(3) Alloy steels with weldability characteristics that have been shown to be similar to the carbon steels listed in subparagraphs (1) and (2) of this paragraph.

Alloy steels and carbon steels that are not covered by subparagraph (1), (2), or (3) of this paragraph require separate qualification of procedures for each individual pipe specification in accordance with sections VIII and IX of the ASME Boiler and Pressure Vessel Code.

(c) Each welding procedure must be recorded in detail during the qualifying tests. This record must be retained and followed whenever the procedure is used.

#### 192.227 Qualification of welders.

(a) Except as provided in paragraph (c) of this section, each welder must be qualified in accordance with Section IX of the ASME Boiler and Pressure Vessel Code or Section 3 or API Standard 1104. However, a welder qualified under an earlier edition previously listed in Appendix A may weld but may not requalify under that earlier edition.

(b) When a welder is being qualified under section IX of the ASME Boiler and Pressure Vessel Code, the following steels are considered to fall within the P-Number 1 grouping for the purpose of the essential variables and do not require separate qualification:

(1) Carbon steels that have a carbon content of 0.32 percent (heat analysis) or less.

(2) Carbon steels that have a carbon equivalent ( $C + \frac{1}{4} Mn$ ) of 0.65 percent (heat analysis) or less.

(3) Alloy steels with weldability characteristics that have been shown to be similar to the carbon steels listed in subparagraphs (1) and (2) of this paragraph.

Alloy steels and carbon steels that are not covered by subparagraph (1), (2), or (3) of this paragraph require separate qualification of welders for each individual pipe specification in accordance with sections VIII and IX of the ASME Boiler and Pressure Vessel Code.

(c) A welder may qualify to perform welding on pipe to be operated at a pressure that produces a hoop stress of less than 20% of SMYS by performing an acceptable test weld, for the process to be used, under the test set forth in section I of Appendix C to this part. A welder who makes welded service line connections to mains must also perform an acceptable test weld under section II of Appendix C to this part as a part of his qualifying test. After initial qualification, a welder may not perform welding unless—

(1) Within the preceding 15 calendar months, the welder has requalified, except that the welder must requalify at least once each calendar year; or

(2) Within the preceding 7½ calendar months, but at least twice each calendar year, the welder has had —

(i) A production weld cut out, tested and found acceptable in accordance with the qualifying test; or

(ii) For welders who work only on service lines 2 inches or smaller in diameter, two sample welds tested and found acceptable in accordance with the test in section III of Appendix C to this part.

#### 192.229 Limitations on welders.

(a) No welder whose qualification is based on nondestructive testing may weld compressor station pipe and components.

(b) No welder may weld with a particular welding process unless, within the preceding 6 calendar months, he has engaged in welding with that process.

(c) A welder qualified under section 192.227 (a) may not weld unless within the preceding 6 calendar months the welder has had one weld tested and found acceptable under Section 3 or 6 of API Standard 1104, except that a welder qualified under an earlier edition previously listed in Appendix A may weld but may not requalify under that earlier edition.

#### 192.231 Protection from weather.

The welding operation must be protected from weather conditions that would impair the quality of the completed weld.

#### 192.233 Miter joints.

(a) A miter joint on steel pipe to be operated at a pressure that produces a hoop stress of 30% or more of SMYS may not deflect the pipe more than 3°.

(b) A miter joint on steel pipe to be operated at a pressure that produces a hoop stress of less than 30%, but more than 10%, of SMYS may not deflect the pipe more than 12½° and must be a distance equal to one

pipe diameter or more away from any other miter joint, as measured from the crotch of each joint.

(c) A miter joint on steel pipe to be operated at a pressure that produces a hoop stress of 10% or less of SMYS may not deflect the pipe more than 90°.

#### 192.235 Preparation for welding.

Before beginning any welding, the welding surfaces must be clean and free of any material that may be detrimental to the weld, and the pipe or component must be aligned to provide the most favorable condition for depositing the root bead. This alignment must be preserved while the root bead is being deposited.

#### 192.237 Preheating.

(a) Carbon steel that has a carbon content in excess of 0.32 percent (heat analysis) or a carbon equivalent ( $C + \frac{1}{4} Mn$ ) in excess of 0.65 percent (heat analysis) must be preheated for welding.

(b) Carbon steel that has a lower carbon content or carbon equivalent than the steels covered by paragraph (a) of this section must be preheated for welding when reheating will alleviate existing conditions that would limit the welding technique or tend to adversely affect the quality of the weld.

(c) When steel materials with different preheat temperatures are being preheated for welding, the higher temperature must be used.

(d) Preheat temperature must be monitored to ensure that the required preheat temperature is reached before, and maintained during, the welding operation.

#### 192.239 Stress relieving.

(a) Except as provided in paragraph (f) of this section, each weld on carbon steel that has a carbon content in excess of 0.32 percent (heat analysis) or a carbon equivalent ( $C + \frac{1}{4} Mn$ ) in excess of 0.65 percent (heat analysis) must be stress relieved as prescribed in section VIII of the ASME Boiler and Pressure Vessel Code.

(b) Except as provided in paragraph (f) of this section, each weld on carbon steel that has a carbon content of less than 0.32 percent (heat analysis) or a carbon equivalent ( $C + \frac{1}{4} Mn$ ) of less than 0.65 percent (heat analysis) must be thermally stress relieved when conditions exist which cool the weld at a rate detrimental to the quality of the weld.

(c) Except as provided in paragraph (f) of this section, each weld on carbon steel pipe with a wall thickness of more than 1¼ inches must be stress relieved.

(d) When a weld connects pipe or components that are of different thickness, the wall thickness to be used in determining whether stress relieving is required under this section is—

(1) In the case of pipe connections, the thicker of the two pipes joined;  
or

(2) In the case of branch connections, slip-on flanges, or socket weld fittings, the thickness of the pipe run or header.

(e) Each weld of different materials must be stress relieved, if either material requires stress relieving under this section.

(f) Notwithstanding paragraphs (a), (b), and (c) of this section, stress relieving is not required for the following:

(1) A fillet or groove weld one-half inch, or less, in size (leg) that attaches a connection 2 inches, or less, in diameter; or

(2) A fillet or groove weld three-eighths inch, or less, in groove size that attaches a supporting member or other nonpressure attachment.

(g) Stress relieving required by this section must be performed at a temperature of at least 1,100° F. for carbon steels and at least 1,200° F. for ferritic alloy steels. When stress relieving a weld between steel materials with the different stress relieving temperatures, the higher temperature must be used.

(h) When stress relieving, the temperature must be monitored to ensure that a uniform temperature is maintained and that the proper stress relieving cycle is accomplished.

#### 192.241 Inspection and test of welds.

(a) Visual inspection of welding must be conducted to insure that—

(1) The welding is performed in accordance with the welding procedure; and

(2) The weld is acceptable under paragraph (c) of this section.

(b) The welds on a pipeline to be operated at a pressure that produces a hoop stress of 20 percent or more of SMYS must be nondestructively tested in accordance with 192.243, except that welds that are visually inspected and approved by a qualified welding inspector need not be nondestructively tested if—

(1) The pipe has a nominal diameter of less than 6 inches; or

(2) The pipeline is to be operated at a pressure that produces a hoop stress of less than 40% of SMYS and the welds are so limited in number that nondestructive testing is impractical.

(c) The acceptability of a weld that is nondestructively tested or visually inspected is determined according to the standards in Section 6 of API Standard 1104.

#### 192.243 Nondestructive testing.

(a) Nondestructive testing of welds must be performed by any process, other than trepanning, that will clearly indicate defects that may affect the integrity of the weld.

(b) Nondestructive testing of welds must be performed—

(1) In accordance with written procedures; and

(2) By persons who have been trained and qualified in the established procedures and with the equipment employed in testing.

(c) Procedures must be established for the proper interpretation of each nondestructive test of a weld to ensure the acceptability of the weld under 192.241 (c).

(d) When nondestructive testing is required under 192.241 (b), the following percentages of each day's field butt welds, selected at random by the operator, must be nondestructively tested over their entire circumference:

(1) In Class 1 locations, except offshore, at least 10%.

(2) In Class 2 locations, at least 15%.

(3) In Class 3 and Class 4 locations, at crossings of major or navigable rivers, and offshore, 100% if practicable, but not less than 90%.

(4) Within railroad or public highway rights-of-way, including tunnels, bridges and overhead road crossings, and at pipeline tie-ins, 100%.

PSC 192.243 (d) (5) *In addition, all welds within 500 feet of buildings intended for human occupancy shall be tested.*

PSC 192.243 (d) (6) *If one weld in any random sample is found to be unacceptable then the minimum percentage of welds selected for examination will be that of the next higher class location. If a second weld is found to be unacceptable or if 2 or more welds are found to be unacceptable in the original random sample, then 100% of the welds shall be inspected if practicable, but in no case less than 90% of the welds in that day's construction.*

(e) Except for a welder whose work is isolated from the principal welding activity, a sample of each welder's work for each day must be nondestructively tested, when nondestructive testing is required under 192.241 (b).

(f) When nondestructive testing is required under 192.241 (b), each operator must retain, for the life of the pipeline, a record showing by milepost, engineering station, or by geographic feature, the number of girth welds made, the number of nondestructively tested, the number of rejected, and the disposition of the rejects.

192.245 **Repair or removal of defects.** (a) Each weld that is unacceptable under s. PSC 192.241 (c) must be removed or repaired. Except for welds on an offshore pipeline being installed from a pipeline vessel, a weld must be removed if it has a crack that is more than 8 percent of the weld length.

(b) Each weld that is repaired must have the defect removed down to sound metal and the segment to be repaired must be preheated if conditions exist which would adversely affect the quality of the weld repair. After repair, the segment of the weld that was repaired must be inspected to ensure its acceptability.

(c) Repair of a crack, or of any defect in a previously repaired area must be in accordance with written weld repair procedures that have been qualified under s. PSC 192.225. Repair procedures must provide that the minimum mechanical properties specified for the welding procedure used to make the original weld are met upon completion of the final weld repair.

*PSC 192.246 Precautions to avoid explosions of gas-air mixtures or uncontrolled fires during construction operations.*

(a) *Operations such as gas or electric welding and cutting with cutting torches can be safely performed on pipelines and mains and auxiliary equipment, provided that they are completely full of gas, or air that is free from combustible material. Steps shall be taken to prevent a mixture of gas and air at all points where such operations are to be performed.*

(b) *When a pipeline or main can be kept full of gas during a welding or cutting operation, the following procedures are recommended:*

(1) *Keep a slight flow of gas moving toward the point where cutting or welding is being done.*

(2) *The gas pressure at the site of the work shall be controlled by suitable means.*

(3) *Close all slots or open ends immediately after they are cut with tape, and/or tightly fitting canvas or other suitable material.*

(4) *Do not permit two openings to remain uncovered at the same time. This is doubly important if the two openings are at different elevations.*

(c) *No welding or acetylene cutting shall be done on a pipeline, main, or auxiliary apparatus that contains air if it is connected to a source of gas, unless a suitable means has been provided to prevent the leakage of gas into the pipeline or mains.*

(d) *In situations where welding or cutting must be done on facilities which are filled with air and connected to a source of gas and the precautions recommended above cannot be taken, one or more of the following precautions, depending upon the circumstances at the job are required:*

(1) *Purging of the pipe or equipment upon which welding or cutting is to be done, with combustible gas or inert gas.*

(2) *Testing of the atmosphere in the vicinity of the zone to be heated before the work is started and at intervals as the work progresses, with a combustible gas indicator or by other suitable means.*

(3) *Careful verification before the work starts that the valves that isolate the work from a source of gas do not leak.*

#### **Subpart F—Joining of Materials Other Than by Welding**

##### **192.271 Scope.**

(a) *This subpart prescribes minimum requirements for joining materials in pipelines, other than by welding.*

(b) *This subpart does not apply to joining during the manufacture of pipe or pipeline components.*

##### **192.273 General.**

(a) *The pipeline must be designed and installed so that each joint will sustain the longitudinal pullout or thrust forces caused by contraction or expansion of the piping or by anticipated external or internal loading.*



(b) Each joint must be made in accordance with written procedures that have been proven by test or experience to produce strong gastight joints.

(c) Each joint must be inspected to insure compliance with this subpart.

Next page is numbered 235

1900

...

...

...

( )

( )

quantity to prevent the formation of a hazardous mixture of gas and air, a slug of inert gas must be released into the line before the gas.

(b) When a pipeline is being purged of gas by use of air, the air must be released into one end of the line in a moderately rapid and continuous flow. If air cannot be supplied in sufficient quantity to prevent the formation of a hazardous mixture of gas and air, a slug of inert gas must be released into the line before the air.

*PSC 192.629 (c) No pipeline, main, or service shall be purged into any building or confined space.*

### Subpart M—Maintenance

#### 192.701 Scope.

This subpart prescribes minimum requirements for maintenance of pipeline facilities.

192.703 General. (a) No person may operate a segment of pipeline, unless it is maintained in accordance with this subpart.

(b) Each segment of pipeline that becomes unsafe must be replaced, repaired, or removed from service.

(c) Hazardous leaks must be repaired promptly.

192.705 Transmission lines: patrolling. (a) Each operator shall have a patrol program to observe surface conditions on and adjacent to the transmission line right-of-way for indications of leaks, construction activity, and other factors affecting safety and operation.

(b) The frequency of patrols is determined by the size of the line, the operating pressures, the class location, terrain, weather, and other relevant factors, but intervals between patrols may not be longer than prescribed in the following table:

Class location of line	Maximum Interval Between Patrols	
	At highway and railroad crossings	All other places
1, 2.....	7½ months; but at least twice each calendar year.	15 months; but at least once each calendar year.
3.....	4½ months; but at least four times each calendar year.	7½ months; but at least twice each calendar year.
4.....	4½ months; but at least four times each calendar year.	4½ months; but at least four times each calendar year.

192.706 Transmission lines; leakage surveys. (a) Each operator of a transmission line shall provide for periodic leakage surveys of the line in its operating and maintenance plan.

(b) Leakage surveys of a transmission line must be conducted at intervals not exceeding 15 months, but at least once each calendar year. However, in the case of a transmission line which transports gas in conformity

with § 192.625 without an odor or odorant, leakage surveys using leak detector equipment must be conducted —

(1) In Class 3 locations, at intervals not exceeding 7½ months, but at least twice each calendar year; and

(2) In Class 4 locations, at intervals not exceeding 4½ months, but at least four times each calendar year.

**192.707 Line markers for mains and transmission lines.** (a) *Buried pipelines.* Except as provided in paragraph (b) of this section, a line marker must be placed and maintained as close as practical over each buried main and transmission line:

(1) At each crossing of a public road and railroad; and

(2) Wherever necessary to identify the location of the transmission line or main to reduce the possibility of damage or interference.

(b) *Exceptions for buried pipelines.* Line markers are not required for buried mains and transmission lines—

(1) Located offshore or at crossings of or under waterways and other bodies of water; or

(2) In Class 3 or Class 4 locations—

(i) Where placement of a marker is impractical; or

(ii) Where a damage prevention program is in effect under s. 192.614.

(c) *Pipelines aboveground.* Line markers must be placed and maintained along each section of a main and transmission line that is located aboveground in an area accessible to the public.

(d) *Marker warning.* The following must be written legibly on a background of sharply contrasting color on each line marker:

(1) The word "Warning," "Caution," or "Danger" followed by the words "Gas (or name of gas transported) Pipeline" all of which, except for markers in heavily developed urban areas, must be in letters at least one inch high with one-quarter inch stroke.

(2) The name of the operator and the telephone number (including area code) where the operator can be reached at all times.

**PSC 192.707**

*When transmission lines are located outside urban areas, their location shall be marked (recognizable to the public) at each fence line, road crossing, railroad crossing, river, lake, stream, or drainage ditch crossing and wherever it is considered necessary to identify the location of a pipeline to reduce the possibility of damage or interference.*

**192.709 Transmission lines: record-keeping.** Each operator shall keep records covering each leak discovered, repair made, transmission line break, leakage survey, line patrol, and inspection, for as long as the segment of transmission line involved remains in service.

**192.711 Transmission lines: general requirements for repair procedures.** (a) Each operator shall take immediate temporary measures to protect the public whenever—

(1) A leak, imperfection, or damage that impairs its serviceability is found in a segment of steel transmission line operating at or above 40% of the SMYS; and

(2) It is not feasible to make a permanent repair at the time of discovery. As soon as feasible, the operator shall make permanent repairs.

(b) Except as provided in 192.717 (a) (3), no operator may use a welded patch as a means of repair.

**192.713 Transmission lines: permanent field repair of imperfections and damages.** (a) Except as provided in paragraph (b) of this section each imperfection or damage that impairs the serviceability of a segment of steel transmission line operating at or above 40% of SMYS must be repaired as follows:

(1) If it is feasible, to take the segment out of service, the imperfection or damage must be removed by cutting out a cylindrical piece of pipe and replacing it with pipe of similar or greater design strength.

(2) If it is not feasible to take the segment out of service, a full encirclement welded split sleeve of appropriate design must be applied over the imperfection or damage.

(3) If the segment is not taken out of service, the operating pressure must be reduced to a safe level during the repair operations.

*PSC 192.713(a)(4) Gouges and grooves of lesser depth than 10% of the nominal wall thickness of the pipe may be removed by grinding out to a smooth contour provided the grinding does not reduce the remaining wall thickness to less than the minimum prescribed by this code for the conditions of use.*

(b) Submerged offshore pipelines and submerged pipelines in inland navigable waters may be repaired by mechanically applying a full encirclement split sleeve of appropriate design over the imperfection or damage.

**192.715 Transmission lines: permanent field repair of welds.** Each weld that is unacceptable under 192.241 (c) must be repaired as follows:

(a) If it is feasible to take the segment of transmission line out of service, the weld must be repaired in accordance with the applicable requirements of 192.245.

(b) A weld may be repaired in accordance with 192.245 while the segment of transmission line is in service if—

(1) The weld is not leaking;

(2) The pressure in the segment is reduced so that it does not produce a stress that is more than 20% of the SMYS of the pipe; and

(3) Grinding of the defective area can be limited so that at least  $\frac{1}{8}$ -inch thickness in the pipe weld remains.

(c) A defective weld which cannot be repaired in accordance with paragraph (a) or (b) of this section must be repaired by installing a full encirclement welded split sleeve of appropriate design.

**192.717 Transmission lines: permanent field repair of leaks.** (a) Except as provided in paragraph (b) of this section, each permanent field repair of a leak on a transmission line must be made as follows:

(1) If feasible, the segment of transmission line must be taken out of service and repaired by cutting out a cylindrical piece of pipe and replacing it with pipe of similar or greater design strength.

(2) If it is not feasible to take the segment of transmission line out of service, repairs must be made by installing a full encirclement welded split sleeve of appropriate design, unless the transmission line—

(i) Is joined by mechanical couplings; and

(ii) Operates at less than 40 percent of SMYS.

(3) If the leak is due to a corrosion pit, the repair may be made by installing a properly designed bolt-on-leak clamp; or, if the leak is due to a corrosion pit and on pipe of not more than 40,000 psi SMYS, the repair may be made by fillet welding over the pitted area a steel plate patch with rounded corners, of the same or greater thickness than the pipe, and not more than one-half of the diameter of the pipe in size.

(b) Submerged offshore pipelines and submerged pipelines in inland navigable waters may be repaired by mechanically applying a full encirclement split sleeve of appropriate design over the leak.

**192.719 Transmission lines: testing of repairs.** (a) *Testing of replacement pipe.* (1) If a segment of transmission line is repaired by cutting out the damaged portion of the pipe as a cylinder, the replacement pipe must be tested to the pressure required for a new line installed in the same location.

(2) The test required by subparagraph (1) of this paragraph may be made on the pipe before it is installed, but all field girth bolt welds that are not strength tested must be tested after installation by nondestructive tests meeting the requirements of 192.243.

(b) *Testing of repairs made by welding.* Each repair made by welding in accordance with 192.713, 192.715, and 192.717 must be examined in accordance with 192.241.

**PSC 192.720 Repair of steel pipe operating below 40% of the specified minimum yield strength.**

*If inspections at any time reveal an injurious defect, gouge, groove, dent, or leak, immediate temporary measures shall be employed to protect the property and public if it is not feasible to make permanent repair at time of discovery. As soon as feasible, permanent repairs shall be made using recognized methods of repair.*

**192.721 Distribution systems: patrolling.** (a) The frequency of patrolling mains must be determined by the severity of the conditions which could cause failure or leakage, and the consequent hazards to public safety.

(b) Mains in places or on structures where anticipated physical movement or external loading could cause failure or leakage must be patrolled at intervals not exceeding 4½ months, but at least four times each calendar year.

**PSC 192.722 Distribution mains: markers.** *When distribution mains are located outside urban areas, their location shall be marked (recognizable to the public) at each fence line, road crossing, railroad crossing, river, lake, stream, or drainage ditch crossing and wherever it is considered necessary to identify the location of a pipeline to reduce the possibility of damage or interference.*

**192.723 Distribution systems: leakage surveys and procedures.** (a) Each operator of a distribution system shall provide for periodic leakage surveys in its operating and maintenance plan.

(b) The type and scope of the leakage control program must be determined by the nature of the operations and the local conditions, but it must meet the following minimum requirements:

(1) A gas detector survey must be conducted in business districts, including tests of the atmosphere in gas, electric, telephone, sewer and water system manholes, at cracks in pavement and sidewalks, and at other locations providing an opportunity for finding gas leaks, at intervals not exceeding 15 months, but at least once each calendar year.

(2) Leakage surveys of the distribution system outside of the principal business areas must be made as frequently as necessary, but at intervals not exceeding 5 years.

**PSC 192.723** *Every operator shall maintain a gas leak-detection program and shall maintain records of operation under the program. The program shall consist of not less than the following:*

(a) *In principal business districts (as shown by maps filed with the public service commission by each utility) a reasonable street-opening survey shall be conducted at intervals not exceeding 7½ months, but at least twice each calendar year by making tests with combustible gas indicators in street openings such as telephone and electric vaults and manholes, catch basins and sewer system manholes, and gas system openings.*

(b) *In each principal business district a building survey shall be conducted at intervals not exceeding 15 months, but at least once each calendar year. The piping from the service entrance to the meter outlet and metering and regulating equipment shall be tested for gas leakage in those buildings that have gas service.*

(c) *A survey of all buildings used for public gatherings such as schools, churches, hospitals, and theaters shall be conducted at intervals not exceeding 15 months, but at least once each calendar year. The piping from the service entrance to the meter outlet and metering and regulating equipment shall be tested for gas leakage.*

(d) *In residential areas, in addition to a survey of public buildings the vegetation shall be checked. At least 3 barhole tests shall be made in each block; at least one street opening shall be checked if one exists in each block or at each intersection; and on streets where the system is operating at a pressure of more than 10 p.s.i.g., all street openings shall be checked. (See 192.723 (b) (1) above for types of street openings.) The utility may substitute for the barhole tests a ground surface survey with a hand-operated, continuous-sampling instrument capable of detecting combustible gas in air concentrations of 100 parts per million. The utility may substitute for all the tests required by this section (PSC 192.723 (d)) a survey by mobile flame ionization or infrared gas detection units. The tests required by this section (PSC 192.723 (d))*

shall be made at intervals not exceeding 15 months, but at least once each calendar year.

(e) A survey of all services with an acceptable leak detection device shall be made at intervals not exceeding five years.

(f) Along lines in rural areas, the vegetation shall be checked annually.

(g) When a leak complaint is received and the odor of gas indicates that there is a leak in or near the premises, a search shall be carried to conclusion until such leak is found.

**PSC 192.724 Further leakage survey after repair of leak.** When a leak is found and repaired, a further check shall be made in the vicinity of the repaired leak to determine if there is any other source of migrant gas in the neighborhood.

**192.725 Test requirements for reinstating service lines.** (a) Except as provided in paragraph (b) of this section, each disconnected service line must be tested in the same manner as a new service line, before being reinstated.

(b) Each service line temporarily disconnected from the main must be tested from the point of disconnection to the service line valve in the same manner as a new service line, before reconnecting. However, if provisions are made to maintain continuous service, such as by installation



(1) Saturated KCl calomel half cell: —0.78 volt.

(2) Silver-silver chloride half cell used in sea water: —0.80 volt.

C. In addition to the standard reference half cells, an alternate metallic material or structure may be used in place of the saturated copper-copper sulfate half cell if its potential stability is assured and if its voltage equivalent referred to a saturated copper-copper sulfate half cell is established.

## WISCONSIN CODE ADOPTION OF PART 193 IN TITLE 49 CODE OF FEDERAL REGULATIONS

### PART 193—LIQUEFIED NATURAL GAS FACILITIES: FEDERAL SAFETY STANDARDS

Subpart	A—General	Design of Components and Buildings
Sec.		193.2121 General.
193.2001	Scope of part.	193.2123 Valves.
193.2003	Semisolid facilities.	193.2125 Automatic shutoff valves.
193.2005	Applicability.	193.2127 Piping.
193.2007	Definitions.	193.2129 Piping attachments and supports.
193.2009	Rules of regulatory construction.	193.2131 Building design.
193.2011	Reporting.	193.2133 Buildings; ventilation.
193.2013	Incorporation by reference.	193.2135 Expansion or contraction.
193.2015	Petition for finding or approval.	193.2137 Frost heave.
193.2017	Plans and Procedures.	193.2139 Ice and snow.
		193.2141 Electrical systems.
		193.2143 Lightning.
Subpart	B—Siting Requirements	193.2145 Boilers and pressure vessels.
		193.2147 Combustion engines and turbines.
193.2051	Scope.	
193.2055	General.	
193.2057	Thermal radiation protection.	Impoundment Design and Capacity
193.2059	Flammable vapor-gas dispersion protection.	193.2149 Impoundment required.
193.2061	Seismic investigation and design forces.	193.2151 General design characteristics.
193.2063	Flooding.	193.2153 Classes of impounding systems.
193.2065	Soil characteristics.	193.2155 Structural requirements.
193.2067	Wind forces.	193.2167 Coatings and coverings.
193.2069	Other severe weather and natural conditions.	193.2159 Floors.
193.2071	Adjacent activities.	193.2161 Dikes, general.
193.2073	Separation of facilities.	193.2163 Vapor barriers.
		193.2165 Dike dimensions.
		193.2167 Covered systems.
		193.2169 Gas leak detection.
Subpart	C—Design	193.2171 Sump basins.
		193.2173 Water removal.
Sec.		193.2175 Shared impoundment.
193.2101	Scope.	193.2179 Impoundment capacity; general.
Materials		193.2181 Impoundment capacity; LNG storage tanks.
193.2103	General.	193.2183 Impoundment capacity; equipment and transfer facilities.
193.2105	Extreme temperatures; normal operations.	193.2185 Impoundment capacity; parking areas, portable vessels.
193.2107	Extreme temperatures; emergency conditions.	
193.2109	Insulation.	
193.2111	Cold boxes.	
193.2113	Piping.	LNG Storage Tanks
193.2115	Concrete subject to cryogenic temperatures.	Sec.
193.2117	Combustible materials.	193.2187 General.
193.2119	Records.	193.2189 Loading forces.
		193.2191 Stratification.

193.2193	Movement and stress.	193.2433	Sensing devices.
193.2195	Penetrations.	193.2435	Warning devices.
193.2197	Internal design pressure.	193.2437	Pump and compressor control.
193.2199	External design pressure.	193.2439	Emergency shutdown control systems.
193.2201	Internal temperature.	193.2441	Control center.
193.2203	Foundation.	193.2443	Failsafe control.
193.2205	Frost heave.	193.2445	Sources of power.
193.2207	Insulation.		
193.2209	Instrumentation for LNG storage tanks.	Subpart	F—Operations
193.2211	Metal storage tanks.	193.2501	Scope.
193.2213	Concrete storage tanks.	193.2503	Operating procedures.
193.2215	Thermal barriers.	193.2505	Cooldown.
193.2217	Support system.	193.2507	Monitoring operations.
193.2219	Internal piping.	193.2509	Emergency procedures.
193.2221	Marking.	193.2511	Personnel safety.
		193.2513	Transfer procedures.
		193.2515	Investigations of failures.
		193.2517	Purging.
		193.2519	Communication systems.
		193.2521	Operating records.
		Subpart	G—Maintenance
		193.2601	Scope.
		193.2603	General.
		193.2605	Maintenance procedures.
		193.2607	Foreign material.
		193.2609	Support systems.
		193.2611	Fire protection.
		193.2613	Auxiliary power sources.
		193.2615	Isolating and purging.
		193.2617	Repairs.
		193.2619	Control systems.
		193.2621	Testing transfer hoses.
		193.2623	Inspecting LNG storage tanks.
		193.2625	Corrosion protection.
		193.2627	Atmospheric corrosion control.
		193.2629	External corrosion control; buried or submerged components.
		193.2631	Internal corrosion control.
		193.2633	Interference currents.
		193.2635	Monitoring corrosion control.
		193.2637	Remedial measures.
		193.2639	Maintenance records.
		Subpart	H— Personnel Qualifications and Training
		193.2701	Scope.
		193.2703	Design and fabrication.
		193.2705	Construction, installation, inspection and testing.
		193.2707	Operations and maintenance.
		193.2709	Security.
		193.2711	Personnel health.
		193.2713	Training; operations and maintenance.
		193.2715	Training; security.
		193.2717	Training; fire protection.
		193.2719	Training; records.
		Subpart	I—Fire Protection
		193.2801	Scope.
		193.2803	General.
		193.2805	Fire prevention plan.
		193.2807	Smoking.

193.2809	Open fires.	193.2903	Security procedures.
193.2811	Hotwork.	193.2905	Protective enclosures.
193.2813	Storage of flammable fluids.	193.2907	Protective enclosure construction.
193.2815	Motorized equipment.		
193.2817	Fire control equipment.	193.2909	Security communications.
193.2819	Gas detection.	193.2911	Security lighting.
193.2821	Fire detection.	193.2913	Security monitoring.
Subpart	J—Security	193.2915	Alternative power sources.
193.2901	Scope.	193.2917	Warning signs.

## Appendix A to Part 193—Incorporation by Reference

### I. List of organizations and addresses

### II. Documents Incorporated by Reference

Authority: 49 U.S.C. 1671 et seq.; 49 CFR 153, Appendix A of Part 1, and Appendix A of Part 106.

#### Subpart A—General

§ 193.2001 Scope of part. (a) This part prescribes safety standards for LNG facilities used in the transportation of gas by pipeline that is subject to the Natural Gas Pipeline Safety Act of 1968 and Part 192 of this chapter.

(b) This part does not apply to—

- (1) LNG facilities used by ultimate consumers of LNG or natural gas.
- (2) LNG facilities used in the course of natural gas treatment or hydrocarbon extraction which do not store LNG.
- (3) In the case of a marine cargo transfer system and associated facilities, any matter other than siting pertaining to the system or facilities between the marine vessel and the last manifold (or in the absence of a manifold, the last valve) located immediately before a storage tank.
- (4) Any LNG facility located in navigable waters (as defined in Section 3 (8) of the Federal Power Act (16 U.S.C. 796(8))).

§ 193.2003 Semisolid facilities. An LNG facility used in the transportation or storage of LNG in a semisolid state need not comply with any requirement of this part which the Director finds impractical or unnecessary because of the semisolid state of LNG. In making such a finding, the Director may impose appropriate alternative safety conditions.

§ 193.2005 Applicability. (a) New or amended standards in this part governing the siting, design, installation, or construction of an LNG facility and related personnel qualifications and training do not apply to—

- (1) LNG facilities under construction before the date such standards are published; or
- (2) LNG facilities for which an application for approval of the siting, construction, or operation was filed before March 1, 1978, with the Department of Energy (or any predecessor organization of that Department) or the appropriate State or local agency in the case of any facility not subject to the jurisdiction of the Department of Energy under the Natural Gas Act (not including any facility the construction of which began after November 29, 1979, not pursuant to such an approval).

(b) If an LNG facility listed in paragraph (a) of this section is replaced, relocated, or significantly altered after February 11, 1980, the replacement, relocated facility, or significantly altered facility must comply with the applicable requirements of this part governing siting, design, installation, and construction, except that—

(1) The siting requirements apply only to LNG storage tanks that are significantly altered by increasing the original storage capacity or relocated, not pursuant to an application for approval filed as provided by paragraph (a)(2) of this section before March 1, 1978; and

(2) To the extent compliance with the design, installation, and construction requirements would make the replaced, relocated, or altered facility incompatible with other facilities or would otherwise be impracticable, the replaced, relocated, or significantly altered facility may be designed, installed, or constructed in accordance with the original specifications for the facility, or in a manner that the Director finds acceptable.

(c) The siting, design, installation, and construction of an LNG facility under construction before February 11, 1980, or that is listed in paragraph (a)(2) of this section (except a facility under construction before July 1, 1976) must meet the applicable requirements of NFPA 59A (1972 edition) and Part 192 of this chapter or the applicable requirements of this part, except that no Part 192 standard issued after March 1, 1978, applies to an LNG facility listed in paragraph (a)(2) of this section.

§ 193.2007 Definitions. As used in this part—

“Ambient vaporizer” means a vaporizer which derives heat from naturally occurring heat sources, such as the atmosphere, sea water, surface waters, or geothermal waters.

“Cargo transfer system” means a component, or system of components functioning as a unit, used exclusively for transferring hazardous fluids in bulk between a tank car, tank truck, or marine vessel and a storage tank.

“Component” means any part, or system of parts functioning as a unit, including, but not limited to, piping, processing equipment, containers, control devices, impounding systems, lighting, security devices, fire control equipment, and communication equipment, whose integrity or reliability is necessary to maintain safety in controlling, processing, or containing a hazardous fluid.

“Container” means a component other than piping that contains a hazardous fluid.

“Control system” means a component, or system of components functioning as a unit, including control valves and sensing, warning, relief, shutdown, and other control devices, which is activated either manually or automatically to establish or maintain the performance of another component.

“Controllable emergency” means an emergency where reasonable and prudent action can prevent harm to people or property.

“Design pressure” means the pressure used in the design of components for the purpose of determining the minimum permissible thickness or physical characteristics of its various parts. When applicable, static

head shall be included in the design pressure to determine the thickness of any specific part.

“Determine” means make an appropriate investigation using scientific methods, reach a decision based on sound engineering judgment, and be able to demonstrate the basis of the decision.

“Dike” means the perimeter of an impounding space forming a barrier to prevent liquid from flowing in an unintended direction.

“Director” means Director of the Materials Transportation Bureau or any person to whom authority in the matter concerned has been delegated.

“Emergency” means a deviation from normal operation, a structural failure, or severe environmental conditions that probably would cause harm to people or property.

“Exclusion zone” means an area surrounding an LNG facility in which an operator or government agency legally controls all activities in accordance with § 193.2057 and § 193.2059 for as long as the facility is in operation.

“Fail-safe” means a design feature which will maintain or result in a safe condition in the event of malfunction or failure of a power supply, component, or control device.

“g” means the standard acceleration of gravity of 9.806 metre per second<sup>2</sup> (32.17 feet per second<sup>2</sup>).

“Gas,” except when designated as inert, means natural gas, other flammable gas, or gas which is toxic or corrosive.

“Hazardous fluid” means gas or hazardous liquid.

“Hazardous liquid” means LNG or a liquid that is flammable or toxic.

“Heated vaporizer” means a vaporizer which derives heat from other than naturally occurring heat sources.

“Impounding space” means a volume of space formed by dikes and floors which is designed to confine a spill of hazardous liquid.

“Impounding system” includes an impounding space, including dikes and floors for conducting the flow of spilled hazardous liquids to an impounding space.

“Liquefied natural gas” or “LNG” means natural gas or synthetic gas having methane (CH<sub>4</sub>) as its major constituent which has been changed to a liquid or semisolid.

“LNG facility” means a pipeline facility that is used for liquefying or solidifying natural gas or synthetic gas or transferring, storing, or vaporizing liquefied natural gas.

“LNG plant” means an LNG facility or system of LNG facilities functioning as a unit.

“m<sup>3</sup>” means a volumetric unit which is one cubic metre, 6.2898 barrels, 35.3147 ft.<sup>3</sup>, or 264.1720 U.S. gallons, each volume being considered as equal to the other.

"Maximum allowable working pressure" means the maximum gage pressure permissible at the top of the equipment, containers or pressure vessels while operating at design temperature.

"Normal operation" means functioning within ranges of pressure, temperature, flow, or other operating criteria required by this part.

"Operator" means a person who owns or operates an LNG facility.

"Person" means any individual, firm, joint venture, partnership, corporation, association, state, municipality, cooperative association, or joint stock association and includes any trustee, receiver, assignee, or personal representative thereof.

"Pipeline facility" means new and existing piping, rights-of-way, and any equipment, facility, or building used in the transportation of gas or in the treatment of gas during the course of transportation.

"Piping" means pipe, tubing, hoses, fittings, valves, pumps, connections, safety devices or related components for containing the flow of hazardous fluids.

"Storage tank" means a container for storage a hazardous fluid, including an underground cavern.

"Transfer piping" means a system of permanent and temporary piping used for transferring hazardous fluids between any of the following: liquefaction process facilities, storage tanks, vaporizers, compressors, cargo transfer systems, and facilities other than pipeline facilities.

"Transfer system" includes transfer piping and cargo transfer system.

"Waterfront LNG plant" means an LNG plant with docks, wharves, piers, or other structures in, on, or immediately adjacent to the navigable waters of the United States or Puerto Rico and any shore area immediately adjacent to those waters to which vessels may be secured and at which LNG cargo operations may be conducted.

"Vaporization" means an addition of thermal energy changing a liquid or semisolid to a vapor or gaseous state.

"Vaporizer" means a heat transfer facility designed to introduce thermal energy in a controlled manner for changing a liquid or semisolid to a vapor or gaseous state.

§ 193.2009 Rules of regulatory construction. (a) As used in this part—

- (1) "Includes" means including but not limited to;
- (2) "May" means is permitted to or is authorized to;
- (3) "May not" means if not permitted to or is not authorized to; and
- (4) "Shall" or "must" is used in the mandatory and imperative sense.

(b) In this part—

- (1) Words importing the singular include the plural; and
- (2) Words importing the plural include the singular.

§ 193.2011 Reporting. Leaks and spills of LNG must be reported in accordance with the requirements of Part 191 of this chapter.

§ 193.2013 Incorporation by reference. (a) There are incorporated by reference in this Part all materials referred to in this Part that are not set forth in full. The incorporated materials are deemed published under 5 U.S.C. 552(a) and 1 CFR Part 51 and are part of this regulation as though set forth in full. All incorporated materials are listed in Appendix A to this Part 193 with the applicable editions in parentheses following the title of the referenced material. Only the latest listed edition applies, except that an earlier listed edition may be followed with respect to components which are designed, manufactured, or installed in accordance with the earlier edition before the latest edition is adopted, unless otherwise provided in this part. The incorporated materials are subject to change, but any change will be announced by publication in the Federal Register before it becomes effective.

(b) All incorporated materials are available for inspection in the Materials Transportation Bureau, U.S. Department of Transportation, 400 Seventh Street, SW., Washington, D.C. 20590, and at the Office of the Federal Register Library, 1100 L Street, NW., Washington, D.C. In addition, copies of the incorporated materials are available from the respective organizations listed in Appendix A to this Part 193.

(c) Incorporated by reference provisions approved by the Director of the Federal Register.

(49 U.S.C. 1674 (a); 49 CFR 1.53 and Appendix A to Part 1)

§ 193.2015 Petitions for finding or approval. Where a rule in this part authorizes the Director to make a finding or approval, any operator may petition the Director to make such finding or approval. Petitions must be sent to the Director, Materials Transportation Bureau, 400 7th Street, SW., Washington, D.C. 20590, and be received at least 90 days before the operator requests that the finding or approval be made. Each petition must refer to the rule authorizing the action sought and contain information or arguments that justify the action. Unless otherwise specified, no public proceeding is held on a petition before it is granted or denied. Within 90 days after a petition is received, the Director notifies the petitioner of the disposition of the petition or, if the request requires more extensive consideration or additional information or comments are requested and delay is expected, of the date by which action will be taken.

§ 193.2017 Plans and procedures. (a) Each operator shall maintain at each LNG plant the plans and procedures required for that plant by this part. The plans and procedures must be available upon request for review and inspection by the Director or any State Agency that has submitted a current certification or agreement with respect to the plant under section 5 of the Natural Gas Pipeline Safety Act of 1968 (49 U.S.C. 1674). In addition, each change to the plans or procedures must be available at the LNG plant for review and inspection within 20 days after the change is made.

(b) The Director or the State Agency, after notice and opportunity for hearing, may require the operator to amend its plans and procedures as necessary to provide a reasonable level of safety.

**Subpart B—Siting Requirements**

§ 193.2051 *Scope.* This subpart prescribes siting requirements for the following LNG facilities: Containers and their impounding systems, transfer systems and their impounding systems, emergency shutdown control systems, fire control systems, and associated foundations, support systems, and normal or auxiliary power facilities necessary to maintain safety.

§ 193.2055 *General.* An LNG facility must be located at a site of suitable size, topography, and configuration so that the facility can be designed to minimize the hazards to persons and offsite property resulting from leaks and spills of LNG and other hazardous fluids at the site. In selecting a site, each operator shall determine all site-related characteristics which could jeopardize the integrity and security of the facility. A site must provide ease of access so that personnel, equipment, and materials from offsite locations can reach the site for fire fighting or controlling spill associated hazards or for evacuation of personnel.

§ 193.2057 *Thermal radiation protection.* (a) *Thermal exclusion zone.* Each LNG container and LNG transfer system must have a thermal exclusion zone in accordance with the following:

(1) Within the thermal exclusion zone, the impounding system may not be located closer in targets listed in paragraph (d) of this section than the exclusion distance "d" determined according to this section, unless the target is a pipeline facility of the operator.

(2) If grading and drainage are used under § 193.2149 (b), operators must comply with the requirements of this section by assuming the space needed for drainage and collection of spilled liquid is an impounding system.

(b) *Measurement.* The exclusion distance "d" is measured along the line (PT), as shown in the following impoundment diagram, where the following apply:

(1) T is a point on the target that is closest to (P).

(2) D is a point closest to (T) on the top inside edge of the innermost dike.

(3)  $\Theta$  is one of the following angles with the vertical, to account for flame tilt and potential preignition vapor formation:

(i) An assumed angle of  $(\Theta) = 45^\circ$ ; or

(ii) An angle determined in accordance with a mathematical model that meets the criteria of paragraph (c)(2) of this section, using the maximum wind speed that is exceeded less than 5 percent of the time based on recorded data for the area.

(4) L is one of the following lengths to account for flame height:

(i) An assumed length of  $(L) = 6(A/\pi)^{0.5}$ , where (A) is the horizontal area across the impounding space measured at the lowest point along the top inside edge of the dike; or



(ii) A length determined in accordance with a mathematical model that meets the criteria of paragraph (c)(2) of this section, using appropriate parameters consistent with the time period that a target could be subjected to exposure before harm would result.


(5) PD is a line of length (L) or less, lying at angle  $\theta$  in the vertical plane that intersects points (D) and (T).

(6) PT is a line lying in the vertical plane of line (PD), that:

(i) Is perpendicular to line (PD) when (PD) is less than (L); or

(ii) Has an angular elevation not above the horizontal at (P) when (PD) equals (L);

(7) P is the point where (PT) and (PD) intersect.

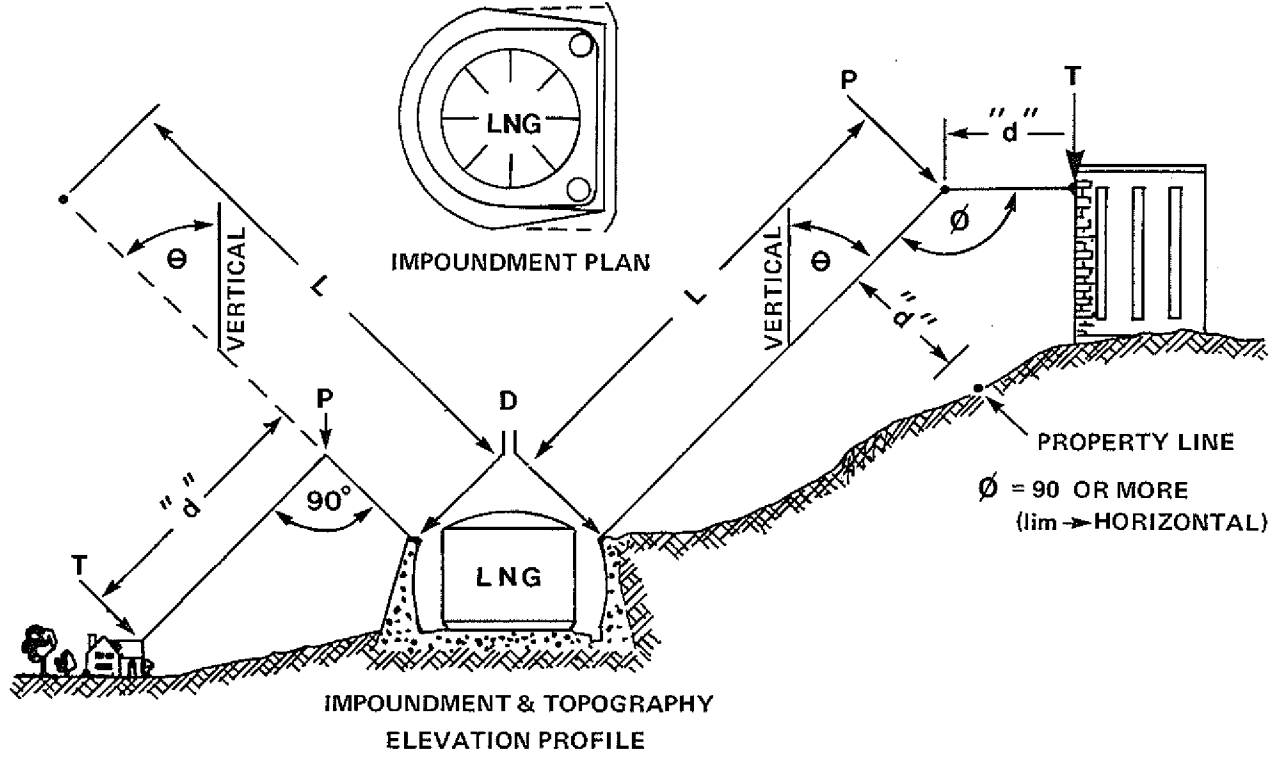

Register, January, 1985, No. 349

(c) *Exclusion distance length.* The length of an exclusion distance for each impounding space may not be less than the distance "d" determined in accordance with one of the following:

(1)  $d = (f)(A)^{0.5}$ , where

A = the largest horizontal area across the impounding space measured at the lowest point along the top inside edge of the dike.

f = values for targets prescribed in paragraph (d) of this section.

(2) Determine "d" from a mathematical model for thermal radiation and other appropriate fire characteristics which assures that the incident thermal flux levels in paragraph (d) of this section are not exceeded. The model must:

(i) Use atmospheric conditions which, if applicable, result in longer exclusion distances than other atmospheric conditions occurring at least 95 percent of the time based on recorded data for the site area;

(ii) Have been evaluated and verified by testing at a scale, considering scaling effects, appropriate for the range of application;

(iii) Have been submitted to the Director for approval, with supportive data as necessary to demonstrate validity; and

(iv) Have received approval by the Director.

(d) *Limiting values for incident radiant flux on offsite targets.* The maximum incident radiant flux at an offsite target from burning of a total spill in an impounding space must be limited to the distances in paragraph (c) of this section using the following values of "(f)" or "Incident Flux":

Offsite target	(f)	Incident flux Btu/ft. <sup>2</sup> hour
(1) Outdoor areas occupied by 20 or more persons during normal use, such as beaches, playgrounds, outdoor theaters, other recreation areas or other places of public assembly.....	(3)	1,600
(2) Buildings that are used for residences, or occupied by 20 or more persons during normal use .....	(1.6)	4,000
(3) Buildings made of cellulosic materials or are not fire resistant or do not provide durable shielding from thermal radiation that: (i) Have exceptional value, or contain objects of exceptional value based on historic uniqueness described in Federal, State, or local registers; (ii) Contain explosive, flammable, or toxic materials in hazardous quantities; or (iii) Could result in additional hazard if exposed to high levels of thermal radiation .....	(1.6)	4,000
(4) Structures that are fire resistant and provide durable shielding from thermal radiation that have the characteristics described in subdivisions (3)(i) through (3)(iii) above .....	(1.1)	6,700
(5) Public streets, highways, and mainlines of railroads .....	(1.1)	6,700
(6) Other structures, or if closer to (P), the right-of-way of the facility	(0.8)	10,000

§ 193.2059 Flammable vapor-gas dispersion protection. (a) *Dispersion exclusion zone.* Except as provided by paragraph (e) of this section, each LNG container and LNG transfer system must have a dispersion exclusion zone with a boundary described by the minimum dispersion distance computed in accordance with this section. The following are prohibited in a dispersion exclusion zone unless it is an LNG facility of the operator:

(1) Outdoor areas occupied by 20 or more persons during normal use, such as beaches, playgrounds, outdoor theaters, other recreation areas, or other places of public assembly.

(2) Buildings that are:

(i) Used for residences;

(ii) Occupied by 20 or more persons during normal use;

(iii) Contain explosive, flammable, or toxic materials in hazardous quantities;

(iv) Have exceptional value or contain objects of exceptional value based on historic uniqueness described in Federal, State, or local registers; or

(v) Could result in additional hazard if exposed to a vapor-gas cloud.

(b) *Measuring dispersion distance.* The dispersion distance is measured radially from the inside edge of an impounding system along the ground contour to the exclusion zone boundary.

(c) *Computing dispersion distance.* A minimum dispersion distance must be computed for the impounding system. If grading and drainage are used under § 193.2149 (b), operators must comply with the requirements of this section by assuming the space needed for drainage and collection of spilled liquid is an impounding system. Dispersion distance must be determined in accordance with the following dispersion parameters, using applicable parts of the mathematical model in Appendix B of the report, "Evaluation of LNG Vapor Control Methods," 1974, or a model for vapor dispersion which meets the requirements of subdivisions (ii) through (iv) in § 193.2057(c)(2):

(1) Average gas concentration in air = 2.5 percent.

(2) Dispersion conditions are a combination of those which result in longer predicted downwind dispersion distances than other weather conditions at the site at least 90 percent of the time, based on U.S. Government weather data, or as an alternative where the model used gives longer distances at lower wind speeds, Category F atmosphere, wind speed = 4.5 miles per hour, relative humidity equals 50.0 percent, and atmospheric temperatures = 0.0 C.

(3) Dispersion coordinates  $y$ ,  $z$ , and  $H$ , where applicable, = 0.

(d) *Vaporization design rate.* In computing dispersion distance under paragraph (c) of this section, the following applies:

(1) Vaporization results from the spill caused by an assumed rupture of a single transfer pipe (or multiple pipes that lack provisions to prevent parallel flow) which has the greatest overall flow capacity, discharging at maximum potential capacity, in accordance with the following conditions:

(i) The rate of vaporization is not less than the sum of flash vaporization and vaporization from boiling by heat transfer from contact surfaces during the time necessary for spill detection, instrument response, and automatic shutdown by the emergency shutdown system but, not less than 10 minutes, plus, in the case of impounding systems for LNG storage tanks with side or bottom penetrations, the time necessary for the liquid level in the tank to reach the level of the penetration or equilibrate with the liquid impounded assuming failures of the internal shutoff valve.

(ii) In determining variations in vaporization rate due to surface contact, the time necessary to wet 100 percent of the impounding floor area shall be determined by equation C-9 in the report "Evaluation of LNG Vapor Control Methods," 1974, or an alternate model which meets the requirements of subdivisions (ii) through (iv) in § 193.2057 (c) (2).

(iii) After spill flow is terminated, the rate of vaporization is vaporization of the remaining spillage, if any, from boiling by heat transfer from contact surfaces that are reducing in area and temperature as a function of time.

(iv) Vapor detention space is all space provided for liquid impoundment and vapor detention outside the component served, less the volume occupied by the spilled liquid at the time the vapor escapes the vapor detention space.

(2) The boiling rate of LNG on which dispersion distance is based is determined using the weighted average value of the thermal properties of the contact surfaces in the impounding space determined from eight representative experimental tests on the materials involved. If surfaces are insulated, the insulation must be designed, installed, and maintained so that it will retain its performance characteristics under spill conditions.

(e) *Planned vapor control.* An LNG facility need not have a dispersion exclusion zone if the Director finds that compliance with paragraph (a) of this section would be impractical and the operator prepares and follows a plan for controlling LNG vapor that is found acceptable by the Director. The plan must include circumstances under which LNG vapor is controlled to preclude the dispersion of a flammable mixture from the LNG facility under all predictable environmental conditions that could adversely affect control. The reliability of the method of control must be demonstrated by testing or experience with LNG spills.

§ 193.2061 *Seismic investigation and design forces.* (a) Except for shop fabricated storage tanks of 70,000 gallons or less capacity mounted within 2 feet of the ground, if an LNG facility is located at a site in Zone 0 or 1 of the "Seismic Risk Map of the United States," UBC, each operator shall determine, based on a study of faults, hydrologic regime, and soil conditions, whether a potential exists at the site for surface faulting or soil liquefaction.

(b) Subject to paragraph (f) of this section LNG facilities must be designed and built to withstand, without loss of structural or functional integrity, the following seismic design forces, as applicable:

(1) For LNG facilities (other than shop fabricated storage tanks of 70,000 gallons or less capacity mounted within 2 feet of the ground) located at a site in Puerto Rico in Zone 2, 3, or 4 of the "Seismic Risk Map of the United States," or at a site determined under paragraph (a) of this section to have a potential for surface faulting or soil liquefaction, the forces that could reasonably be expected to occur at the foundation of the facility due to the most critical ground motion, motion amplification, permanent differential ground displacement, soil liquefaction, and symmetric and asymmetric reaction forces resulting from hydrodynamic pressure and motion of contained liquid in interaction with the facility structure.

(2) For all other LNG facilities, the total lateral force set forth in UBC, Volume 1, corresponding to the zone of the "Seismic Risk Map of

the United States" in which the facility is located, and a vertical force equal to the total lateral force.

(c) Each operator of an LNG facility to which paragraph (b)(1) of this section applies shall determine the seismic design forces on the basis of a detailed geotechnical investigation and in accordance with paragraphs (d) and (e) of this section. The investigation must include each of the following items that could reasonably be expected to affect the site and be sufficient in scope to identify all hazards that could reasonably be expected to affect the facility design:

(1) Identification and evaluation of faults, Quaternary activity of those faults, tectonic structures, static and dynamic properties of materials underlying the site, and, as applicable, tectonic provinces within 100 miles of the site;

(2) Identification and evaluation of all historically reported earthquakes which could affect the determination under this section of the most critical ground motion or differential displacement at the site when correlated with particular faults, tectonic structures, and tectonic provinces, as applicable; and

(3) Identification and evaluation of the hydrologic regime and the potential of liquefaction-induced soil failures.

(d) The most critical ground motion must be determined in accordance with paragraph (e) of this section either:

(1) Probabilistically, when the available earthquake data are sufficient to show that the yearly probability of exceedance of most critical ground motion is  $10^{-4}$  or less; or

(2) Deterministically, when the available earthquake data are insufficient to provide probabilistic estimates, with the objective of determining a most critical ground motion with a yearly probability of exceedance of  $10^{-4}$  or less.

(e) The determination of most critical ground motion, considering local and regional seismological conditions, must be made by using the following:

(1) A regionally appropriate attenuation relationship, assuming that earthquakes occur at a location on a fault, tectonic structure, or tectonic province, as applicable, which would cause the most critical seismic movement at the site, except that where epicenters of historically reported earthquakes cannot be reasonably related to known faults or tectonic structures, but are recognized as being within a specific tectonic province which is within 100 miles of the site, assume that those earthquakes occur within their respective provinces at a source closest to the site.

(2) A horizontal design response spectrum determined from the mean plus one standard deviation of a freefield horizontal elastic response spectra whose spectral amplitudes are consistent with values expected for the most critical ground motion.

(3) A vertical design response spectrum that is either two-thirds of the amplitude of the horizontal design response spectrum at all frequencies

or equal to the horizontal design response spectrum where the site is located within 10 miles of the earthquake source.

(f) An LNG storage tank or its impounding system may not be located at a site where an investigation under paragraph (c) of this section shows that any of the following conditions exists unless the Director grants an approval for the site:

(1) The estimated design horizontal acceleration exceeds 0.8 g at the tank or dike foundation.

(2) The specific local geologic and seismic data base is sufficient to predict future differential surface displacement beneath the tank and dike area, but displacement not exceeding 30 inches cannot be assured with a high level of confidence.

(3) The specific local geologic and seismic data base is not sufficient to predict future differential surface displacement beneath the tank and dike area, and the estimated cumulative displacement of a Quaternary fault within one mile of the tank foundation exceeds 60 inches.

(4) The potential for soil liquefaction cannot be accommodated by design and construction in accordance with paragraph (b)(1) of this section.

(g) An application for approval of a site under paragraph (f) of this section must provide at least the following:

(1) A detailed analysis and evaluation of the geologic and seismic characteristics of the site based on the geotechnical investigation performed under paragraph (c) of this section, with emphasis on prediction of near field seismic response.

(2) The design plans and structural analysis for the tank, its impounding system, and related foundations, with a report demonstrating that the design requirements of this section are satisfied, including any test results or other documentation as appropriate.

(3) A description of safety-related features of the site or designs, in addition to those required by this part, if applicable, that would mitigate the potential effects of a catastrophic spill (e.g., remoteness or topographic features of the site, additional exclusion distances, or multiple barriers for containing or impounding LNG).

(h) Each container which does not have a structurally liquid-tight cover must have sufficient freeboard with an appropriate configuration to prevent the escape of liquid due to sloshing, wave action, and vertical liquid displacement caused by seismic action.

§ 193.2063 Flooding. (a) Each operator shall determine the effects of flooding on an LNG facility site based on the worst occurrence in a 100-year period. The determination must take into account:

- (1) Volume and velocity of the floodwater;
- (2) Tsunamis (local, regional, and distant);
- (3) Potential failure of dams;
- (4) Predictable land developments which would affect runoff accumulation of water; and

## (5) Tidal action.

(b) The effect of flooding determined under paragraph (a) of this section must be accommodated by location or design and construction, as applicable, to reasonably assure:

(1) The structural or functional integrity of LNG facilities; and

(2) Access from outside the LNG facility and movement of personnel and equipment about the LNG facility site for the control of fire and other emergencies.

§ 193.2065 **Soil characteristics.** (a) Soil investigations including borings and other appropriate tests must be made at the site of each LNG facility to determine bearing capacity, settlement characteristics, potential for erosion, and other soil characteristics applicable to the integrity of the facility.

(b) The naturally occurring or designed soil characteristics at each LNG facility site must provide load bearing capacities, using appropriate safety factors, which can support the following loads without excessive lateral or vertical movement that causes a loss of the functional or structural integrity of the facility involved:

(1) Static loading caused by the facility and its contents and any hydrostatic testing of the facility; and

(2) Dynamic loading caused by movement of contents of the facility during normal operation, including flow, sloshing, and rollover.

§ 193.2067 **Wind forces.** (a) LNG facilities must be designed to withstand without loss of structural or functional integrity:

(1) The direct effect of wind forces;

(2) The pressure differential between the interior and exterior of a confining, or partially confining, structure; and

(3) In the case of impounding systems for LNG storage tanks, impact forces and potential penetrations by wind borne missiles.

(b) The wind forces at the location of the specific facility must be based on one of the following:

(1) For shop fabricated containers of LNG or other hazardous fluids with a capacity of not more than 70,000 gallons, applicable wind load data in ANSI A 58.1, 1972 edition.

(2) For all other LNG facilities—

(i) An assumed sustained wind velocity of not less than 200 miles per hour, unless the Director finds a lower velocity is justified by adequate supportive data; or

(ii) The most critical combination of wind velocity and duration, with respect to the effect on the structure, having a probability of exceedance in a 50-year period of 0.5 percent or less, if adequate wind data are available and the probabilistic methodology is reliable.

§ 193.2069 **Other severe weather and natural conditions.** (a) In addition to the requirements of §§ 193.2061, 193.2063, 193.2065, and 193.2067, Register, January, 1985, No. 349



each operator shall determine from historical records and engineering studies the worst effect of other weather and natural conditions which may predictably occur at an LNG facility site.

(b) The facility must be located and designed so that such severe conditions cannot reasonably be expected to result in an emergency involving the factors listed in § 193.2063 (b).

§ 193.2071 Adjacent activities. (a) Each operator shall determine that present and reasonably foreseeable activities adjacent to an LNG facility site that could adversely affect the operation of the LNG facility or the safety of persons or offsite property, if damage to the facility occurs.

(b) An LNG facility must not be located where present or projected offsite activities would be reasonably expected to—

- (1) Adversely affect the operation of any of its safety control systems;
- (2) Cause failure of the facility; or
- (3) Cause the facility not to meet the requirements of this part.

§ 193.2073 Separation of facilities. Each LNG facility site must be large enough to provide for minimum separations between facilities and between facilities and the site boundary to—

(a) Permit movement of personnel, maintenance equipment, and emergency equipment around the facility; and

(b) Comply with distances specified in Sections 2-2.4 through 2-2.7 of NFPA 59A.

### Subpart C—Design

§ 193.2101 Scope. This subpart prescribes requirements for the selection and qualification of materials for components, and for the design and installation or construction of components and buildings, including separate requirements for impounding systems, LNG storage tanks, and transfer systems.

#### Materials

§ 193.2103 General. Materials for all components must be—

(a) Able to maintain their structural integrity under all design loadings, including applicable environmental design forces under Subpart B of this part;

(b) Physically, chemically, and thermally compatible within design limits with any fluid or other materials with which they are in contact; and

(c) Qualified in accordance with the applicable requirements of this subpart.

§ 193.2105 Extreme temperatures; normal operations. Each operator shall—

(a) Determine the range of temperatures to which components will be subjected during normal operations, including required testing, initial startup, cooldown operations, and shutdown conditions; and

(b) Use component materials that meet the design standards of this part for strength, ductility, and other properties throughout the entire range of temperatures to which the component will be subjected in normal operations.

§ 193.2107 **Extreme temperatures; emergency conditions.** (a) Each operator shall determine the effects on components not normally exposed to extreme cold (including a component's foundation or support system) of contact by LNG or cold refrigerant that could result from error, a spill, or other emergency determined as required by this part.

(b) Each operator shall determine the effects on components (including their foundations or support systems) of the extreme heat which could result from an LNG or other hazardous fluid fire.

(c) Where the exposure determined under paragraph (a) or (b) of this section could result in a failure that would worsen the emergency, the component or its foundation or support system, as appropriate, must be:

(1) Made of material or constructed to be suitable for the extreme temperature to which it could be subjected; or

(2) Protected by insulation or other means that will delay failure due to extreme temperature in order to allow adequate time to take emergency responses.

(d) If a material that has low resistance to flame temperatures is used in any component containing a hazardous fluid, the material must be protected so that any heat resulting from a controllable emergency does not cause the release of fluid that would result in an uncontrollable emergency.

§ 193.2109 **Insulation.** During normal operations, insulation materials must—

(a) Maintain insulating values;

(b) Withstand thermal and mechanical design loads; and

(c) Be covered with a material that is noncombustible in the installed state, is not subject to detrimental ultraviolet decay, and that can withstand the forces of wind according to ANSI A58.1 and anticipated loading which could occur in a controllable emergency.

§ 193.2111 **Cold boxes.** All cold boxes must be made of noncombustible material and the insulation must be made of materials which are noncombustible in the installed condition.

§ 193.2113 **Piping.** (a) Piping made of cast iron, malleable iron, or ductile iron may not be used to carry any cryogenic or hazardous fluids.

(b) Piping materials intended for normal use at temperatures below —28.9°C (—20°F) or for use under § 193.2107 (c) (1) must be qualified by testing in accordance with ANSI B 31.3 to comply with § 193.2103 (b).

§ 193.2115 Concrete subject to cryogenic temperatures. Concrete intended for normal use at cryogenic temperatures or for use under § 193.2107 (c) (1) may not be used unless—

(a) Materials, measurements, mixing, placing, prestressing, and post-stressing of concrete meets generally accepted engineering practices;

(b) Metallic reinforcing, prestressing wire, structural and nonstructural members used in concrete are acceptable in the installed condition for the temperature and stress levels encountered at design loading conditions; and

(c) Tests for the compressive strength, the coefficient of contraction, an acceptable thermal gradient, and, if applicable, acceptable surface loading to prevent detrimental spalling are performed on the concrete at the lowest temperature for which the concrete is designed or similar test data on these properties are available.

§ 193.2117 Combustible materials. Combustible materials are not permitted for the construction of buildings, plant equipment, and the foundations and supports of buildings and plant equipment in areas where ignition of the material would worsen an emergency. However, limited combustible materials may be used when the use of noncombustible materials is impractical.

§ 193.2119 Records. Each operator shall keep a record of all materials for components, buildings, foundations, and support systems, as necessary to verify that material properties meet the requirements of this part. These records must be maintained for the life of the item concerned.

### Design of Components and Buildings

§ 193.2121 General. Components, including their foundations and support systems, must be designed, fabricated, and installed to withstand, without loss of functional or structural integrity, predictable loadings not including environmental design forces under Subpart B of this part unless applicable under that subpart.

§ 193.2123 Valves. (a) Each valve, including control valves and relief valves, must be designed, manufactured, and tested to comply with ANSI B31.3 or ANSI B31.5 or ANSI B 31.8 or API Standard 6D, if design conditions fall within their scope.

(b) Extended bonnet valves must be used for service temperatures below  $-45.6^{\circ}\text{C}$  ( $-50^{\circ}\text{F}$ ).

(c) Valves used for cryogenic liquid service must be designed to operate in the position in which they are installed.

(d) Powered local and remote operation must be provided for valves intended for use during a controllable emergency that would be difficult or excessively time-consuming to operate manually during such an emergency.

(e) Valves must be designed and installed so that an excessive load on the piping system does not render the valve inoperable.

§ 193.2125 Automatic shutoff valves. Each automatic shutoff valve or combination of valves must—

- (a) Have a fail-safe design;
- (b) Operate to stop fluid flow which would endanger the operational integrity of plant equipment; and
- (c) Close at a rate to avoid fluid hammer which would endanger the operating integrity of a component.

§ 193.2127 Piping. (a) Piping must be designed, manufactured, and tested to comply with ANSI B 31.3.

(b) All cryogenic and hazardous fluid piping must have connections to facilitate blowdown and purge as required by this part.

(c) Each cryogenic or hazardous fluid piping system that is above-ground must be identified by color coding, painting, or labeling.

(d) Seamless pipe or pipe with a longitudinal joint efficiency of 1.0 determined in accordance with ANSI B31.3 or pipe with a design pressure less than two-thirds of the mill-proof test pressure or subsequent shop or field hydrostatic test pressure must be used for process and transfer piping handling cryogenic or other hazardous fluids with a service temperature below  $-22^{\circ}\text{F}$  ( $-30^{\circ}\text{C}$ ).

(e) For longitudinal or spiral weld piping handling LNG or cryogenic fluids, the heat affected zone must comply with § 323.2.2 of ANSI B31.3.

(f) Threaded piping used in hazardous fluid service must be at least Schedule 80.

§ 193.2129 Piping attachments and supports. Piping attachments and supports for LNG or refrigerant piping must be designed to prevent excessive heat transfer which can result in either unintentional restraint of piping caused by ice formations or the embrittlement of supporting steel.

§ 193.2131 Building design. (a) Each building or structural enclosure in which potentially hazardous quantities of flammable materials are handled must be designed and constructed to minimize fire hazards.

(b) Buildings or structural enclosures in which hazardous or cryogenic fluids are handled shall be of light-weight, noncombustible construction with nonload-bearing walls.

(c) If rooms containing such fluids are located within or attached to buildings in which such fluids are not handled, i.e., control rooms, shops, etc., the common walls shall be limited to not more than two in number, shall be designed to withstand a static pressure of at least 4800 Pa (100 psi), have no doors or other communicating openings, and shall have a fire resistance rating of at least 1 hour.

§ 193.2133 Buildings; ventilation. (a) Each building in which potentially hazardous quantities of flammable fluids are handled must be ventilated to minimize the possibility, during normal operation, of hazardous accumulation of a flammable gas and air mixture, hazardous products of combustion, and other hazardous vapors in enclosed process areas by one of the following means:

- (1) A continuously operating mechanical ventilation system;

(2) A combination gravity ventilation system and normally off mechanical ventilation system which is activated by suitable flammable gas detectors at a concentration not exceeding 25 percent of the lower flammable limit of the gas;

(3) A dual rate mechanical ventilation system with the high rate activated by suitable flammable gas detectors at a concentration not exceeding 25 percent of the lower flammable limit of the gas; or

(4) A gravity ventilation system composed of a combination of wall openings, roof ventilators, and, if there are basements or depressed floor levels, a supplemental mechanical ventilation system.

(b) The ventilation rate must be at least 1 cubic foot per minute of air per square foot of floor area. If vapors heavier than air can be present, the ventilation must be proportioned, according to the area of each level.

§ 193.2135 Expansion or contraction. Each operator shall consider the amount of contraction and expansion of each component during operating and environmental thermal cycling and shall—

(a) Provide components that operate without detrimental stress or restriction of movement, within each component and between components, caused by contraction and expansion; and

(b) Prevent ice buildup from detrimentally restricting the movement of components caused by contraction and expansion.

§ 193.2137 Frost heave. (a) Each operator shall—

(1) Determine which components and their foundations could be endangered by frost heave from ambient temperatures or operating temperatures of the component; and

(2) Provide protection against frost heave which might impair their structural integrity.

(b) For each component and foundation determined under paragraph (a) of this section, instrumentation must be installed to warn of potential structural impairment due to frost heave, unless the operator includes in the maintenance procedures required by this part, a method and schedule of inspection that will detect changes in the elevation.

§ 193.2139 Ice and snow. (a) Components must be designed to support the weight of ice and snow which could normally collect or form on them.

(b) Each operator shall provide protection for components from falling ice or snow which may accumulate on structures.

(c) Valves and moving components must not become inoperative due to ice formation on the component.

§ 193.2141 Electrical systems. (a) Each operator shall select and install electrical equipment and wiring for components in accordance with NFPA-70 and, where applicable Section 7-62 of NFPA-59A.

(b) Electrical grounding and bonding must be in accordance with Section 7-7.1.1 of NFPA-59A.

(c) Protective measures for stray or impressed currents must be provided in accordance with Section 7-7.3 of NFPA-59A.

§ 193.2143 **Lightning.** Each operator shall install proper grounds as necessary to minimize the hazard to plant personnel and components, including all electrical circuits, as a result of lightning.

§ 193.2145 **Boilers and pressure vessels.** Boilers must be designed and fabricated in accordance with Section I or Section IV of the ASME Boiler and Pressure Vessel Code. Other pressure vessels subject to that Code must be designed and fabricated in accordance with Division 1 or Division 2 of Section VIII.

§ 193.2147 **Combustion engines and turbines.** Combustion engines and gas turbines must be installed in accordance with NFPA-37.

### Impoundment Design and Capacity

§ 193.2149 **Impoundment required.** (a) An impounding system must be provided for storage tanks to contain a potential spill of LNG or other hazardous liquid.

(b) Grading or drainage or an impounding system must be provided to ensure that accidental spills or leaks from the following components and areas do not endanger components or adjoining property or enter navigable waterways:

- (1) Liquefaction and other process equipment;
- (2) Vaporizers;
- (3) Transfer systems;
- (4) Parking areas for tank cars or tank trucks; and
- (5) Areas for loading, unloading, or storing portable containers and dewar vessels.

(c) Impounding systems for LNG must be designed and constructed in accordance with this subpart. Impounding systems intended for containment of hazardous liquids other than LNG must meet the requirements of NFPA-30.

§ 193.2151 **General design characteristics.** (a) An impounding system must have a configuration or design which, to the maximum extent possible, will prevent liquid from escaping impoundment by leakage, splash from collapse of a structure or part thereof, momentum and low surface friction, foaming, failure of pressurized piping, and accidental pumping.

(b) The basic form of an impounding system may be excavation, a natural geological formation, manufactured diking, such as berms or walls, or any combination thereof.

§ 193.2153 **Classes of impounding systems.** (a) for the purpose of this part, impounding systems are classified as follows:

*Class 1.* A system which surrounds the component served with the inner surface of the dike constructed against or within 24 inches of the component served.

*Class 2.* A system which surrounds the component or area served with the dike located a distance away from the component or at the periphery of the area.

*Class 3.* A system which conducts a spill by dikes and floors to a remote impounding space which does not surround the component or area served.

(b) In the case of an impounding system consisting of a combination of classes, requirements of this part regarding a single class apply according to the percentage of impoundment provided by each class.

§ 193.2155 Structural requirements. (a) Subject to paragraph (b) of this section, the structural parts of an impounding system must be designed and constructed to prevent impairment of the system's performance reliability and structural integrity as a result of the following:

- (1) The imposed loading from—
  - (i) Full hydrostatic head of impounded LNG;
  - (ii) Hydrodynamic action, including the effect of any material injected into the system for spill control;
  - (iii) The impingement of the trajectory of an LNG jet discharged at any predictable angle; and
  - (iv) Anticipated hydraulic forces from a credible opening in the component or item served, assuming that the discharge pressure equals design pressure.
- (2) The erosive action from a spill, including jetting of spilling LNG, and any other anticipated erosive action including surface water runoff, ice formation, dislodgement of ice formation, and snow removal.
- (3) The effect of the temperature, any thermal gradient, and any other anticipated degradation resulting from sudden or localized contact with LNG.
- (4) Exposure to fire from impounded LNG or from sources other than impounded LNG.
- (5) If applicable, the potential impact and loading on the dike due to—
  - (i) Collapse of the component or item served or adjacent components; and
  - (ii) If the LNG facility adjoins the right-of-way of any highway or railroad, collision by or explosion of a train, tank car, or tank truck that could reasonably be expected to cause the most severe loading.
- (b) For spills from LNG storage tanks with Class 2 or 3 impounding systems, imposed loading and surging flow characteristics must be based on a credible release of the tank contents.

(c) If an LNG storage tank is located within a horizontal distance of 6,100 m. (20,000 ft.) from the nearest point of the nearest runway serving large aircraft as defined in 14 CFR Part 1.1, a Class 1 impounding system must be used which is designed to withstand collision by, or explosion of, the heaviest aircraft which can take off or land at the airport.

§ 193.2157 Coatings and coverings. Insulation, sealants, or other coatings and coverings which are part of an impounding system—

(a) Must be noncombustible in an installed condition when exposed to an LNG fire resulting from a spill that covers the floor of the impounding space;

(b) Must withstand exposure to fire from sources determined as required by this part, other than impounded LNG, for a period of time until fire protective or fire extinguishing action is taken; and

(c) When used for the purpose of maintaining the functional integrity of an impounding system, must be capable of withstanding sudden exposure to LNG without loss of such integrity.

§ 193.2159 Floors. Floors of Class 2 and Class 3 impounding systems must, to the extent feasible—

(a) Slope away from the component or item impounded and to a sump basin installed under § 193.2171;

(b) Slope away from the nearest adjacent component;

(c) Drain surface waters from the floor at rates based on a storm of 10-year frequency and 1-hour duration and other natural water sources; and

(d) Be designed to minimize the wetted floor area.

§ 193.2161 Dikes, general. (a) Penetrations in dikes to accommodate piping or any other purpose are prohibited.

(b) An outer wall of a component served by an impounding system may not be used as a dike except for a concrete wall designed to comply with the requirements of § 193.2155 (c) or equivalent design impact loading.

§ 193.2163 Vapor barriers. If vapor barriers are installed in meeting the requirements of § 193.2059, they must be designed and constructed to detain LNG vapor.

§ 193.2165 Dike dimensions. In addition to dike dimensions needed to comply with other requirements of this subpart, to minimize the possibility that a trajectory of accidentally discharged liquid would pass over the top of a dike, the horizontal distance from the inner wall of the component or vessel served to the closest inside edge of the top of the dike must at least equal the vertical distance from the maximum liquid level in the component or vessel to the inside edge of the top of the dike.

§ 193.2167 Covered systems. (a) A covered impounding system is prohibited unless it is—

(1) Sealed from the atmosphere and filled with an inert gas; or

(2) Permanently interconnected with the vapor space of the component served.

(b) Flammable nonmetallic membranous covering is prohibited in a covered system.

(c) For systems to which paragraph (a)(1) of this section applies, instrumentation and controls must be provided to—

(1) Maintain pressures at a safe level; and

(2) Monitor gas concentrations in accordance with § 193.2169.



(d) Dikes must have adequate structural strength to assure that they can withstand impact from a collapsed cover and all anticipated conditions which could cause a failure of the impounding space cover.

§ 193.2169 Gas leak detection. Appropriate areas within an impounding system where collection or passage of LNG or LNG vapor could be expected must be equipped with sensing and warning devices to monitor continuously for the presence of LNG or LNG vapor and to warn before LNG gas concentration levels exceed 25 percent of the lower flammable limit.

§ 193.2171 Sump basins. Except for Class 1 impounding systems, a sump basin must be located in each impounding system for collection of water.

§ 193.2173 Water removal. (a) Except for Class 1 systems, impounding systems must have sump pumps and piping running over the dike to remove water collecting in the sump basin.

(b) The water removal system must have adequate capacity to remove water at rates which equal the maximum predictable collection rate from a storm of 10-year frequency and 1-hour duration, and other natural causes.

(c) Sump pumps for water removal must—

(1) Be operated as necessary to keep the impounding space as dry as practical; and

(2) If sump pumps are designed for automatic operation, have redundant automatic shutdown controls to prevent operation when LNG is present.

§ 193.2175 Shared impoundment. When an impounding system serves more than one LNG storage tank, a means must be provided to prevent low temperature or fire resulting from leakage from any one of the storage tanks served causing any other storage tank to leak. The means must not result in a vapor dispersion distance which exceeds the exclusion zone required by § 193.2059.

§ 193.2179 Impoundment capacity; general. In addition to capacities otherwise required by this subpart, an impounding system must have sufficient volumetric capacity to provide for—

(a) Displacement by the component, tank car, tank truck, container, or dewar vessel served; and

(b) Where applicable, displacement which could occur when a higher density substance than the liquid to be impounded enters the system, considering all relevant means of assuring capacity.

§ 193.2181 Impoundment capacity; LNG storage tanks. (a) Except as provided in paragraph (b) of this section, each impounding system serving an LNG storage tank must have a minimum volumetric liquid impoundment capacity as follows:

Number of tanks in system	Class or type of system	System capacity in percent of LNG tank's maximum liquid capacity
1	Class 1	110 percent.
	Classes 2 and 3	150 percent.
More than 1	Classes 2 and 3	100 percent of all tanks or 150 percent of largest tank, whichever is greater.

(b) For purposes of this section, a covered impounding system serving a single LNG storage tank may have a capacity of 110 percent of the LNG tank's maximum liquid capacity if it is covered by a roof that is separate and independent from the LNG storage tank.

§ 193.2183 Impoundment capacity; equipment and transfer systems. If an impounding system serves a component under § 193.2149 (b) (1)-(3), it must have a minimum volumetric liquid impoundment capacity equal to the sum of—

(a) One-hundred percent of the volume of liquid that could be contained in the component and, where applicable, tank car or tank truck served; and

(b) The maximum volume of liquid which could discharge into the impounding space from any single failure of equipment or piping during the time period necessary for spill detection, instrument response, and sequenced shutdown by the automatic shutdown system under § 193.2439.

§ 193.2185 Impoundment capacity; parking areas, portable containers. Each impounding system serving an area listed under § 193.2149 (b) (4) or (5) must have a minimum volumetric liquid impoundment capacity which complies with the requirements of § 193.2181, assuming each tank car, tank truck, portable container, or dewar vessel to be a storage tank.

### LNG Storage Tanks

§ 193.2187 General. (a) LNG storage tanks must comply with the requirements of this subpart and the other applicable requirements of this part.

(b) A flammable nonmetallic membrane liner may not be used as an inner container in a storage tank.

§ 193.2189 Loading forces. Each part of an LNG storage tank must be designed to withstand without loss of functional or structural integrity any predictable combination of forces which would result in the highest stress to the part, including the following:

(a) Internal design pressure determined under § 193.2197.

(b) External design pressure determined under § 193.2199.

(c) Weight of the structure.

(d) Weight of liquid to be stored, except that in no case will the density assumed be less than 29.3 pounds per cubic foot (470 kilograms per cubic meter).

(e) Loads due to testing required by § 193.2327.

(f) Nonuniform reaction forces on the foundation due to predictable settling and other movement.

(g) Superimposed forces from piping, stairways, and other connected appurtenances.

(h) Predictable snow and ice loads.

(i) The loading of internal insulation on the inner container and outer shell due to compaction and movement of the container and shell over the design life of the insulation.

(j) In the case of vacuum insulation, the forces due to the vacuum.

(k) In the case of a positive pressure purge, the forces due to the maximum positive pressure of the purge gas.

§ 193.2191 Stratification. LNG storage tanks with a capacity of 5,000 barrels or more must be equipped with means to mitigate a potential for rollover and overpressure such as:

(a) Selective filling at the top and bottom of the tank;

(b) Circulating liquid from the bottom to the top of the same tank; or

(c) Transferring liquid selectively from the bottom of the tank to the bottom or top of any adjacent storage tank.

§ 193.2193 Movement and stress. (a) Each operator shall determine for normal operations of each LNG storage tank—

(1) The amount and pattern of predictable movement of components, including transfer piping, and the foundation, which could result from thermal cycling, loading forces, and ambient air changes; and

(2) For a storage tank with an inner container, the predictable movement of the inner container and the outer shell in relation to each other.

(b) Storage tanks must be designed to provide adequate allowance for stress due to movement determined under paragraph (a) of this section, including provisions that—

(1) Backfill does not cause excessive stresses on the tank structure due to expansion of the storage tank during warmup;

(2) Insulation does not settle to a damaging degree or unsafe condition during thermal cycling; and

(3) Expansion bends and other expansion or contraction devices are adequate to prevent excessive stress on tank penetrations, especially during cooldown from ambient temperatures.

§ 193.2195 Penetrations. (a) All penetrations in an LNG storage tank must be designed in accordance with API 620, including Appendix Q.

(b) The loadings on all penetrations must be determined by an analysis of all contributing forces, including those from tank thermal movements, connecting piping thermal movements, hydraulic forces, applicable wind and earthquake forces, and the forces resulting from settlement or movement of the tank foundation or pipe supports.

(c) All penetrations in an LNG storage tank below the design liquid level must be fitted with an internal shutoff valve which is designed and installed so that any failure of the nozzle penetrating the tank will be outside the tank.

(d) The requirements of paragraphs (a) and (c) of this section do not apply to shop fabricated tanks of 70,000 gallons or less capacity. All penetrations in such tanks must be designed and installed in accordance with the applicable provisions of Section VIII, Division 1 of the ASME Boiler and Pressure Vessel Code.

§ 193.2197 Internal design pressure. (a) Each operator shall establish the internal design pressure at the top of each LNG storage tank, including a suitable margin above the maximum allowable working pressure.

(b) The internal design pressure of a storage tank may not be lower than the highest pressure in the vapor space resulting from each of the following events or combination thereof that predictably might occur, giving consideration to vapor handling equipment, relief devices in accordance with § 193.2429, and any other mitigating measures:

(1) Filling the tank with LNG including effects of increased vaporization rate due to superheat and sensible heat of the added liquid;

(2) Rollover;

(3) Fall in barometric pressure, using the worst combination of amount of fall and rate of fall which might predictably occur;

(4) Loss of effective insulation that may result from an adjacent fire, leak of liquid into the intertank space, or other predictable accident; and

(5) Flash vaporization resulting from pump recirculation.

§ 193.2199 External design pressure. (a) Each operator shall establish the external design pressure at the top of each LNG storage tank, including a suitable margin below the minimum allowable working pressure.

(b) The external design pressure may not be higher than the lowest vapor pressure in the vapor space resulting from each of the following events or combinations thereof that predictably might occur, giving consideration to gas makeup systems, vacuum relief devices in accordance with § 193.2429, and any other mitigating measures.

(1) Withdrawing liquid from the tank;

(2) Withdrawing gas from the tank;

(3) Adding subcooled LNG to the tank; and

(4) Rise in barometric pressure, based on the worst combination of amount of rise and rate of rise which predictably might occur.

§ 193.2201 Internal temperature. The liquid container of each LNG storage tank and all tank parts used in contact with LNG or its cold vapor shall be designed for the lowest bulk liquid temperature which can be attained in the LNG storage tank.

§ 193.2203 Foundation. (a) Each LNG storage tank must have a stable foundation designed in accordance with generally accepted structural engineering practices.

(b) Each foundation must support design loading forces without detrimental settling that could impair the structural integrity of the tank.

§ 193.2205 Frost heave. If the protection provided for LNG storage tank foundations from frost heave under § 193.2137 (a) includes heating the foundation area—

(a) An instrumentation and alarm system must be provided to warn of malfunction of the heating system; and

(b) A means to correct the malfunction must be provided.

§ 193.2207 Insulation. (a) Insulation on the outside of the outer shell of an LNG storage tank may not be used to maintain stored LNG at an operating temperature during normal operation.

(b) Insulation between an inner container and the outer shell of an LNG storage tank must—

(1) Be compatible with the contained liquid and its vapor;

(2) In its installed condition, be noncombustible; and

(3) Not significantly lose insulating properties by melting, settling, or other means due to a fire resulting from a spill that covers the floor of the impounding space around the tank.

§ 193.2209 Instrumentation for LNG storage tanks. (a) LNG storage tank having a capacity over 70,000 gallons must be equipped with a sufficient number of sensing devices and personnel warning devices, as prescribed, which operate continuously while the tank is in operation to assure that each of the following conditions is not a potential hazard to the structural integrity or safety of the tank:

Condition	Instrumentation
(1) Amount of liquid in the tank.	Redundant liquid level gages and recorders with high level alarms, and a minimum of one independent high level alarm.
(2) Vapor pressure within the tank.	Redundant gages and recorders with high and low pressure alarms.
(3) Temperatures at representative critical points in the foundation.	Temperature indicating and recording devices with alarm.
(4) Temperature of contained liquid at various vertical intervals.	Temperature recorders.
(5) Abnormal temperature in tank structure.	Thermocouples located at representative critical points with recorders.
(6) Excessive relative movement of inner container and outer shell.	Linear and rotational movement indicators located between inner container and outer shell with recorders.

(b) LNG storage tanks with a capacity of 70,000 gallons or less must be equipped with the following:

(1) LNG liquid trycocks, when attended during the filling operation.

(2) Pressure gages and recorders with high pressure alarm.

(3) Differential pressure liquid level gage.

(c) Each storage tank must be designed as appropriate to provide for compliance with the inspection requirements of this part.

§ 193.2211 **Metal storage tanks.** (a) Metal storage tanks with internal design pressures of not more than 15 psig must be designed and constructed in accordance with API Standard 620 and, where applicable, Appendix Q of that standard.

(b) Metal storage tanks with internal design pressures above 15 psig must be designed in accordance with the applicable division of Section VIII of the ASME Boiler and Pressure Vessel Code.

§ 193.2213 **Concrete storage tanks.** Concrete storage tanks must be designed and constructed in accordance with Section 4-3 of NFPA-59A.

§ 193.2215 **Thermal barriers.** Thermal barriers must be provided between piping and an outer shell when necessary to prevent the outer shell from being exposed during normal operation to temperatures lower than its design temperature.

§ 193.2217 **Support system.** (a) Saddles and legs must be designed in accordance with generally accepted structural engineering practices, taking into account loads during transportation, erection loads, and thermal loads.

(b) Storage tank stress concentrations from support systems must be minimized by distribution of loads using pads, load rings, or other means.

(c) For a storage tank with an inner container, support systems must be designed to—

(1) Minimize thermal stresses imparted to the inner container and outer shell from expansion and contraction; and

(2) Sustain the maximum applicable loading from shipping and operating conditions.

(d) LNG storage tanks with an air space beneath the tank bottom or its foundation must be designed to withstand without loss of functional or structural integrity, the forces caused by the ignition of a combustible vapor cloud in this space.

§ 193.2219 **Internal piping.** Piping connected to an inner container that is located in the space between the inner container and outer shell must be designed for not less than the pressure rating of the inner container. The piping must contain expansion loops where necessary to protect against thermal and other secondary stresses created by operation of the tank. Bellows may not be used within the space between the inner container and outer shell.

§ 193.2221 **Marking.** (a) Each operator shall install and maintain a name plate in an accessible place on each storage tank and mark it in accordance with the applicable code or standard incorporated by reference in §§ 193.2211 or 193.2213.

(b) Each penetration in a storage tank must be marked indicating the function of the penetration.

(c) Marking required by this section must not be obscured by frosting.

**Design of Transfer Systems**

§ 193.2223 General. (a) Transfer systems must comply with the requirements of this subpart and other applicable requirements of this part.

(b) The design of transfer systems must provide for stress due to the frequency of thermal cycling and intermittent use to which the transfer system may be subjected.

(c) Slip type expansion joints are prohibited and packing-type joints may not be used in transfer systems for LNG or flammable refrigerants.

(d) A suitable means must be provided to precool the piping in a manner that prevents excessive stress prior to normal transfer of cold fluids.

(e) Stresses due to thermal and hydraulic shock in the piping system must be determined and accommodated by design to avoid damage to piping.

§ 193.2227 Backflow. (a) Each transfer system must operate with a means to—

(1) Prevent backflow of liquid from a receiving container, tank car, or tank truck from causing a hazardous condition; and

(2) Maintain one-way flow where necessary for the integrity or safe operation of the LNG facility.

(b) The means provided under paragraph (a)(1) of this section must be located as close as practical to the point of connection of the transfer system and the receiving container, tank car, or tank truck.

§ 193.2229 Cargo transfer systems. (a) Each cargo transfer system must have—

(1) A means of safely depressurizing and venting that system before disconnection;

(2) A means to provide for safe vapor displacement during transfer;

(3) Transfer piping, pumps, and compressors located or protected by suitable barriers so that they are safe from damage by tank car or tank truck movements;

(4) A signal light at each control location or remotely located pumps or compressors used for transfer which indicates whether the pump or compressor is off or in operation; and

(5) A means of communication between loading or unloading areas and other areas in which personnel are associated with the transfer operations.

(b) Hoses and arms for cargo transfer systems must be designed as follows—

(1) The design must accommodate operating pressures and temperatures encountered during the transfers;

(2) Hoses must have a bursting pressure of not less than five times the operating pressure.

(3) Arms must meet the requirements of ANSI B31.3.

(4) Adequate support must be provided, taking into account ice formation.

(5) Couplings must be designed for the frequency of any coupling or uncoupling.

§ 193.2231 Cargo transfer area. The transfer area of a cargo transfer system must be designed—

(a) To accommodate tank cars and tank trucks without excessive maneuvering; and

(b) To permit tank trucks to enter or exit the transfer area without backing.

§ 193.2233 Shutoff valves. (a) Shutoff valves on a transfer systems must be located—

(1) On each liquid supply line, or common line to multiple supply lines, to a storage tank, or to a cargo transfer system;

(2) On each vapor or liquid return line from multiple return lines, used in a cargo transfer system;

(3) At the connection of a transfer system with a pipeline subject to Part 192 of this chapter; and

(4) To provide for proper operation and maintenance of each transfer system.

(b) Transfer system shutoff valves that are designated for operation in the emergency procedures must be manually operable at the valve and power operable at the valve and at a remote location at least 50 feet from the valve.

#### Subpart D—Construction

§ 193.2301 Scope. This subpart prescribes requirements for the construction or installation of components.

§ 193.2303 Construction acceptance. No person may place in service any component until it passes all applicable inspections and tests prescribed by this subpart.

§ 193.2304 Corrosion control overview. (a) Subject to paragraph (b) of this section, components may not be constructed, repaired, replaced, or significantly altered until a person qualified under § 193.2707 (c) reviews the applicable design drawings and materials specifications from a corrosion control viewpoint and determines that the materials involved will not impair the safety or reliability of the component or any associated components.

(b) The repair, replacement, or significant alteration of components must be reviewed only if the action to be taken—

(1) Involves a change in the original materials specified;

(2) Is due to a failure caused by corrosion; or



(3) Is occasioned by inspection revealing a significant deterioration of the component due to corrosion.

§ 193.2305 Procedures. (a) In performing construction, installation, inspection, or testing, an operator must follow written specifications, procedures, and drawings, as appropriate, that are consistent with this part, taking into account relevant mechanical, chemical, and thermal properties, component functions, and environmental effects that are involved.

(b) All procedures, including any field revisions, must be substantiated by testing or experience to produce a component that is reliable and complies with the design and installation requirements of this part.

§ 193.2307 Inspection. (a) All construction, installation, and testing activities must be inspected as frequently as necessary in accordance with a written plan to assure that—

(1) Activities are in compliance with all applicable requirements of this subpart; and

(2) Components comply with the applicable material, design, fabrication, installation, and construction requirements of this part.

(b) In addition to the requirements of paragraph (a) of this section, the construction of concrete storage tanks must be inspected in accordance with ACI-311-75.

(c) Each operator shall have a quality assurance inspection program to verify that components comply with their design specifications and drawings, including any field design changes, before they are placed in service.

§ 193.2309 Inspection and testing methods Except as otherwise provided by this subpart, each operator shall determine, commensurate with the hazard that would result from failure of the component concerned, the scope and nature of—

(a) Inspections and tests required by this subpart; and

(b) Inspection and testing procedures required by § 193.2305.

§ 193.2311 Cleanup. After construction or installation, as the case may be, all components must be cleaned to remove all detrimental contaminants which could cause a hazard during operation, including the following:

(a) All flux residues used in brazing or soldering must be removed from the joints and the base metal to prevent corrosive solutions from being formed.

(b) All solvent type cleaners must be tested to ensure that they will not damage equipment integrity or reliability.

(c) Incompatible chemicals must be removed.

(d) All contaminants must be captured and disposed of in a manner that does not reduce the effectiveness of corrosion protection and monitoring provided as required by this part.

§ 193.2313 Pipe welding. (a) Each operator shall provide the following for welding on pressurized piping for LNG and other hazardous fluids:

(1) Welding procedures and welders qualified in accordance with Section IX of the ASME Boiler and Pressure Vessel Code or API 1104, as applicable;

(2) When welding materials that are qualified by impact testing, welding procedures selected to minimize degradation of low temperature properties of the pipe material; and

(3) When welding attachments to pipe, procedures and techniques selected to minimize the danger of burn-throughs and stress intensification.

(b) Oxygen fuel gas welding is not permitted on flammable fluid piping with a service temperature below  $-29^{\circ}\text{C}$  ( $-20^{\circ}\text{F}$ ).

(c) Marking materials for identifying welds on pipe must be compatible with the basic pipe material.

(d) Surfaces of components that are less than 6.35 mm (0.25 in.) thick may not be field die stamped.

(e) Where die stamping is permitted, any identification marks must be made with a die having blunt edges to minimize stress concentration.

§ 193.2315 Piping connections. (a) Piping more than 2 inches nominal diameter must be joined by welding, except that—

(1) Threaded or flanged connections may be used where necessary for special connections, including connections for material transitions, instrument connections, testing, and maintenance;

(2) Copper piping in nonflammable service may be joined by silver brazing; and

(3) Material transitions may be made by any joining technique proven reliable under § 193.2305 (b).

(b) If socket fittings are used, a clearance of 1.6 to 3.2 mm (0.063 to 0.126 in.) between the pipe end and the bottom of the socket recess must be provided and appropriate measurement reference marks made on the piping for the purpose of inspection.

(c) Threaded joints must be—

(1) Free of stress from external loading; and

(2) Seal welded, or sealed by other means which have been tested and proven reliable.

(d) Compression type couplings must meet the requirements of ANSI B31.3.

(e) Care shall be taken to ensure the tightness of all bolted connections. Spring washers or other such devices designed to compensate for the contraction and expansion of bolted connections during operating cycles shall be used where required.

(f) The selection of gasket material shall include the consideration of fire.

§ 193.2317 Retesting. After testing required by this subpart is completed on a component to contain a hazardous fluid, the component must be retested whenever—

- (a) Penetration welding other than tie-in welding is performed; or
- (b) The structural integrity of the component is disturbed.

§ 193.2319 Strength tests. (a) A strength test must be performed on each piping system and container to determine whether the component is capable of performing its design function, taking into account—

- (1) The maximum allowable working pressure;
- (2) The maximum weight of product which the component may contain or support;

(b) For piping, the test required by paragraph (a) of this section must include a pressure test conducted in accordance with Section 337 of ANSI B31.3, except that test pressures must be based on the design pressure. Carbon and low alloy steel piping must be pressure tested above their nil ductility transition temperature.

(c) All shells and internal parts of heat exchangers to which Section VIII, Division 1, or Division 2 of the ASME Boiler and Pressure Vessel Code, applies must be pressure tested, inspected, and stamped in accordance therewith.

§ 193.2321 Nondestructive tests. (a) The following percentages of each day's circumferentially welded pipe joints for hazardous fluid piping, selected at random, must be nondestructively tested over the entire circumference to indicate any defects which could adversely affect the integrity of the weld or pipe:

Weld type	Cryogenic piping	Other	Test method
Butt welds more than 2 inches in nominal size.	100	30	Radiographic or ultrasonic.
Butt welds 2 inches or less in nominal size.	100	30	Radiographic, ultrasonic, liquid penetrant, or magnetic particle.
Filled and socket welds.	100	30	Liquid penetrant or magnetic particle.

(b) Evaluation of weld tests and repair of defects must be in accordance with the requirements of ANSI B31.3 or API 1104, as applicable.

(c) Where longitudinally or spiral welded pipe is used in transfer systems, 100 percent of the seam weld must be examined by radiographic or ultrasonic inspection.

(d) The butt welds in metal shells of storage tanks with internal design pressure of not more than 15 psig must be radiographically tested in accordance with Section 0.7.6, API 620, Appendix Q, except that for hydraulic load bearing shells with curved surfaces that are subject to cryogenic temperatures, 100 percent of both longitudinal (or meridional) and circumferential or (or latitudinal) welds must be radiographically tested.

(e) The butt welds in metal shells of storage tanks with internal design pressure above 15 psig must be radiographically tested in accordance with Section IX of the ASME Boiler and Pressure Vessel Code, except

that for hydraulic load bearing shells with curved surfaces that are subject to cryogenic temperatures, 100 percent of both longitudinal (or meridional) and circumferential (or latitudinal) welds must be radiographically tested.

§ 193.2323 **Leak tests.** (a) Each container and piping system must be initially tested to assure that the component will contain the product for which it is designed without leakage.

(b) Shop fabricated containers and all flammable fluid piping must be leak tested to a minimum of the design pressure after installation but before placing it in service.

(c) For a storage tank with vacuum insulation, the inner container, outer shell, and all internal piping must be tested for vacuum leaks in accordance with an appropriate procedure.

§ 193.2325 **Testing control systems.** Each control system must be tested before being placed in service to assure that it has been installed properly and will function as required by this part.

§ 193.2327 **Storage tank tests.** (a) In addition to other applicable requirements of this subpart, storage tanks for cryogenic fluids with internal design pressures of not more than 15 psig must be tested in accordance with Sections Q8 and Q9 of API 620, Appendix Q, as applicable.

(b) Metal storage tanks for cryogenic fluids with internal design pressures above 15 psig must be tested in accordance with the applicable division of Section VIII of the ASME Boiler and Pressure Vessel Code.

(c) Reference measurements must be made with appropriate precise instruments to assure that the tank is gas tight and lateral and vertical movement of the storage tank does not exceed predetermined design tolerances.

§ 193.2329 **Construction records.** For the service life of the component concerned, each operator shall retain appropriate records of the following:

(a) Specifications, procedures, and drawings prepared for compliance with § 193.2305; and

(b) Results of tests, inspections, and the quality assurance program required by this subpart.

### Subpart E—Equipment

§ 193.2401 **Scope.** This subpart prescribes requirements for the design, fabrication, and installation of vaporization equipment, liquifaction equipment, and control systems.

#### Vaporization Equipment

§ 193.2403 **General.** Vaporizers must comply with the requirements of this subpart and the other applicable requirements of this part.

§ 193.2405 **Vaporizer design.** (a) Vaporizers must be designed and fabricated in accordance with applicable provisions of Section VIII, Division 1 of the ASME Boiler and Pressure Vessel Code.

(b) Each vaporizer must be designed for the maximum allowable working pressure at least equal to the maximum discharge pressure of the pump or pressurized container system supplying it, whichever is greater.

§ 193.2407 Operational control. (a) Vaporizers must be equipped with devices which monitor the inlet pressure of the LNG, the outlet temperature, and the pressure of the vaporized gas, and the inlet pressure of the heating medium fluids.

(b) Manifolded vaporizers must be equipped with:

(1) Two inlet valves in series to prevent LNG from entering an idle vaporizer; and

(2) A means to remove LNG or gas which accumulates between the valves.

§ 193.2409 Shutoff valves. (a) A shutoff valve must be located on transfer piping supplying LNG to a vaporizer. The shutoff valve must be located at a sufficient distance from the vaporizer to minimize potential for damage from explosion or fire at the vaporizer. If the vaporizer is installed in a building, the shutoff valve must be located outside the building.

(b) A shutoff valve must be located on each outlet of a vaporizer.

(c) For vaporizers designed to use a flammable intermediate fluid, a shutoff valve must be located on the inlet and outlet line of the intermediate fluid piping system where they will be operable during a controllable emergency involving the vaporizer.

§ 193.2411 Relief devices. The capacity of pressure relief devices required for vaporizers by § 193.2429 is governed by the following:

(a) For heated vaporizers, the capacity must be at least 110 percent of rated natural gas flow capacity without allowing the pressure to rise more than 10 percent above the vaporizer's maximum allowable working pressure.

(b) For ambient vaporizers, the capacity must be at least 150 percent of rated natural gas flow capacity without allowing the pressure to rise more than 10 percent above the vaporizer's maximum allowable working pressure.

§ 193.2413 Combustion air intakers. (a) Combustion air intakes to vaporizers must be equipped with sensing devices to detect the induction of a flammable vapor.

(b) If a heated vaporizer or vaporizer heater is located in a building, the combustion air intake must be located outside the building.

### Liquefaction Equipment

§ 193.2415 General. Liquefaction equipment must comply with the requirements of this subpart and the other applicable requirements of this part.

§ 193.2417 Control of incoming gas. A shutoff valve must be located on piping delivering natural gas to each liquefaction system.

**§ 193.2419 Backflow.**

Each multiple parallel piping system connected to liquefaction equipment must have devices to prevent backflow from causing a hazardous condition.

**§ 193.2421 Cold boxes.** (a) Each cold box in a liquefaction system must be equipped with a means of monitoring or detecting, as appropriate, the concentration of natural gas in the insulation space.

(b) If the insulation space in a cold box is designed to operate with a gas rich atmosphere, additional natural gas must be introduced when the concentration of gas falls to 30 percent.

(c) If the insulation space of a cold box is designed to operate with a gas free atmosphere, additional air or inert gas, as appropriate, must be introduced when the concentration of gas is 25 percent of the lower flammable limit.

**§ 193.2423 Air in gas.** Where incoming gas to liquefaction equipment contains air, each operator shall provide a means of preventing a flammable mixture from occurring under any operating condition.

### Control Systems

**§ 193.2427 General.** (a) Control systems must comply with the requirements of this subpart and other applicable requirements of this part.

(b) Each control system must be capable of performing its design function under normal operating conditions.

(c) Control systems must be designed and installed in a manner to permit maintenance, including inspection or testing, in accordance with this part.

(d) Local, remote, and redundant signal lines installed for control systems that can affect the operation of a component that does not fail safe must be routed separately or in separate underground conduits installed in accordance with NFPA-70.

**§ 193.2429 Relief devices.** (a) Each component containing a hazardous fluid must be equipped with a system of automatic relief devices which will release the contained fluid at a rate sufficient to prevent pressures from exceeding 110 percent of the maximum allowable working pressure. In establishing relief capacity, each operator shall consider trapping of fluid between valves; the maximum rates of boiloff and expansion of fluid which may occur during normal operation, particularly cooldown; and controllable emergencies.

(b) A component in which internal vacuum conditions can occur must be equipped with a system of relief devices or other control system to prevent development in the component of a vacuum that might create a hazardous condition. Introduction of gas into a component must not create a flammable mixture within the component.

(c) In addition to the control system required by paragraphs (a) and (b) of this section—

(1) Each LNG Storage tank must be equipped with relief devices to assure that design pressure and vacuum relief capacity is available during maintenance of the system; and

(2) A manual means must be provided to relieve pressure and vacuum in an emergency.

(d) Relief devices must be installed in a manner to minimize the possibility that release of fluid could—

(1) Cause an emergency; or

(2) Worsen a controllable emergency.

(e) The means for adjusting the setpoint pressure of all adjustable relief devices must be sealed.

(f) Relief devices which are installed to limit minimum or maximum pressure may not be used to handle boiloff and flash gases during normal operation.

§ 193.2431 Vents. (a) Hazardous fluids may not be relieved into the atmosphere of a building or other confined space.

(b) Boiloff vents for hazardous fluids may not draw in air during operation.

(c) Venting of natural gas/vapor under operational control which could produce a hazardous gas atmosphere must be directed to a flare stack or heat exchanger in order to raise its temperature to achieve positive buoyancy and safe venting.

§ 193.2433 Sensing devices. Each operator shall determine the appropriate location for and install sensing devices as necessary to—

(1) Monitor the operation of components to detect a malfunction which could cause a hazardous condition if permitted to continue; and

(2) Detect the presence of fire or combustible gas in areas determined in accordance with Section 500-4 of NFPA 70 to have a potential for the presence of flammable fluids.

(b) Buildings in which potentially hazardous quantities of flammable fluids are used or handled must be continuously monitored by gas sensing devices set to activate audible and visual alarms in the building and at the control center when the concentration of the fluid in air is not more than 25 percent of the lower flammable limit.

§ 193.2435 Warning devices. Each operator shall install warning devices in the control center to warn of hazardous conditions detected by all sensing devices required by this part. Warnings must be given both audibly and visibly and must be designed to gain the attention of personnel. Warnings must indicate the location and nature of the existing or potential hazard.

§ 193.2437 Pump and compressor control. (a) Each pump and compressor for hazardous fluids must be equipped with—

(1) A control system, operable locally and remotely, to shut down the pump or compressor in a controllable emergency;

(2) A signal light at the pump or compressor and the remote control location which indicates whether the pump or compressor is in operation or off;

(3) Adequate valving to ensure that the pump or compressor can be isolated for maintenance; and

(4) A check valve on each discharge line where pumps or compressors operate in parallel.

(b) Pumps or compressors in a cargo transfer system must have shutdown controls at the loading or unloading area and at the pump or compressor site.

§ 193.2439 Emergency shutdown control systems. (a) Each transfer system, vaporizer, liquefaction system, and storage system tank must be equipped with an emergency shutdown control system. The control must automatically actuate the shutdown of the component (providing pressure relief as necessary) when any of the following occurs:

(1) Temperatures of the component exceed the limits determined under § 193.2105;

(2) Pressure outside the limits of the maximum and minimum design pressure;

(3) Liquid in receiving vessel reaches the design maximum liquid level;

(4) Gas concentrations in the area of the component exceed 40 percent of the lower flammable limit;

(5) A sudden excessive pressure change or other condition indicating a potentially dangerous condition; and

(6) Presence of fire in area of component.

(b) For cargo transfer systems where all transfer operations are continuously manned and visually supervised by qualified personnel, actuation of the emergency shutdown control system may be manual after devices warn of the events listed in paragraph (a) of this section.

(c) Except for components that operate unattended and are remote from the control center, a reasonable delay may be programmed in emergency shutdown control systems required by this section between warning and automated shutdown to provide for manual response.

(d) Each LNG plant must have a shutdown control system to shut down all operations of the plant safely. The system must be operable at—

(1) The control center; and

(2) In the case of a plant where LNG facilities other than the control center are designed to operate unattended at the site of these facilities.

§ 193.2441 Control center. Each LNG plant must have a control center from which operations and warning devices are monitored as required by this part. A control center must have the following capabilities and characteristics—



(a) It must be located apart or protected from other LNG facilities so that it is operational during a controllable emergency.

(b) Each remotely actuated control system and each automatic shutdown control system required by this part must be operable from the control center.

(c) Each control center must have personnel in continuous attendance while any of the components under its control are in operation, unless the control is being performed from another control center which has personnel in continuous attendance.

(d) If more than one control center is located at an LNG Plant, each control center must have more than one means of communication with each other center.

(e) Each control center must have a means of communicating a warning of hazardous conditions to other locations within the plant frequented by personnel.

§ 193.2443 **Fail-safe control.** Control systems for components must have a fail-safe design. A safe condition must be maintained until personnel take appropriate action either to reactivate the component served or to prevent a hazard from occurring.

§ 193.2445 **Sources of power.** (a) Electrical control systems, means of communication, emergency lighting, and firefighting systems must have at least two sources of power which function so that failure of one source does not affect the capability of the other source.

(b) Where auxiliary generators are used as a second source of electrical power—

(1) They must be located apart or protected from components so that they are not unusable during a controllable emergency; and

(2) Fuel supply must be protected from hazards.

### Subpart F—Operations

§ 193.2501 **Scope.** This subpart prescribes requirements for the operation of LNG facilities.

§ 193.2503 **Operating procedures.** Each operator shall follow one or more manuals of written procedures to provide safety in normal operation and in responding to an abnormal operation that would affect safety. The procedures must include provisions for—

(a) Monitoring components or buildings according to the requirements of § 193.2507.

(b) Startup and shutdown, including for initial startup, performance testing to demonstrate that components will operate satisfactory in service.

(c) Recognizing abnormal operating conditions.

(d) Purging and inerting components according to the requirements of § 193.2517.

(e) In the case of vaporization, maintaining the vaporization rate, temperature and pressure so that the resultant gas is within limits established for the vaporizer and the downstream piping;

(f) In the case of liquefaction, maintaining temperatures, pressures, pressured differentials and flow rates, as applicable, within their design limits for:

- (1) Boilers;
- (2) Turbines and other prime movers;
- (3) Pumps, compressors, and expanders;
- (4) Purification and regeneration equipment; and
- (5) Equipment within cold boxes.

(g) Cooldown of components according to the requirements of § 193.2505; and

(h) Compliance with § 193.2805 (b).

§ 193.2505 Cooldown. (a) The cooldown of each system of components that is subjected to cryogenic temperatures must be limited to a rate and distribution pattern that keeps thermal stresses within design limits during the cooldown period, paying particular attention to the performance of expansion and contraction devices.

(b) After cooldown stabilization is reached, cryogenic piping systems must be checked for leaks in areas of flanges, valves, and seals.

§ 193.2507 Monitoring operations. Each component in operation or building determined under § 193.2805 (a) (2) in which a hazard to persons or property could exist must be monitored to detect fire or any malfunction or flammable fluid which could cause a hazardous condition. Monitoring must be accomplished by watching or listening from an attended control center for warning alarms, such as gas, temperature, pressure, vacuum, and flow alarms, or by conducting an inspection or test at intervals specified in the operating procedures.

§ 193.2509 Emergency procedures. (a) Each operator shall determine the types and places of emergencies other than fires that may reasonably be expected to occur at an LNG plant due to operating malfunctions, structural collapse, personnel error, forces of nature, and activities adjacent to the plant.

(b) To adequately handle each type of emergency identified under paragraph (a) of this section and each fire emergency identified under § 193.2817 (a), each operator shall follow one or more manuals of written procedures. The procedures must provide for the following:

(1) Responding to controllable emergencies, including notifying personnel and using equipment appropriate for handling the emergency.

(2) Recognizing an uncontrollable emergency and taking action to minimize harm to the public and personnel, including prompt notification of appropriate local officials of the emergency and possible need for evacuation of the public in the vicinity of the LNG plant.

(3) Coordinating with appropriate local officials in preparation of an emergency evacuation plan, which sets forth the steps required to protect the public in the event of an emergency, including catastrophic failure of an LNG storage tank.

(4) Cooperating with appropriate local officials in evacuations and emergencies requiring mutual assistance and keeping these officials advised of—

(i) The LNG plant fire control equipment, its location, and quantity of units located throughout the plant;

(ii) Potential hazards at the plant, including fires;

(iii) Communication and emergency control capabilities at the LNG plant; and

(iv) The status of each emergency.

§ 193.2511 Personnel safety. (a) Each operator shall provide any special protective clothing and equipment necessary for the safety of personnel while they are performing emergency response duties.

(b) All personnel who are normally on duty at a fixed location, such as a building or yard, where they could be harmed by thermal radiation from a burning pool of impounded liquid, must be provided a means of protection at that location from the harmful effects of thermal radiation or a means of escape.

(c) Each LNG plant must be equipped with suitable first-aid material, the location of which is clearly marked and readily available to personnel.

§ 193.2513 Transfer procedures. (a) Each transfer of LNG or other hazardous fluid must be conducted in accordance with one or more manuals of written procedures to provide for safe transfers.

(b) The transfer procedures must include provisions for personnel to:

(1) Before transfer, verify that the transfer system is ready for use, with connections and controls in proper positions, including if the system could contain a combustible mixture, verifying that it has been adequately purged in accordance with a procedure which meets the requirements of AGA "Purging Principles and Practice;"

(2) Before transfer, verify that each receiving container or tank vehicle does not contain any substance that would be incompatible with the incoming fluid and that there is sufficient capacity available to receive the amount of fluid to be transferred;

(3) Before transfer, verify the maximum filling volume of each receiving container or tank vehicle to ensure that expansion of the incoming fluid due to warming will not result in overfilling or overpressure;

(4) When making bulk transfer of LNG into a partially filled (excluding cooldown heel) container, determine any differences in temperature or specific gravity between the LNG being transferred and the LNG already in the container and, if necessary, provide a means to prevent rollover due to stratification;

(5) Verify that the transfer operations are proceeding within design conditions and that overpressure or overfilling does not occur by monitoring applicable flow rates, liquid levels, and vapor returns;

(6) Manually terminate the flow before overfilling or overpressure occurs; and

(7) Deactivate cargo transfer systems in a safe manner by depressurizing, venting, and disconnecting lines and conducting any other appropriate operations.

(c) In addition to the requirements of paragraph (b) of this section, the procedures for cargo transfer must be located at the transfer area and include provisions for personnel to:

(1) Be in constant attendance during all cargo transfer operations;

(2) Prohibit the backing of tank trucks in the transfer area, except when a person is positioned at the rear of the truck giving instructions to the driver;

(3) Before transfer, verify that—

(i) Each tank car or tank truck complies with applicable regulations governing its use;

(ii) All transfer hoses have been visually inspected for damage and defects;

(iii) Each tank truck is properly immobilized with chock wheels, and electrically grounded; and

(iv) Each tank truck engine is shut off unless it is required for transfer operations;

(4) Prevent a tank truck engine that is off during transfer operations from being restarted until the transfer lines have been disconnected and any released vapors have dissipated;

(5) Prevent loading LNG into a tank car or tank truck that is not in exclusive LNG service or that does not contain a positive pressure if it is in exclusive LNG service, until after the oxygen content in the tank is tested and if it exceeds 2 percent by volume, purged in accordance with a procedure that meets the requirements of AGA "Purging Principles and Practice;"

(6) Verify that all transfer lines have been disconnected and equipment cleared before the tank car or tank truck is moved from the transfer position; and

(7) Verify that transfers into a pipeline system will not exceed the pressure or temperature limits of the system.

§ 193.2515 Investigations of failures. (a) Each operator shall investigate the cause of each explosion, fire, or LNG spill or leak which results in—

(1) Death or injury requiring hospitalization; or

(2) Property damage exceeding \$10,000.

(b) As a result of the investigation, appropriate action must be taken to minimize reoccurrence of the incident.

(c) If the Director or relevant state agency under section 5 of the Natural Gas Pipeline Safety Act of 1968 (49 U.S.C. 1674) investigates an incident, the operator involved shall make available all relevant information and provide reasonable assistance in conducting the investigation. Unless necessary to restore or maintain service, or for safety, no component involved in the incident may be moved from its location or otherwise altered until the investigation is complete or the investigating agency otherwise provides. Where components must be moved for operational or safety reasons, they must not be removed from the plant site and must be maintained intact to the extent practicable until the investigation is complete or the investigating agency otherwise provides.

§ 193.2517 **Purging.** When necessary for safety, components that could accumulate significant amounts of combustible mixtures must be purged in accordance with a procedure which meets the provisions of the AGA "Purging Principles and Practice" after being taken out of service and before being returned to service.

§ 193.2519 **Communication systems.** (a) Each LNG plant must have a primary communication system that provides for verbal communications between all operating personnel at their work stations in the LNG plant.

(b) Each LNG plant in excess of 70,000 gallons storage capacity must have an emergency communication system that provides for verbal communications between all persons and locations necessary for the orderly shutdown of operating equipment and the operation of safety equipment in time of emergency. The emergency communication system must be independent of and physically separated from the primary communication system and the security communication system under § 193.2909.

(c) Each communication system required by this part must have an auxiliary source of power, except sound-powered equipment.

§ 193.2521 **Operating records.** Each operator shall maintain a record of the results of each inspection, test, and investigation required by this subpart. Such records must be kept for a period of not less than 5 years.

### Subpart G—Maintenance

§ 193.2601 **Scope.** This subpart prescribes requirements for maintaining components at LNG plants.

§ 193.2603 **General.** (a) Each component in service, including its support system, must be maintained in a condition that is compatible with its operational or safety purpose by repair, replacement, or other means.

(b) An operator may not place, return, or continue in service any component which is not maintained in accordance with this subpart.

(c) Each component taken out of service must be identified in the records kept under § 193.2639.

(d) If a safety device is taken out of service for maintenance, the component being served by the device must be taken out of service unless the same safety function is provided by an alternate means.

(e) If the inadvertent operation of a component taken out of service could cause a hazardous condition, that component must have a tag at-

tached to the controls bearing the words "do not operate" or words of comparable meaning.

§ 193.2605 **Maintenance procedures.** Each operator shall determine and perform, consistent with generally accepted engineering practice, the periodic inspections or tests needed to meet the applicable requirements of this subpart and to verify that components meet the maintenance standards prescribed by this subpart.

(b) Each operator shall follow one or more manuals of written procedures for the maintenance of each component, including any required corrosion control. The procedures must include—

(1) The details of the inspections or tests determined under paragraph (a) of this section and their frequency of performance; and

(2) A description of other actions necessary to maintain the LNG plant in accordance with the requirements of this subpart and § 193.2805.

§ 193.2607 **Foreign material.** (a) The presence of foreign material, contaminants, or ice shall be avoided or controlled to maintain the operational safety of each component.

(b) LNG plant grounds must be free from rubbish, debris, and other material which present a fire hazard. Grass areas on the LNG plant grounds must be maintained in a manner that does not present a fire hazard.

§ 193.2609 **Support systems.** Each support system or foundation of each component must be inspected for any detrimental change that could impair support.

§ 193.2611 **Fire protection.** (a) Maintenance activities on fire control equipment must be scheduled so that a minimum of equipment is taken out of service at any one time and is returned to service in a reasonable period of time.

(b) Access routes for movement of fire control equipment within each LNG plant must be maintained to reasonably provide for use in all weather conditions.

§ 193.2613 **Auxiliary power sources.** Each auxiliary power source must be tested monthly to check its operational capability and tested annually for capacity. The capacity test must take into account the power needed to start up and simultaneously operate equipment that would have to be served by that power source in an emergency.

§ 193.2615 **Isolating and purging.** (a) Before personnel begin maintenance activities on components handling flammable fluids which are isolated for maintenance, the component must be purged in accordance with a procedure which meets the requirements of AGA "Purging Principles and Practices," unless the maintenance procedures under § 193.2605 provide that the activity can be safely performed without purging.

(b) If the component or maintenance activity provides an ignition source, a technique in addition to isolation valves (such as removing spool pieces or valves and blank flanging the piping, or double block and bleed valving) must be used to ensure that the work area is free of flammable fluids.

§ 193.2617 Repairs. (a) Repair work on components must be performed and tested in a manner which—

(1) As far as practicable, complies with the applicable requirements of Subpart D of this part; and

(2) Assures the integrity and operational safety of the component being repaired.

(b) For repairs made while a component is operating, each operator shall include in the maintenance procedures under § 193.2605 appropriate precautions to maintain the safety of personnel and property during repair activities.

§ 193.2619 Control systems. (a) Each control system must be properly adjusted to operate within design limits.

(b) If a control system is out of service for 30 days or more, it must be inspected and tested for operational capability before returning it to service.

(c) Control systems in service, but not normally in operation (such as relief valves and automatic shutdown devices), must be inspected and tested once each calendar year, but with intervals not exceeding 15 months, with the following exceptions:

(1) Control systems used seasonally, such as for liquefaction or vaporization, must be inspected and tested before use each season.

(2) Control systems that are intended for fire protection must be inspected and tested at regular intervals not to exceed 6 months.

(d) Control systems that are normally in operation, such as required by a base load system, must be inspected and tested once each calendar year but with intervals not exceeding 15 months.

(e) Relief valves must be inspected and tested for verification of the valve seat lifting pressure and reseating.

§ 193.2621 Testing transfer hoses. Hoses used in LNG or flammable refrigerant transfer systems must be—

(a) Tested more each calendar year, but with intervals not exceeding 15 months, to the maximum pump pressure or relief valve setting; and

(b) Visually inspected for damage or defects before each use.

§ 193.2623 Inspecting LNG storage tanks. Each LNG storage tank must be inspected or tested to verify that each of the following conditions does not impair the structural integrity or safety of the tank:

(a) Foundation and tank movement during normal operation and after a major meteorological or geophysical disturbance.

(b) Inner tank leakage.

(c) Effectiveness of insulation.

(d) Frost heave.

§ 193.2625 Corrosion protection. (a) Each operator shall determine which metallic components could, unless corrosion is controlled, have

their integrity or reliability adversely affected by external, internal, or atmospheric corrosion during their intended service life.

(b) Components whose integrity or reliability could be adversely affected by corrosion must be either—

(1) Protected from corrosion in accordance with §§ 193.2627 thru 193.2635, as applicable; or

(2) Inspected and replaced under a program of scheduled maintenance in accordance with procedures established under § 193.2605.

§ 193.2627 Atmospheric corrosion control. Each exposed component that is subject to atmospheric corrosive attack must be protected from atmospheric corrosion by—

(a) Material that has been designed and selected to resist the corrosive atmosphere involved; or

(b) Suitable coating or jacketing.

§ 193.2629 External corrosion control; buried or submerged components.

(a) Each buried or submerged component that is subject to external corrosive attack must be protected from external corrosion by—

(1) Material that has been designed and selected to resist the corrosive environment involved; or

(2) The following means:

(i) An external protective coating designed and installed to prevent corrosion attack and to meet the requirements of § 192.461 of this chapter; and

(ii) A cathodic protection system designed to protect components in their entirety in accordance with the requirements of § 192.463 of this chapter and placed in operation before October 23, 1981, or, within 1 year after the component is constructed or installed, whichever is later.

(b) Where cathodic protection is applied, components that are electrically interconnected must be protected as a unit.

§ 193.2631 Internal corrosion control. Each component that is subject to internal corrosive attack must be protected from internal corrosion by—

(a) Material that has been designed and selected to resist the corrosive fluid involved; or

(b) Suitable coating, inhibitor, or other means.

§ 193.2633 Interference currents. (a) Each component that is subject to electrical current interference must be protected by a continuing program to minimize the detrimental effects of currents.

(b) Each cathodic protection system must be designed and installed so as to minimize any adverse effects it might cause to adjacent metal components.

(c) Each impressed current power source must be installed and maintained to prevent adverse interference with communications and control systems.



§ 193.2635 **Monitoring corrosion control.** Corrosion protection provided as required by this subpart must be periodically monitored to give early recognition of ineffective corrosion protection, including the following, as applicable:

(a) Each buried or submerged component under cathodic protection must be tested at least once each calendar year, but with intervals not exceeding 15 months, to determine whether the cathodic protection meets the requirements of § 192.463 of this Chapter.

(b) Each cathodic protection rectifier or other impressed current power source must be inspected at least 6 times each calendar year, but with intervals not exceeding 2½ months, to ensure that it is operating properly.

(c) Each reverse current switch, each diode, and each interference bond whose failure would jeopardize component protection must be electrically checked for proper performance at least 6 times each calendar year, but with intervals not exceeding 2½ months. Each other interference bond must be checked at least once each calendar year, but with intervals not exceeding 15 months.

(d) Each component that is protected from atmospheric corrosion must be inspected at intervals not exceeding 3 years.

(e) If a component is protected from internal corrosion, monitoring devices designed to detect internal corrosion, such as coupons or probes, must be located where corrosion is most likely to occur. However, monitoring is not required for corrosion resistant materials if the operator can demonstrate that the component will not be adversely affected by internal corrosion during its service life. Internal corrosion control monitoring devices must be checked at least two times each calendar year but with intervals not exceeding 7½ months.

§ 193.2637 **Remedial measures.** Prompt corrective or remedial action must be taken whenever an operator learns by inspection or otherwise that atmospheric, external, or internal corrosion is not controlled as required by this subpart.

§ 193.2639 **Maintenance records.** (a) Each operator shall keep a record at each LNG plant of the data and type of each maintenance activity performed on each component to meet the requirements of this subpart, including periodic tests and inspections, for a period of not less than five years.

(b) Each operator shall maintain records or maps to show the location of cathodically protected components, neighboring structures bonded to the cathodic protection system, and corrosion protection equipment.

(c) Each of the following records must be retained for as long as the LNG facility remains in service:

- (1) Each record or map required by paragraph (b) of this section.
- (2) Records of each test, survey, or inspection required by this subpart in sufficient detail to demonstrate the adequacy of corrosion control measures.

**Subpart H—Personnel Qualification and Training**

§ 193.2701 **Scope.** This subpart prescribes requirements for personnel qualifications and training.

§ 193.2703 **Design and fabrication.** For the design and fabrication of components, each operator shall use—

(a) With respect to design, persons who have demonstrated competence by training or experience in the design of comparable components.

(b) With respect to fabrication, persons who have demonstrated competence by training or experience in the fabrication of comparable components.

§ 193.2705 **Construction, installation, inspection, and testing.** (a) Supervisors and other personnel utilized for construction, installation, inspection, or testing must have demonstrated their capability to perform satisfactorily the assigned function by appropriate training in the methods and equipment to be used or related experience and accomplishments.

(b) Each operator must periodically determine whether inspectors performing duties under § 193.2307 are satisfactorily performing their assigned function.

§ 193.2707 **Operations and maintenance.** (a) Each operator shall utilize for operation or maintenance of components only those personnel who have demonstrated their capability to perform their assigned functions by—

(1) Successful completion of the training required by §§ 193.2713 and 193.2717; and

(2) Experience related to the assigned operation or maintenance function; and

(3) Acceptable performance on a proficiency test relevant to the assigned function.

(b) A person who does not meet the requirements of paragraph (a) of this section may operate or maintain a component when accompanied and directed by an individual who meets the requirements.

(c) Corrosion control procedures under § 193.2605 (b), including those for the design, installation, operation, and maintenance of cathodic protection systems, must be carried out by, or under the direction of a person qualified by experience and training in corrosion control technology.

§ 193.2709 **Security.** Personnel having security duties must be qualified to perform their assigned duties by successful completion of the training required under § 193.2715.

§ 193.2711 **Personnel health.** Each operator shall follow a written plan to verify that personnel assigned operating, maintenance, security, or fire protection duties at the LNG plant do not have any physical condition that would impair performance of their assigned duties. The plan must be designed to detect both readily observable disorders, such as physical handicaps or injury, and conditions requiring professional examination for discovery.

§ 193.2713 Training; operations and maintenance. (a) Each operator shall provide and implement a written plan of initial training to instruct—

(1) All permanent maintenance, operating, and supervisory personnel—

(i) About the characteristics and hazards of LNG and other flammable fluids used or handled at the facility, including, with regard to LNG, low temperatures, flammability of mixtures with air, odorless vapor, boiloff characteristics, and reaction to water and water spray;

(ii) About the potential hazards involved in operating and maintenance activities; and

(iii) To carry out aspects of the operating and maintenance procedures under §§ 193.2503 and 193.2605 that relate to their assigned functions; and

(2) All personnel—

(i) To carry out the emergency procedures under § 193.2509 that relate to their assigned functions; and

(ii) To give first-aid; and

(3) All operating and appropriate supervisory personnel—

(i) To understand detailed instruction on the facility operations, including controls, functions, and operating procedures; and

(ii) To understand the LNG transfer procedures provided under § 193.2513.

(b) A written plan of continuing instruction must be conducted at intervals of not more than two years to keep all personnel current on the knowledge and skills they gained in the program of initial instruction.

§ 193.2715 Training; security. (a) Personnel responsible for security at an LNG plant must be trained in accordance with a written plan of initial instruction to:

(1) Recognize breaches of security;

(2) Carry out the security procedures under § 193.2903 that relate to their assigned duties;

(3) Be familiar with basic plant operations and emergency procedures, as necessary to effectively perform their assigned duties; and

(4) Recognize conditions where security assistance is needed.

(b) A written plan of continuing instruction must be conducted at intervals of not more than two years to keep all personnel having security duties current on the knowledge and skills they gained in the program of initial instruction.

§ 193.2717 Training; fire protection. (a) All personnel involved in maintenance and operations of an LNG plant, including their immediate supervisors, must be trained in accordance with a written plan of initial instruction, including plant fire drills, to:

(1) Know and follow the fire prevention procedures under § 193.2805 (b);

(2) Know the potential causes and areas of fire determined under § 193.2805 (a);

(3) Know the types, sizes, and predictable consequences of fire determined under § 193.2817 (a); and

(4) Know and be able to perform their assigned fire control duties according to the procedures established under § 193.2509 and by proper use of equipment provided under § 193.2817.

(b) A written plan of continuing instruction, including plant fire drills, must be conducted at intervals of not more than two years to keep personnel current on the knowledge and skills they gained in the instruction under paragraph (a) of the section.

§ 193.2719 Training; records. (a) Each operator shall maintain a system of records which—

(1) Provide evidence that the training programs required by this subpart have been implemented; and

(2) Provide evidence that personnel have undergone and satisfactorily completed the required training programs.

(b) Records must be maintained for one year after personnel are no longer assigned duties at the LNG plant.

#### Subpart I—Fire Protection

§ 193.2801 Scope. This subpart prescribes requirements for fire prevention and fire control at LNG plants other than waterfront LNG plants.

§ 193.2803 General. Each operator shall use sound fire protection engineering principles to minimize the occurrence and consequences of fire.

§ 193.2805 Fire prevention plan. (a) Each operator shall determine—

(1) Those potential sources of ignition located inside and adjacent to the LNG plant which could cause fires that affect the safety of the plant; and

(2) These areas, as described in Section 500—4 of NFPA-70, where the potential exists for the presence of flammable fluids in an LNG plant. Determinations made under this paragraph must be kept current.

(b) With respect to areas determined under paragraph (a)(2) of this section, each operator shall include in the operating and maintenance procedures under § 193.2503 and § 193.2605, as appropriate, steps necessary to minimize—

(1) The leakage or release of flammable fluids; and

(2) The possibility of flammable fluids being ignited by sources identified under paragraph (a)(1) of this section.

§ 193.2807 Smoking. (a)(1) Smoking is prohibited at an LNG plant in areas identified under § 193.2805 (a) (2).

(2) Smoking is permitted only in such locations that the operator designates as a smoking area.

(b) Signs marked with the words "smoking permitted" must be displayed in prominent places in each smoking area designated under paragraph (a) of this section.

(c) Signs marked with the words "NO SMOKING" must be displayed in prominent places in areas where smoking is prohibited.

§ 193.2809 Open fires. (a) No open fires are permitted at an LNG plant, except at flare stacks and at times and places designated by the operator.

(b) Whenever an open fire is designated, there must be at the site of the fire—

(1) Trained fire fighting personnel; and

(2) Fire control equipment which has the capability of extinguishing the fire.

(c) The fire fighting personnel and equipment must remain at the fire site until the fire is extinguished and there is no possibility of reignition.

§ 193.2811 Hotwork. Welding, flame cutting, and similar operations are prohibited, except at times and places that the operator designates in writing as safe and when constantly supervised in accordance with NFPA-51B.

§ 193.2813 Storage of flammable fluids. Flammable fluids may not be stored in areas where ignition sources are present, unless stored in accordance with the requirements of Chapter 4 of NFPA 30.

§ 193.2815 Motorized equipment. Use of motor vehicles and other motorized equipment which constitute potential ignition sources is prohibited in an impounding space, in areas within 15 m (49.2 ft) of a storage tank, and in areas within 15 m (49.2 ft) of processing equipment containing a flammable fluid except—

(a) At times the operator designates in writing as safe; and

(b) When the motorized equipment is constantly attended.

§ 193.2817 Fire equipment. (a) Each operator shall determine: (1) the types and sizes of fires that may reasonably be expected to occur within and adjacent to each LNG plant that could affect the safety of components; and (2) The foreseeable consequences of these fires, including the failure of components or buildings due to heat exposure.

(b) Each operator shall provide and maintain fire control equipment and supplies in accordance with the applicable requirements of NFPA 59A to protect or cool components that could fail due to heat exposure from fires determined under paragraph (a) of this section and either worsen an emergency or endanger persons or property located outside the plant. Protection or cooling must be provided for as long as the heat exposure exists. The fire control equipment and supplies must include the following:

(1) Portable fire extinguishers suitable for types of fires identified under paragraph (a) of this section; and

(2) If the total inventory of LNG is 265 m<sup>3</sup> (70,000 gal.) or more, a water supply and associated delivery system.

(c) Each operator shall determine the type, size, quantity and location of the fire control equipment and supplies required under paragraph (b) of this section.

(d) Each operator shall provide each facility person who may be endangered by exposure to fire or the products of combustion in performing fire control duties protective clothing and equipment, including, if necessary, a self-contained breathing apparatus.

(e) Portable fire control equipment, protective clothing and equipment for personnel use, controls for fixed fire control equipment, and fire control supplies must be conspicuously located, marked for easy recognition, and readily available for use.

(f) Fire control equipment must have operating instructions. Instructions must be attached to portable equipment and placed at the location of controls for fixed equipment.

§ 193.2819 Gas detection. (a) All areas determined under § 193.2805 (a) (2) in which a hazard to persons or property could exist must be continuously monitored for the presence of flammable gases and vapors with fixed flammable gas detection systems provided and maintained according to the applicable requirements of NFPA 59A.

(b) Each fixed flammable gas detection system must be provided with audible and visible alarms located at an attended control room or control station, and an audible alarm in the area of gas detection.

(c) Flammable gas detection alarms must be set to activate at not more than 25 percent of the lower flammable limit of the gas or vapor being monitored.

(d) Gas detection systems must be installed as that they can be readily tested as required by NFPA 59A.

(e) A minimum of two portable flammable gas detectors capable of measuring the lower flammable limit must be available at the LNG plant for use at all times.

(f) All enclosed buildings located on an LNG plant must be continuously monitored for the presence of flammable gases and vapors with a fixed flammable gas detection system that provides a visible or audible alarm outside the enclosed building. The systems must be provided and maintained according to the applicable requirements of NFPA 59A.

§ 193.2821 Fire detection. (a) Fire detectors that continuously monitor for the presence of either flame, heat, or products of combustion must be provided in all areas determined under § 193.2805 (a) (2) in which a hazard to persons or property could exist and in all other areas that are used for the storage of flammable or combustible material.

(b) Each fire detection system must be provided with audible and visible alarms located at an attended control room or control station, and an audible alarm in the area of fire detection. The systems must be provided and maintained according to the applicable requirements of NFPA 59A.

**Subpart J—Security**

§ 193.2901 Scope. This subpart prescribes requirements for security at LNG plants other than waterfront LNG plants.

§ 193.2903 Security procedures. Each operator shall prepare and follow one or more manuals of written procedures to provide security for each LNG plant. The procedures must be available at the plant in accordance with § 193.2017 and include at least:

(a) A description and schedule of security inspections and patrols performed in accordance with § 193.2913;

(b) A list of security personnel positions or responsibilities utilized at the LNG plant;

(c) A brief description of the duties associated with each security personnel position or responsibility;

(d) Instructions for actions to be taken, including notification of other appropriate plant personnel and law enforcement officials, where there is any indication of an actual or attempted breach of security;

(e) Methods for determining which persons are allowed access to the LNG plant;

(f) Positive identifications of all persons entering the plant and on the plant, including methods at least as effective as picture badges; and

(g) Liaison with local law enforcement officials to keep them informed about current security procedures under this section.

§ 193.2905 Protective enclosures. (a) The following facilities must be surrounded by a protective enclosure:

- (1) Storage tanks;
- (2) Impounding systems;
- (3) Vapor barriers;
- (4) Cargo transfer systems;
- (5) Process, liquefaction, and vaporization equipment;
- (6) Control rooms and stations;
- (7) Control systems;
- (8) Fire control equipment;
- (9) Security communications systems; and
- (10) Alternative power sources.

The protective enclosure may be one or more separate enclosures surrounding a single facility or multiple facilities.

(b) Ground elevations outside a protective enclosure must be graded in a manner that does not impair the effectiveness of the enclosure.

(c) Protective enclosures may not be located near features outside of the facility, such as trees, poles, or buildings, which could be used to breach the security.

(d) At least two accesses must be provided in each protective enclosure and be located to minimize the escape distance in the event of emergency.

(e) Each access must be locked unless it is continuously guarded. During normal operations, an access may be unlocked only by persons designated in writing by the operator. During an emergency, a means must be readily available to all facility personnel within the protective enclosure to open each access.

§ 193.2907 Protective enclosure construction. (a) Each protective enclosure must have sufficient strength and configuration to obstruct unauthorized access to the facilities enclosed.

(b) Protective enclosures must be fences or walls constructed as follows:

(1) Fences must be chainlink security fences constructed of No. 11 American wire gauge or heavier metal wire.

(2) Walls must be vertical and constructed of stone, brick, cinder block, concrete, steel or comparable materials.

(3) Protective enclosures must be topped by three or more strands of barbed wire or similar materials on brackets angled outward between 30° and 45° from the vertical, with a height of at least 2.4m (8 ft.) including approximately one foot of barbed topping.

(4) Openings in or under protective enclosures must be secured by grates, doors or covers of construction and fastening of sufficient strength such that the integrity of the protective enclosure is not reduced by any opening.

(c) Paragraphs (b)(1) thru (b)(3) of the section do not apply to protective enclosures constructed before October 23, 1980.

(1) Are made of noncombustible materials;

(2) Are at least 2.1m (7 ft.) in height including approximately one foot of barbed or similar topping; and

(3) Have served to protect the LNG plant without having been breached during their history of service.

§ 193.2909 Security communications. A means must be provided for:

(a) Prompt communications between personnel having supervisory security duties and law enforcement officials; and

(b) Direct communications between all on-duty personnel having security duties and all control rooms and control stations.

§ 193.2911 Security lighting. Where security warning systems are not provided for security monitoring under § 193.2913, the area around the facilities listed under § 193.2905 (a) and each protective enclosure must be illuminated with a minimum in service lighting intensity of not less than 2.2 lux (0.2 ft.c) between sunset and sunrise.



§ 193.2913 **Security monitoring.** Each protective enclosure and the area around each facility listed in § 193.2905 (a) must be monitored for the presence of unauthorized persons. Monitoring must be by visual observation in accordance with the schedule in the security procedures under § 193.2903 (a) or by security warning systems that continuously transmit data to an attended location. At an LNG plant with less than 40,000 m<sup>3</sup> (250,000 bbl) of storage capacity, only the protective enclosure must be monitored.

§ 193.2915 **Alternative power sources.** An alternative source of power that meets the requirements of § 193.2445 must be provided for security lighting and security monitoring and warning systems required under §§ 193.2911 and 193.2913.

§ 193.2917 **Warning signs.** (a) Warning signs must be conspicuously placed along each protective enclosure at intervals so that at least one sign is recognizable at night from a distance of 30m (100 ft.) from any way that could reasonably be used to approach the enclosure.

(b) Signs must be marked with at least the following on a background of sharply contrasting color:

The words "NO TRESPASSING," or words of comparable meaning.

#### Appendix A to Part 193—Incorporation by Reference

##### *I. List of Organizations and Addresses*

A. American Concrete Institute (ACI), P.O. Box 19150, Redford Station, Detroit, Michigan 48219.

B. American Gas Association (AGA), 1515 Wilson Boulevard, Arlington, Virginia 22209.

C. American National Standards Institute (ANSI), 1430 Broadway, New York, New York 10018.

D. American Petroleum Institute (API), 2101 L. Street, NW., Washington, D.C. 20037.

E. American Society of Mechanical Engineers (ASME), United Engineering Center, 345 East 47th Street, New York, New York 10017.

F. National Fire Protection Association (NFPA), Batterymarch Park, Quincy, Mass. 02269.

G. International Conference of Building Officials, 5360 South Workman Hill Road, Whittier, California 90601.

##### *II. Documents Incorporated by Reference*

###### A. American Concrete Institute (ACI)

1. ACI Standard 311-75—Recommended Practice for Concrete Inspection, (1975 edition).

###### B. American Gas Association (AGA)

1. Evaluation of LNG Vapor control Methods. (October 1974 edition).

2. Purging Principles and Practice (1975 edition).

## C. American National Standards Institute (ANSI)

1. ANSI A 58.1 Building Code Requirements for Minimum Design Loads in Buildings and Other Structures.

## D. American Petroleum Institute (API)

1. API 620-Recommended Rules for Design and Construction of Large, Welded, Low Pressure Storage Tanks (6th edition, Dec. 1978)

2. API 1104 Standard for Welding Pipelines and Related Facilities (15th edition, 1980)

3. API 6D Specifications for Pipeline Valves (17 edition, 1977).

## E. American Society of Mechanical Engineers (ASME)

1. ANSI B31.3 Chemical and Plant Petroleum Refinery Piping (1976 edition).

2. ASME Boiler and Pressure Vessel Code, Section 1 Power Boilers (1977 edition).

3. ASME Boiler and Pressure Vessel Code, Section 8 Division 1 (1977 edition).

4. ASME Boiler and Pressure Vessel Code, Section 8 Division 2, Alternative Rules (1977 edition).

5. ASME Boiler and Pressure Vessel Code, Section 9 Welding and Brazing Qualifications (1977 edition).

6. ASME Boiler and Pressure Vessel Code, Section 4 Heating Boilers.

7. ANSI B31.5 Refrigeration Piping (1974 edition).

8. ANSI B31.8 Gas Transmission and Distribution Piping Systems (1975 edition).

## F. International Conference of Building Officials

1. UBC, Uniform Building Code (1979 edition).

## G. National Fire Protection Association (NFPA)

1. NFPA No. 37 Stationary Combustion Engine and Gas Turbines (1979 edition).

2. NFPA No. 59A Storage and Handling of LNG (1972 edition for § 193.2005 (c), otherwise 1979 edition).

3. NFPA No. 70 National Electric Code (1978 edition).

4. NFPA No. 30 Flammable Liquids (1981 edition).

5. NFPA No. 51 B Cutting and Welding Processes (1977 edition).

History: Cr. Register, May, 1972, No. 197, eff. 6-1-72; cr. 192.12, 192.379, appendix A-II F 4; am. 192.201 (a), 192.625 (g) (1), 192.717 (b), 192.727, Register, February, 1973, No. 206, eff. 3-1-73; am. PSC 192.457 (d), PSC 192.613 (c) (1), Register, June, 1974, No. 222, eff. 7-1-74; am. 192.3, 192.55 (a) (2) and (b) (2), 192.65, 192.197 (a), 192.625 (g) (1), appendix A-I, B, and II A, 1., 2., 3., and 5., appendix B, I, cr. appendix B, III, Register, December, 1974, No. 228, eff. 1-1-75; am. 192.59 (a) (1), (b) (1) and cr. (c), am. 192.65 (a), 192.225 (a), 192.227 (a) (2), 192.229 (c), 192.241 (c), 192.625 (a) and (b), 192.625 (g) (1), 192.705 (a) and (b), r. 192.705 (c), cr. 192.706, am. 192.707, appendix A II and appendix B I, Register, March, 1976, Register, January, 1985, No. 349

No. 243, eff. 4-1-76; revised, Register, April, 1977, No. 256, eff. 5-1-77; am. 192.13 (2), 192.313 (a) (4), 192.455 (f), 192.619 (a) (2) (ii), 192.707 (d) (1) and (e) (2) (i), cr. 192.14, 192.452 and 192.455 (f), Register, May, 1978, No. 269, eff. 6-1-78; cr. 192.283, 192.285, 192.287 and part 193., am. (1), 192.121, PSC 192.375, PSC 192.727, Appendix A, IIA and IIB, Appendix B, I, 192.281, 192.465 (a), 192.711 (b) and 192.713, r. 192.12, Register, December, 1981, No. 312, eff. 1-1-82; reprinted to correct error in 192.287, Register, March, 1983, No. 327; r. and recr. (2), 192.113, 192.117, 192.225 (a), 192.227 (a), 192.229 (c), Appendix A and BI, r. 192.17, cr. 192.375 (c), am. 192.7 (b) and (c), 192.145 (a), 192.163 (e), 192.225 (b) (1) and (2), 192.227 (b) (1) and (2), 192.237 (a), 192.239 (a) and (b), 192.241 (c), 192.557 (d) (1) and (3), Register, July, 1983, No. 331, eff. 8-1-83; am. 192.227 (c) 1 and (2), 192.283 (b) (5), 192.455 (f) (2), 192.706 (b), 192.721 (b), 192.723 (b) (1), 192.731 (c), 192.739 (intro.), 192.743 (a), 192.745, 192.747, 192.749 (a), Appendix AI, IIB, BI, 193.2313 (b), 193.2623 (intro.), 193.2629 (a) (2) (ii), 193.2917 (a) and Appendix AI, r. and recr. 192.619 (a) (2) (ii) (intro.), 192.705 (b), 192.707 (b) (2) (ii), r. 192.455 (f) (3) and cr. 192.614, Register, March, 1984, No. 339, eff. 4-1-84; am. 192.10 5 (b), 19R 143, 192.245 (a) and (b), 192.707 (a) and (b), 192.707 (d), 192.723 (a), (b), (c) and (d), renum. 192.723 (e) and (f) to be (f) and (g), cr. 192.144, 192.245 (c) and 192.723 (e), r. 192.707 (e) and (f), Register, January, 1985, No. 349, eff. 2-1-85.