

Chapter ILHR 22

ENERGY CONSERVATION

Subchapter I Scope and Purpose	ILHR 22.10	Indoor and outdoor temperatures (p. 84)
ILHR 22.01 Scope (p. 77)	ILHR 22.11	Moisture control for electrically heated dwellings (p. 84)
ILHR 22.02 Purpose (p. 77)	ILHR 22.12	Insulation standards (p. 86)
Subchapter III Design Criteria For Dwellings Which Use Fuels Other Than Electricity For Space Heating	ILHR 22.13	Infiltration control for electrically heated dwellings (p. 86)
ILHR 22.04 Indoor and outdoor temperatures (p. 77)	Subchapter VI Heating and Air Conditioning Equipment and Systems	
ILHR 22.05 Moisture control for non-electrically heated dwellings (p. 80)	ILHR 22.14	Scope (p. 90)
Subchapter IV Thermal Envelope Requirements For Dwellings Which Use Fuels Other Than Electricity For Space Heating	ILHR 22.15	Selection of equipment (p. 90)
ILHR 22.06 Insulation standards for non-electrically heated dwellings (p. 80)	ILHR 22.16	Temperature control (p. 90)
ILHR 22.07 Air leakage (p. 82)	ILHR 22.17	Zone control (p. 90)
Subchapter V Insulation and Infiltration Standards For Electrically Heated Dwellings	ILHR 22.18	Duct and pipe insulation (p. 90)
ILHR 22.08 Purpose and authority (p. 82)	ILHR 22.19	Equipment efficiencies (p. 91)
ILHR 22.085 Applications (p. 82)	ILHR 22.20	Electronic ignition and automatic flue dampering (p. 91)
ILHR 22.09 Accuracy of calculations (p. 84)	Subchapter VII Buildings Utilizing Solar, Wind or Other Nondepletable Energy Sources	
	ILHR 22.21	Innovative designs (p. 92)
	ILHR 22.22	Documentation (p. 92)

Note: Chapter Ind 22 was renumbered to be chapter ILHR 22, Register, February, 1985, No. 350, eff. 3-1-85.

Subchapter I — Scope and Purpose

**ILHR 22.01 Scope.** The provisions of this chapter shall apply to all newly constructed conventional and manufactured one- and 2-family dwellings.

History: Cr. Register, May, 1978, No. 269, eff. 12-1-78.

**ILHR 22.02 Purpose.** (1) The purpose of this chapter is to provide design requirements which will improve the utilization of energy in one- and 2-family dwellings as defined in s. ILHR 22.01, including minimum requirements for materials and methods of construction and for heating, cooling and air conditioning equipment and systems.

(2) The requirements of this chapter are intended to be flexible and to permit the use of innovative approaches and techniques to achieve effective utilization of energy.

(3) The requirements of this chapter are not intended to conflict with any safety or health requirements. Where such conflict occurs, the safety and health requirements shall govern.

History: Cr. Register, May, 1978, No. 269, eff. 12-1-78.

Subchapter III — Design Criteria For Dwellings Which Use Fuels Other Than Electricity For Space Heating

**ILHR 22.04 Indoor and outdoor temperatures.** The indoor temperatures listed in Table 22.04-A and the outdoor temperatures listed in Table

Register, March, 1992, No. 435


22.04-B shall be used to determine the total building heat loss or heat gain and to select the size of the heating or cooling equipment which is installed in dwellings which are not electrically heated.

TABLE 22.04-A  
INDOOR DESIGN TEMPERATURES

Season	Temperature
Winter	
All areas except nonhabitable basement areas	70° F
Unheated nonhabitable basement areas only	45° F
Summer	
All areas	78° F

TABLE 22.04-B  
OUTDOOR DESIGN CONDITIONS

Zone	Winter	Summer
	Design Temp. (°F)	Dry Bulb (°F)
1	-25	86
2	-20	87
3	-15	87
4	-10	89

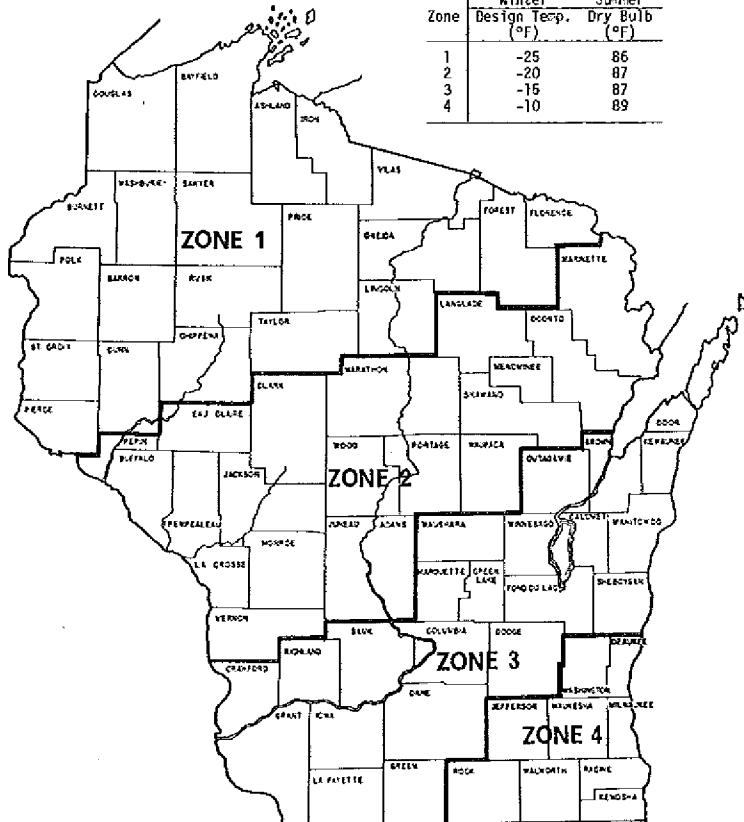

History: Cr. Register, May, 1978, No. 269, eff. 12-1-78; am. Register, July, 1986, No. 367, eff. 1-1-87; r. and recr. Table 22.04-A, Register, March, 1992, No. 436, eff. 4-1-92.

**ILHR 22.05 Moisture control for non-electrically heated dwellings.** The provisions of this section for moisture control shall apply to non-electrically heated dwellings.

(1) **VAPOR RETARDERS.** (a) Where thermal insulation is used, a vapor retarder shall be installed. The vapor retarder shall be installed on the interior side of the insulation, facing the heated interior, and behind the interior finish at the wall, ceiling and roof/ceiling assemblies.

(b) The vapor retarder shall cover the exposed insulation and the interior face of studs, joists and rafters. The vapor retarder shall be continuous in all areas except the box sill.

(c) Vapor retarders shall also be provided under slab and basement floors, and around the exterior insulation installed around ducts in unheated areas. Vapor retarders over crawl space floors shall be provided in accordance with s. ILHR 21.05 (4).

(d) The transmission rate of the vapor retarder shall not exceed one perm.

Note: Tongue-and-groove plywood may serve as the required vapor retarder where the transmission rate of the plywood does not exceed one perm.

(2) **RELATIVE HUMIDITY.** Where a power humidifier is installed, the humidifier shall be equipped with a control to regulate the relative humidity.

(3) **VENTILATION.** (a) *Attics.* Ventilation above the ceiling/attic insulation shall be provided.

1. The free ventilating area shall be at least 1/300 of the horizontal area of the ceiling. At least 50% of the required free ventilating area shall be distributed at the low sides of the roof, the remainder of the vents shall be provided in the upper one-half of the roof or attic area.

2. If all the ventilating area is provided at one level, then the ventilating area shall be at least 1/150 of the horizontal area of the ceiling.

3. The ventilation space above any non-rigid insulation in a cathedral ceiling assembly shall be at least one inch in height.

(b) *Crawl spaces.* Ventilation shall be provided in crawl spaces which are outside the thermal envelope. The area of ventilation shall be at least 1/1500 of the floor space. At least 50% of the ventilating area shall be provided at opposite sides of the crawl space or as far apart as possible.

History: Cr. Register, May, 1978, No. 269, eff. 12-1-78; cr. (intro), r. and recr. (3), Register, July, 1986, No. 367, eff. 1-1-87; am. (1), Register, January, 1989, No. 397, eff. 2-1-89; r. and recr. (1), Register, March, 1992, No. 435, eff. 4-1-92.

#### **Subchapter IV — Thermal Envelope Requirements For Dwellings Which Use Fuels Other Than Electricity For Space Heating**

**ILHR 22.06 Insulation standards for non-electrically heated dwellings.** The thermal envelope of dwellings which are not electrically heated shall be insulated to meet the requirements of sub. (1) or (2).

Note: If the office of state planning and energy certifies that there is a shortage of insulating materials that are routinely used in construction of one- and 2-family dwellings, the department will modify the requirements of s. ILHR 22.06 in accordance with the available supply of insulating material, with an emergency rule. When the office of state planning and energy Register, March, 1992, No. 435

certifies that shortages have been remedied, the department will reinstate the requirements of s. ILHR 22.06.

(1) COMPONENT METHOD. Each component of the thermal envelope shall meet the performance values specified in Table 22.06.

TABLE 22.06  
INSULATION STANDARDS FOR NONELECTRICALLY HEATED DWELLINGS

Component of Thermal Envelope	Maximum Overall Thermal Transmittance, $U_o$
Roof/Ceiling <sup>a</sup>	0.029
Walls:	
Exterior walls above the foundation wall <sup>b</sup>	0.12
Foundation walls above-grade 25% or less of the foundation wall exposed	0.25
More than 25% of the foundation wall exposed:	
Area equal to 25% fo the foundation wall	0.25
Remaining portion	0.12
Below-grade walls <sup>c</sup>	0.20
Floors:	
Slab-on-grade <sup>d</sup>	0.11
Over unconditioned spaces <sup>e</sup>	0.09

- <sup>a</sup> Roof/ceiling assemblies include attic access panels and sky lights.
- <sup>b</sup> Includes box sill, windows and doors.
- <sup>c</sup> The thermal transmittance value applies to the surface area which extends from grade to 3 feet below-grade, or to the top of the footing, whichever is less. The insulation type shall be suitable for the below-grade application.
- <sup>d</sup> The thermal transmittance value applies to a surface area which extends from the top of a slab to 48 inches vertically downward or horizontally or a combination thereof with a total dimension of 48 inches.
- <sup>e</sup> Includes unheated crawlspaces, basements, garages and other spaces outside of the thermal envelope.

(2) SYSTEM DESIGN. The overall thermal transmittance or  $U_o$  for any one component (such as wall, roof/ceiling or floor) may be increased and the  $U_o$  for other components decreased provided that the overall heat loss for the entire building enclosure does not exceed the total heat loss resulting from complying with sub. (1).

Note: See Appendix A for an example of the system design procedure.

(3) ACCURACY OF CALCULATIONS. (a) The thermal transmittance ( $U_o$ ) values and building dimensions used in heat gain or loss calculations shall have a minimum decimal accuracy of 3 places rounded to 2, except that the  $U_o$  values used for calculating ceiling transmission shall have a minimum decimal accuracy of 4 places rounded to 3.

(b) The thermal resistance or thermal transmittance values used in heat gain or loss calculations shall be those given in the ASHRAE Handbook of Fundamentals or shall be substantiated by the submittal of test data from an independent laboratory that verifies the claimed thermal resistance for the specific application of the product.

Note: See Appendix for a table of R-values reprinted from the ASHRAE Handbook of Fundamentals.

History: Cr. Register, May, 1978, No. 269, eff. 12-1-78; r. (5) and (6) eff. 3-31-79 and cr. (6a) and (6a), eff. 4-1-79; r. (6a), eff. 3-31-80 and cr. (6b), eff. 4-1-80; am. (intro.), renum. (5a) and (6b) to be (5) and (6) and am., Register, July, 1986, No. 367, eff. 1-1-87; am. (9), Register, January, 1989, No. 397, eff. 2-1-89; am. (intro.), r. and recr. (1), r. (2) to (3), renum. (9) and (10) to be (2) and (3) (a) and am. (2), cr. Table 22.06 and (3) (b), Register, March, 1992, No. 435, eff. 4-1-92.

Register, March, 1992, No. 435

**ILHR 22.07 Air leakage.** Provisions for the limitation of air leakage in dwellings which are not electrically heated shall be made in accordance with this section.

(1) **GENERAL.** All windows and doors shall be constructed and installed to minimize air leakage.

(2) **DOORS AND WINDOWS.** Manufactured windows shall be constructed and installed to limit infiltration to .5 cubic feet per minute per foot of sash crack. The air infiltration rate of sliding glass doors shall not exceed .5 cubic feet per minute per square foot of door area. The air infiltration rate for swinging doors shall not exceed 1.25 cubic feet per minute per square foot of door area.

*Note:* The department will recognize windows and doors tested in conformance with ASTM E-283, Standard Method of Test for Rate of Air Leakage Through Exterior Curtain Walls and Doors.

(3) **EXTERIOR OPENINGS.** Exterior joints around windows and door frames; between wall cavities and window or door frames; between walls and foundations; between walls and roofs; between walls and floors; between separate wall panels; at penetrations of utility services through walls, floors and roofs; and all other openings in the exterior building envelope shall be caulked, gasketed, weatherstripped or otherwise sealed.

(4) **INTERIOR OPENINGS.** Openings through the top plate of frame walls shall be caulked, gasketed, packed with insulation, or otherwise sealed.

*History:* Cr. Register, May, 1978, No. 269, eff. 12-1-78; cr. (intro.), Register, July, 1986, No. 367, eff. 1-1-87.

#### **Subchapter V — Insulation and Infiltration Standards For Electrically Heated Dwellings**

**ILHR 22.08 Purpose and authority.** The purpose of this subchapter is to provide design requirements to improve energy efficiency of conventionally built and manufactured one- and 2-family dwellings which use electricity for space heating as required by ss. 101.63 (1m) and 101.73 (1m), Stats.

*History:* Cr. Register, July, 1986, No. 367, eff. 1-1-87.

**ILHR 22.085 Applications.** (1) **NEW DWELLINGS.** The provisions of this subchapter shall apply to any new electrically heated dwelling or dwelling unit for which a uniform building permit was issued on or after January 1, 1987.

(2) **DWELLINGS EXISTING BEFORE DECEMBER 1, 1978.** The provisions of this subchapter shall not apply to any dwelling or dwelling unit for which a uniform building permit was issued before December 1, 1978, or to additions or alterations to such dwellings.

(3) **ADDITIONS TO DWELLINGS OR DWELLING UNITS.** (a) Additions to a dwelling or dwelling unit shall be constructed in compliance with the requirements of this subsection whenever one of the following conditions apply:

1. The uniform building permit for the original dwelling or dwelling unit was issued on or after January 1, 1987, and the dwelling or dwelling unit is electrically heated; or

Register, March, 1992, No. 435

2. The uniform building permit for the original dwelling or dwelling unit was issued on or after January 1, 1987, and the combined input capacity of permanently installed electrical space heating equipment of the original dwelling or dwelling unit and the new addition exceeds 3 kilowatts; or

3. The uniform building permit for the original dwelling or dwelling unit was issued on or after December 1, 1978, but before January 1, 1987, and the addition is provided with permanently installed electrical space heating equipment with an input capacity of 3 kilowatts or more.

(b) An addition to a dwelling or dwelling unit to which one of the 3 conditions of par. (a) apply, shall be insulated to meet the requirements of s. ILHR 22.12 with one of the following methods.

1. The addition alone may be insulated in accordance with s. ILHR 22.12 (1) via the component method;

2. The addition alone may be insulated in accordance with s. ILHR 22.12 (2) via the system method; or

3. The entire dwelling, including the addition, may be insulated in accordance with s. ILHR 22.12 (2) via the system method.

(4) ALTERATIONS TO DWELLINGS OR DWELLING UNITS CONSTRUCTED AFTER JANUARY 1, 1987. (a) *Electrically heated dwellings or dwelling units.* Any alteration made to an electrically heated dwelling or dwelling unit for which a uniform building permit was issued on or after January 1, 1987 shall be made in accordance with the provisions of this subchapter which are in effect at the time the permit for the alteration is issued.

(b) *Non-electrically heated dwellings and dwelling units.* 1. Whenever an alteration to a non-electrically heated dwelling or dwelling unit for which a uniform dwelling permit was issued on or after January 1, 1987, results in the addition of permanently installed space heating equipment so that the combined input capacity of all sources of permanently installed electrical space heating equipment in the dwelling or dwelling unit exceeds 3 kilowatts, the alteration shall be performed in accordance with the requirements of this subchapter which are in effect at the time that the permit for the alteration is issued.

2. Alterations which do not result in an increase in the electric space heating input capacity to over 3 kilowatts, shall be made in compliance with the provisions of subchapters III and IV which are in effect at the time the permit for alterations is issued.

(5) ALTERATIONS TO DWELLINGS OR DWELLING UNITS CONSTRUCTED AFTER DECEMBER 1, 1978, BUT BEFORE JANUARY 1, 1987. Any alteration which is made to a dwelling or dwelling unit for which a uniform building permit was issued on or after December 1, 1978, but before January 1, 1987, shall be made in compliance with the requirements for non-electrically heated dwellings specified in this chapter which are in effect at the time the permit for the alteration is issued.

Note: The intent of this subsection is to assure that a dwelling which is built in accordance with this code continues to meet minimum health, safety and energy conservation standards whenever additions and alterations are made to the dwelling. It is not the intent of this section however, to require additional modifications beyond those necessary to achieve the intended alteration or addition. For example, if a window is being replaced, the replacement window must meet the infiltration and thermal transmission requirements of the current code. If new windows are to be cut into the exterior wall, the new windows must meet code

## ILHR 22

requirements and, because insulation had to be removed from the wall to put in the windows, the insulation requirements of the current code must be met by using either the component or system method. As another example, when electric heat is added to the basement area and the walls are not to be altered, insulation does not have to be installed. If insulation is removed from the basement ceiling, however, to create a heated basement, the insulation requirements of the current code must be met by the component or system method.

History: Cr. Register, July, 1986, No. 367, eff. 1-1-87.

**ILHR 22.09 Accuracy of calculations.** (1) The thermal transmittance values used in heat gain or loss calculations shall have a minimum decimal accuracy of 4 places, rounded to 3.

(2) The thermal resistance or thermal transmittance values used in heat gain or loss calculations shall be those given in the ASHRAE Handbook of Fundamentals or shall be substantiated by the submittal of test data from an independent laboratory that verifies the claimed thermal resistance for the specific application of the product.

Note: See the Appendix for a table of R-values reprinted from the ASHRAE Handbook of Fundamentals.

History: Cr. Register, July, 1986, No. 367, eff. 1-1-87; r. and recr. Register, March, 1992, No. 435, eff. 4-1-92.

**ILHR 22.10 Indoor and outdoor temperatures.** The indoor temperatures listed in Table 22.10-A and the outdoor temperatures listed in Table 22.04-B shall be used to determine the total building heat loss or gain and to select the size of the heating or cooling equipment which is installed in electrically heated dwellings in accordance with s. ILHR 22.15.

TABLE 22.10-A  
INDOOR DESIGN TEMPERATURES

Season	Temperature
Winter	
All areas except nonhabitable basement areas	70° F
Unheated nonhabitable basement areas only	45° F
Summer	
All areas	78° F

History: Cr. Register, July, 1986, No. 367, eff. 1-1-87; r. and recr. Table 22.10-A, Register, March, 1992, No. 435, eff. 4-1-92.

**ILHR 22.11 Moisture control for electrically heated dwellings.** Provisions for the control of moisture in electrically heated dwellings shall be made in accordance with this section.

(1) **VAPOR RETARDERS.** (a) A vapor retarder shall be installed to prevent water vapor from condensing within the insulated cavity. The vapor retarder shall be installed on the interior side of the insulation, facing the heated interior, and behind the interior finish at the wall, ceiling and roof/ceiling assemblies.

(b) The vapor retarder shall cover the exposed insulation and the interior face of studs, joists and rafters. All joints in the vapor retarder shall be overlapped and secured or sealed. Rips and punctures in the vapor retarder shall be patched with vapor retarder materials and taped or sealed. Openings in the vapor retarder around electrical boxes and other utility services shall be taped or sealed.

Register, March, 1992, No. 435



(c) Vapor retarders shall also be provided under slab and basement floors, and around the exterior insulation installed around ducts in unheated areas. Vapor retarders over crawl space floors shall be provided in accordance with s. ILHR 21.05 (4).

(d) The transmission rate of the vapor retarder shall not exceed 0.1 perm.

(2) **RELATIVE HUMIDITY.** Where a power humidifier is installed, the equipment shall be provided with a control to regulate the relative humidity.

(3) **VENTILATION.** (a) *Attics.* Ventilation above the ceiling/attic insulation shall be provided.

1. The free ventilating area shall be at least 1/300 of the horizontal area of the ceiling. At least 50% of the required free ventilating area shall be distributed at the low sides of the roof, the remainder of the vents shall be provided in the upper one-half of the roof or attic area.

2. If all the ventilating area is provided at one level, then the ventilating area shall be at least 1/150 of the horizontal area of the ceiling.

3. The ventilation space above any non-rigid insulation in a cathedral ceiling assembly shall be at least one inch in height.

(b) *Crawl spaces.* Ventilation shall be provided in crawl spaces which are outside the thermal envelope. The area of ventilation shall be at least 1/1500 of the floor space. At least 50% of the ventilating area shall be provided at opposite sides of the crawl space or as far apart as possible.

(c) *Clothes dryers.* If clothes dryers are provided, the dryers shall be vented to the outside of the building. The dryer vents may not terminate in an attic space or crawl space or basement.

(4) **AIR QUALITY.** (a) *General.* All electrically heated dwellings shall be provided with mechanical ventilation equipment.

1. The equipment shall be capable of providing 0.5 air changes per hour upon demand to the living space within the thermal envelope, or shall be capable of providing 0.5 air changes per hour to individual rooms of the living area during periods of occupancy.

2. The mechanical ventilation equipment may consist of one or more exhaust fans.

3. The air intakes may be operable windows or dampered openings.

4. All exhaust vents shall terminate outside the building.

5. Habitable spaces within basements shall be considered to be part of the living space.

(b) *Dwellings with combustion appliances and high ventilation rates.* Dwellings which are provided with gas-fired, oil-fired, solid fuel burning appliances or fireplaces and are also provided with mechanical ventilation systems capable of providing one air change per hour or more to the living space shall be provided with dampered outside air intakes.

Note 1: Residences with low levels of infiltration or occupants who smoke or situations which release pollutants or large quantities of moisture to the air may require a more exten-

sive mechanical system or a greater number of air changes to assure a sufficient level of air quality.

Note 2: Information on ventilation capacity calculations is contained in the energy worksheet.

Note 3: An example of the energy worksheet is contained in Appendix A22.

History: Cr. Register, July, 1986, No. 367, eff. 1-1-87; r. and recr. (1), Register, March, 1992, No. 435, eff. 4-1-92.

**ILHR 22.12 Insulation standards.** Electrically heated dwellings shall be insulated to meet the requirements specified in sub. (1) or (2).

(1) **COMPONENT METHOD.** Each component of the thermal envelope of an electrically heated dwelling shall meet the thermal performance values specified in Table 22.12-1.

Note: Additional explanatory material is contained in the appendix.

TABLE 22.12-1

INSULATION STANDARDS FOR ELECTRICALLY HEATED DWELLINGS

Component of Thermal Envelope	Maximum Overall Thermal Transmittances, $U_o$
Roof-Ceiling <sup>a</sup>	0.020
Walls:	
above grade <sup>b</sup>	0.080
below grade <sup>c</sup>	0.100
Floors:	
slab-on-grade <sup>d</sup>	0.100
over unconditioned spaces <sup>e</sup>	0.055

<sup>a</sup> Roof-ceiling assemblies include attic access panels and skylites.

<sup>b</sup> Walls include box sills, windows, doors, and those portions of the foundation wall above grade.

<sup>c</sup> The thermal transmittance value applies to the surface area which extends from grade to the top of the footing. If insulation is to be applied to the exterior of the wall below grade, the insulation shall be a type suitable for this application.

<sup>d</sup> The thermal transmittance value applies to a surface area which extends from the top of a slab to 48 inches vertically downward or horizontally or a combination thereof with a total dimension of 48 inches.

<sup>e</sup> Includes unheated crawl spaces, basements, garages and other spaces outside of the thermal envelope.

(2) **SYSTEM METHOD.** The overall thermal transmittance for any component of an electrically heated dwelling specified in sub. (1) may be exceeded if the calculated heat loss or gain for the entire thermal envelope does not exceed the total heat loss or gain calculated using the maximum overall thermal transmittances for all the components as specified in sub. (1).

Note: Additional explanatory material and examples of some methods which may be used to meet these requirements are contained in Appendices A through C.

History: Cr. Register, July, 1986, No. 367, eff. 1-1-87.

**ILHR 22.13 Infiltration control for electrically heated dwellings.** Provisions for the limitation of infiltration in electrically heated dwellings shall be made in accordance with this section.

(1) **GENERAL.** Windows and door assemblies and other portions of the thermal envelope shall be constructed and installed to minimize infiltration.

Register, March, 1992, No. 435

(2) **WINDOWS AND DOORS.** Manufactured windows and door assemblies which form a part of the thermal envelope of an electrically heated dwelling shall be constructed and installed to limit infiltration.

(a) *Windows.* Except as provided in par. (c), the air infiltration rate for manufactured windows of electrically heated dwellings may not exceed 0.20 cubic feet per minute per foot of sash crack.

(b) *Sliding doors.* Except as provided in par. (c), the air infiltration rate for manufactured sliding doors of electrically heated dwellings may not exceed 0.25 cubic feet per minute per square foot of door area.

(c) *Exception.* Windows with a maximum infiltration rate of 0.30 cubic feet per minute per foot of sash crack and sliding doors with a maximum infiltration rate of 0.30 cubic feet per minute per square foot of door area may be used in electrically heated dwellings where a blower door test, performed in accordance with sub. (4), indicates that the infiltration rate of the entire thermal envelope does not exceed 4.4 air changes per hour at 50 pascals (Pa) or does not exceed an equivalent leakage area (ELA) of 2 square inches per 100 square feet of above grade thermal envelope at 10 pascals (Pa).

(d) *Swinging doors.* The air infiltration rate for swinging door assemblies of electrically heated dwellings may not exceed 0.35 cubic feet per minute per square foot of door area.

*Note:* The department will allow the use of windows and doors meeting the requirements of this section when tested in accordance with ASTM E-283, Standard Method of Test for Rate of Air Leakage Through Exterior Curtain Walls and Doors.

(3) **EXTERIOR OPENINGS IN THE THERMAL ENVELOPE.** (a) *Sealing of openings.* Except as provided in par. (b) or as provided in par. (c), the following openings and all other similar openings in the thermal envelope shall be caulked, gasketed, weatherstripped, tightly packed with fiberglass, or otherwise sealed with a flexible material to limit air infiltration:

*Note:* Additional explanatory material is contained in Appendix D.

1. At the junction of exterior walls and the roof, including but not limited to the joints between:

- a. Double top plates; and
- b. The top plate and the siding or exterior finish, where extruded polystyrene is not placed behind the siding or exterior finish.

2. Between exterior walls and floors, including but not limited to the joints between:

- a. The subfloor and the exterior header joist;

*Note:* The header joist is also known as a band joist or a skirt.

- b. The top plates of the exterior wall and the header joists of floors placed on wall;

- c. The subfloor and bottom plates of exterior walls; and

- d. The joints between double top plates or double bottom plates of exterior walls.

3. Between floors and foundation walls, including but not limited to the joints between:

a. The foundation and sill plate and between the sill plate and floor joist header; or

b. The foundation and floor joist header; and

c. Floor joist header and the subfloor.

4. Between exterior frame walls placed on foundations, including but not limited to the joint between foundation and sill plate and the joint between double bottom plates.

5. At openings in exterior walls, including but not limited to the joints between:

a. Window headers and top wall plates;

b. Window headers and plates at the heads of windows and doors;

c. Plates and window sills;

d. Plate and window frame;

e. Separate wall panels;

f. Siding or exterior finish joints at cantilevered floors, bay windows and at soffits; and

g. Siding and foundation where no sheathing is provided behind the siding.

6. At joints around window and door assemblies in the thermal envelope, including but not limited to the joints between:

a. Window and door assemblies and the wall framing;

b. Window and door assemblies and the exterior siding or finish; and

c. Door thresholds and the subfloor.

7. At the joint between the foundation wall and the sill plate or joist header of a floor, or between the foundation wall and the bottom plate of a wall.

8. At penetrations through the thermal envelope at walls, floors and ceilings or insulated roof assemblies, including but not limited to:

a. Piping;

b. Hose bibbs;

c. Plumbing vent stacks;

d. Electrical wiring;

e. Chimney or vent penetrations;

f. Dryer vents;

g. Bathroom vents;

h. Kitchen vents;

i. Telephone wire entrances;

j. Through-the-wall air conditioners;

- k. Refrigeration lines;
- l. Air vents and inlets; and
- m. Recessed light fixtures.

9. Attic access panels in the thermal envelope shall be weatherstripped or otherwise sealed.

10. Air exhaust or intake openings shall be provided with back draft dampers or automatic dampers to limit air leakage.

11. All receptacles, switches or other electric boxes which are set into the vapor barrier or infiltration barrier shall be gasketed or otherwise sealed to limit infiltration. Insulation shall be placed behind all electric boxes and around wires in cavities of the thermal envelope.

12. Fireplaces shall be provided with:

a. Closable metal or glass doors covering the opening of the firebox;

b. A combustion air intake to draw air from the outside of the building directly into the firebox. The air intake shall be at least 6 square inches in area, or more if required by the manufacturers listing or installation instructions. The air intake shall be equipped with an accessible manual or automatic back draft damper; and

c. A flue damper with an accessible control.

(b) *Exception.* The sealing of any or all of the openings as specified in par. (a) 1. through 5. may be omitted if the openings are covered by an infiltration barrier installed as specified in this paragraph.

1. The infiltration barrier shall be installed on the exterior side of the insulation of the thermal envelope.

2. The infiltration barrier shall form a continuous surface over the walls of the building, extending from the bearing points of the roof to the top of the foundation.

3. All seams, joints, tears and punctures shall be sealed.

Note: Infiltration barriers include spun-bonded polyolefin sheets and tongue and groove extruded polystyrene.

(c) *Exception.* The sealing of any or all of the openings specified in par. (a) 1. through 5. may be omitted if a blower door test is performed in accordance with sub. (4) and the test indicates that the infiltration rate of the entire thermal envelope does not exceed 4.4 air changes per hour at 50 pascals (Pa) or does not exceed air equivalent leakage area (ELA) of 2 square inches per 100 square feet of above grade thermal envelope at 10 pascals (Pa).

(4) BLOWER DOOR TESTING PROCEDURE. Blower door tests which are performed to meet the requirements of sub. (2) (c) or (3) (c) shall be performed in accordance with this subsection:

(a) The test shall be performed in accordance with ASTM E-779, "Standard Practice for Measuring Air Leakage by the Fan Pressurization Method".

## ILHR 22

Note: ASTM is an acronym for the American Society for Testing and Materials. Copies of ASTM Standards may be purchased from the ASTM Publications Sales Department, 1916 Race Street, Philadelphia, PA 19103.

(b) The blower door test may not be conducted when the wind speed exceeds 10 miles per hour (mph).

(c) The results of the test shall be provided to the purchaser.

History: Cr. Register, July, 1986, No. 367, eff. 1-1-87; am. (4) (a), Register, January, 1989, No. 397, eff. 2-1-89.

### Subchapter VI — Heating and Air Conditioning Equipment and Systems

**ILHR 22.14 Scope.** This subchapter shall apply to all newly constructed conventional and manufactured one- and 2-family dwellings.

History: Cr. Register, July, 1986, No. 367, eff. 1-1-87.

**ILHR 22.15 Selection of equipment.** (1) **GENERAL.** Except as provided in sub. (2), the output capacity of the mechanical heating, cooling and air conditioning equipment shall not exceed the calculated heating load and cooling load by more than 15%, except to satisfy the next closest manufacturer's nominal size.

(2) **WATER HEATERS USED FOR SPACE HEATING.** The output capacity of water heaters that are used for simultaneous space and domestic water heating shall exceed the calculated space heating load by at least 43 percent, but by no more than 49 percent. Other sizing methods may be used if approved by the department for water heaters providing simultaneous space and domestic water heating.

History: Cr. Register, May, 1978, No. 269, eff. 12-1-78; renum. from ILHR 22.08, Register, July, 1986, No. 367, eff. 1-1-87; am. Register, March, 1992, No. 435, eff. 4-1-92.

**ILHR 22.16 Temperature control.** At least one thermostat for regulating the temperature of the space shall be provided for each separate system. Thermostats used to control the heating system may also be used to control the cooling system.

Note: Setting back the thermostat during periods of non-use or thermostats equipped with automatic controls which reduce the temperature during periods of non-use, conserve energy.

History: Cr. Register, May, 1978, No. 269, eff. 12-1-78; renum. from ILHR 22.09, Register, July, 1986, No. 367, eff. 1-1-87.

**ILHR 22.17 Zone control.** Each heating and cooling system shall be provided with an automatic or manually controlled damper or valve to shut off or reduce the heating or cooling to each zone or floor and to each room.

History: Cr. Register, May, 1978, No. 269, eff. 12-1-78; renum. from ILHR 22.10, Register, July, 1986, No. 367, eff. 1-1-87.

**ILHR 22.18 Duct and pipe insulation.** (1) **DUCT INSULATION.** All duct systems exposed to unheated spaces shall be insulated with materials having a minimum thermal resistance of  $R = 5$ .

(2) **PIPE INSULATION.** All heating pipes in unheated spaces and all cooling pipes in conditioned spaces shall be insulated with at least one inch of insulation. A vapor barrier on the exposed side of the insulation shall be provided on cooling pipes to prevent condensation. Pipes installed within Register, March, 1992, No. 435

heating and air conditioning equipment, installed in conditioned spaces, are not required to be insulated.

History: Cr. Register, May, 1978, No. 269, eff. 12-1-78; renum. from ILHR 22.11, Register, July, 1986, No. 367, eff. 1-1-87.

**ILHR 22.19 Equipment efficiencies.** (1) **ELECTRICAL EQUIPMENT.** (a) *Air conditioning equipment.* Air conditioning equipment shall have a minimum energy efficiency ratio (EER) of 7.8 or a COP of 2.3.

(b) *Heat pumps.* Heat pumps shall comply with the minimum coefficients of performance set forth in Table 22.19.

TABLE 22.19

## MINIMUM COP FOR HEAT PUMPS, HEATING MODE

Source and outdoor temperature (°F)	Minimum COP
Air source - 47 dry bulb/43 wet bulb	2.2
Air source - 17 dry bulb/16 wet bulb	1.2
Water source - 60 entering	2.2

1. The heat pump shall be installed with a control to prevent the supplementary heater from operating when the heating load can be more efficiently satisfied by the heat pump alone.

2. Supplementary heater operation is permitted during transient periods, such as start-ups, following room thermostat set point advance, and during defrost.

Note: A two-stage room thermostat, which controls the supplementary heat on its second stage, will be accepted as meeting this requirement. The cut-on temperature for the compression heating should be higher than the cut-on temperature for the supplementary heat; the cut-off temperature for the compression heating should be higher than the cut-off temperature for the supplementary heat.

(2) **COMBUSTION HEATING EQUIPMENT.** (a) *General.* Except as provided in par. (b), all gas-fired and oil-fired heating equipment shall have a minimum annual fuel utilization efficiency (AFUE) of 80%. Where a vent damper is provided but not included in the AFUE rating of the equipment, the equipment, without the vent damper, shall have a minimum AFUE of 75.

(b) *Exception.* All gas-fired and oil-fired copper fin and coil type boilers shall meet the minimum energy efficiency standards of ASHRAE 90A-80 "Energy Conservation in New Building Design."

Note: Efficiencies for electrical equipment and combustion heating equipment manufactured after January 1, 1992, shall comply with the National Appliance Energy Conservation Act (NAECA) which will preempt state regulations. As an exception, the NAECA will apply to air conditioners and central air conditioning heat pumps classed as single package systems which are manufactured after January 1, 1993.

History: Cr. Register, May, 1978, No. 269, eff. 12-1-78; renum. from ILHR 22.12 and r. and recr. (1) (a) and (2), Register, July, 1986, No. 367, eff. 1-1-87.

**ILHR 22.20 Electronic ignition and automatic flue dampering.** Combustion space heating equipment shall be provided with intermittent ignition devices and automatic flue dampers.

(1) Automatic flue dampers may be eliminated where:

(a) Induced draft equipment is used;

(b) Where equipment with a condensing secondary heat exchanger is used;

(c) All combustion air is ducted to the furnace burner from the outside; or

(d) Where combustion equipment is located in an enclosure and provided with combustion air from the outside.

(2) Appliances that burn solid fuels may be provided with manual dampers in lieu of automatic dampers.

(3) Thermally operated dampers shall not be used on boilers.

(4) Intermittent ignition devices may be omitted on water heaters used for simultaneous space and domestic water heating.

Note: Furnaces and boilers manufactured after January 1, 1992, shall comply with the National Appliance Energy Conservation Act which will preempt state regulations for electronic ignition and automatic flue dampering.

History: Cr. Register, May, 1978, No. 269, eff. 4-1-79; renum. from ILHR 22.13 and am. Register, July, 1986, No. 367, eff. 1-1-87; r. and recr. (intro.), renum. (1) to (4) to be (1) (a) to (d), cr. (1) (intro.), (2) to (4), Register, March, 1992, No. 435, eff. 4-1-92.

### Subchapter VII — Buildings Utilizing Solar, Wind Or Other Nondepletable Energy Sources

ILHR 22.21 Scope. History: Cr. Register, July, 1986, No. 367, eff. 1-1-87; r. Register, March, 1992, No. 435, eff. 4-1-92.

ILHR 22.21 Innovative designs. Any innovative building or system design, or a design which utilizes solar, geothermal, wind or other nondepletable energy sources will be accepted by the department provided the design utilizes less depletable energy than determined through the accepted practice method or the system design method.

History: Cr. Register, May, 1978, No. 269, eff. 12-1-78; renum. from ILHR 22.14, Register, July, 1986, No. 367, eff. 1-1-87; r. (2), renum. from ILHR 22.22 (1), Register, March, 1992, No. 435, eff. 4-1-92.

ILHR 22.22 Documentation. Proposed alternative designs shall be accompanied with an energy analysis comparing the energy utilized by the proposed design with the energy used by a design complying with subch. IV or V.

History: Cr. Register, May, 1978, No. 269, eff. 12-1-78; renum. from ILHR 22.15, Register, July, 1986, No. 367, eff. 1-1-87; renum. from ILHR 22.23, Register, March, 1992, No. 435, eff. 4-1-92.