

Chapter Comm 63

ENERGY CONSERVATION

Subchapter I — Purpose, Scope, Application and Compliance

Comm 63.0001 Purpose.
Comm 63.0002 Scope.
Comm 63.0003 Application.
Comm 63.0004 Compliance.

Subchapter II — Changes, Additions or Omissions to the International Energy Conservation Code (IECC)

Comm 63.0100 Changes, additions or omissions to IECC.
Comm 63.0101 Scope and general requirements.
Comm 63.0102 Materials, systems and equipment.
Comm 63.0103 Alternate materials—method of construction, design or insulating systems.
Comm 63.0104 Construction documents.
Comm 63.0105 Inspections.
Comm 63.0107 Conflicting requirements.
Comm 63.0202 General definitions.
Comm 63.0302 Exterior design parameters.
Comm 63.0402 System analysis.
Comm 63.0502 Building envelope.
Comm 63.0503 Building mechanical systems and equipment.
Comm 63.0504 Service water heating.
Comm 63.0505 Lighting power budget.
Comm 63.0602 Building envelope.
Comm 63.0605 Electrical power and lighting.
Comm 63.0701 General scope and application.
Comm 63.0802 Building envelope requirements.
Comm 63.0803 Building mechanical systems.
Comm 63.0804 Service water heating.
Comm 63.0805 Lighting systems.
Comm 63.0806 Lighting power for the standard design.
Comm 63.0900 Referenced standards.

Subchapter III — Building Design for Commercial Buildings

Part 1 — Application

Comm 63.1001 Application.

Part 2 — Definitions

Comm 63.1005 Definitions.

Part 3 — Building Envelope

Comm 63.1010 Exempt buildings.
Comm 63.1011 Air leakage and moisture migration.

Comm 63.1012 Daylight credits for skylights.
Comm 63.1014 Building envelope thermal performance.
Comm 63.1015 Component standards option.
Comm 63.1016 System standards option.
Comm 63.1017 Design criteria.
Comm 63.1018 Material properties.
Comm 63.1019 Required calculation procedures.

Part 4 — Equipment and Systems

Comm 63.1020 Minimum equipment efficiencies.
Comm 63.1021 Field-assembled equipment and components.
Comm 63.1022 Heat pump equipment controls.
Comm 63.1023 Load calculations for sizing.
Comm 63.1024 System and equipment sizing.
Comm 63.1026 Temperature controls.
Comm 63.1027 Zone controls.
Comm 63.1028 Humidity control.
Comm 63.1029 Insulation, materials and construction.
Comm 63.1030 Hydronic system controls.
Comm 63.1031 Economizer controls.
Comm 63.1032 Electrical motors.

Part 5 — Lighting Power

Comm 63.1040 Scope.
Comm 63.1041 Exterior lighting power requirement.
Comm 63.1042 Calculation of exterior lighting power.
Comm 63.1043 Exterior lighting power allowance.
Comm 63.1044 Interior lighting power requirement.
Comm 63.1045 Calculation of interior lighting power.
Comm 63.1046 Calculation of interior lighting power allowance.
Comm 63.1047 Complete building method.
Comm 63.1048 Area category method.
Comm 63.1049 Activity method.
Comm 63.1050 Lighting controls that must be installed.
Comm 63.1051 Requirements for lighting control devices.
Comm 63.1052 Exit signs.
Comm 63.1053 Reduction of single lamp ballasts.

Part 6 — Nondepletable Energy Source

Comm 63.1060 Buildings utilizing solar, geothermal, wind or other nondepletable energy source.

Part 7 — System Analysis Design

Comm 63.1070 System analysis design.

Note: Chapter Comm 63 as it existed on June 30, 2002 was repealed and a new chapter Comm 63 was created, Register December 2001 No. 552, effective July 1, 2002.

Subchapter I — Purpose, Scope, Application and Compliance

Comm 63.0001 Purpose. The purpose of this chapter is to regulate the design of building envelopes for adequate thermal resistance and low air leakage and the design and selection of mechanical, electrical, service water—heating and illumination systems and equipment which will enable effective use of energy in new building construction.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.0002 Scope. (1) GENERAL. The scope of this chapter is as specified in s. Comm 61.02, except as exempted in sub. (2).

(2) EXEMPT BUILDINGS AND STRUCTURES. The following buildings or portions of buildings shall be exempt from this chapter.

(a) Buildings, or portions thereof, without space heating or cooling, service water heating, or illumination are exempt from the requirements of this chapter that apply to those systems.

(b) Buildings and structures, or portions thereof separated by building envelope assemblies from the remainder of the building, that have a peak design rate of energy usage less than 3.4 Btu/h-ft² of floor area for all purposes are exempt.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.0003 Application. (1) GENERAL. This chapter shall be applied as specified in s. Comm 61.03 and as modified in subs. (2) to (5).

(2) ADDITIONS. (a) *Building envelope.* Additions to existing buildings or structures may be made without the existing building or structure having to comply with the building envelope requirements of this chapter, but the addition envelope shall comply with this chapter.

(b) *HVAC systems.* Where an existing HVAC system serves both an existing building and a proposed addition, any portion of the HVAC system or equipment that is altered shall comply with this chapter.

(c) *Lighting systems.* Lighting systems installed in a new addition or in conjunction with an increase of floor area, such as the addition of a mezzanine, shall comply with this chapter.

(3) ALTERATIONS. (a) *Building envelope.* Alterations to the building envelope shall comply with one of the following:

1. The alteration shall not increase the rate of heat loss through the portion of the building envelope containing the alteration.

2. The alteration shall not increase the annual energy use from heat gain or loss through the entire building envelope.

3. The building envelope shall be brought into compliance with the requirements of this chapter.

(b) *HVAC systems.* Rooftop fan systems that replace existing fan systems shall be provided with economizers that comply with this chapter's requirements for new construction.

(c) *Lighting systems.* 1. a. When an alteration of an interior lighting system increases the connected interior lighting load of the building, the entire interior lighting system is required to comply with ss. Comm 63.1044 to 63.1049.

b. Where an alteration of a building area includes replacement of more than 50% of the existing lighting fixtures in the altered area, the portion of the lighting system in the altered area is required to comply with ss. Comm 63.1044 to 63.1049.

2. a. When an alteration of an exterior lighting system increases the connected exterior lighting load of the building, the entire exterior lighting system is required to comply with ss. Comm 63.1041 to 63.1043.

b. Where an alteration of an exterior building surface includes replacement of more than 50% of the existing lighting fixtures on the altered surface, the portion of the lighting system on the altered surface is required to comply with ss. Comm 63.1041 to 63.1043.

3. a. Except as specified in subd. 3. b., alterations to controls shall comply with ss. Comm 63.1050 and 63.1051.

b. Shut-off lighting controls in s. Comm 63.1050 (4) are not required in contiguous altered spaces of less than 5,000 square feet unless shut-off controls were required by the building code at the time of the original lighting design or if an exception to s. Comm 63.1050 (4) (b) is no longer applicable.

(4) CHANGE IN OCCUPANCY. (a) Any change in the occupancy classification of a building or structure that would increase the required minimum inside temperature as specified in Table 64.0403 shall comply with the requirements of this chapter.

(b) Any change in a building or structure that would result in an increase in demand for either fossil fuel or electrical energy supply shall comply with this chapter.

(5) MIXED RESIDENTIAL AND COMMERCIAL OCCUPANCY. (a) *General.* Except as specified in par. (b), when a building houses both a residential and a commercial occupancy, each portion of the building shall conform to the requirements for the occupancy, residential or commercial, housed therein. Where minor accessory uses do not occupy more than 10% of the area of any floor of a building, the major use shall determine whether the building is a residential or commercial building.

(b) *Exception.* All buildings with a height of 4 or more stories above grade shall be considered a commercial building for purposes of this chapter.

History: CR 00–179: cr. Register December 2001 No. 552, eff. 7–1–02; CR 04–016: r. and recr. (3) (c) 1. and 2. Register December 2004 No. 588, eff. 1–1–05.

Comm 63.0004 Compliance. **(1) GENERAL.** All buildings shall comply with the International Energy Conservation Code (IECC), with the changes, additions or omissions specified in subch. II, and with the compliance approaches specified in sub. (2) for residential building and sub. (3) for commercial buildings.

(2) RESIDENTIAL BUILDINGS. (a) Except as specified in par. (b), for residential buildings one of the following approaches for compliance shall be used:

1. A systems approach for the entire building and its energy-using subsystems, which uses renewable sources as specified in IECC chapter 4.

2. An approach based on performance of individual components of the building envelope as specified in IECC chapter 5.

3. An approach based on performance of the total building envelope specified in IECC chapter 5.

4. An approach based on acceptable practice for each envelope component specified in IECC chapter 5.

5. An approach by prescriptive specification for individual components of the building envelope specified in IECC chapter 5.

6. An approach based on simplified, prescriptive specification specified in IECC chapter 6 when the glazing areas do not exceed 25% of the gross areas of exterior walls.

(b) This chapter does not apply to type A–1 residential buildings as defined in IECC section 202 as one and two family dwellings.

(3) COMMERCIAL BUILDINGS. For commercial buildings one of the following approaches for compliance shall be used:

(a) A prescriptive, system, or energy cost budget approach specified in subch. III.

(b) A prescriptive or performance option specified in IECC chapter 8.

History: CR 00–179: cr. Register December 2001 No. 552, eff. 7–1–02.

Subchapter II — Changes, Additions or Omissions to the International Energy Conservation Code (IECC)

Comm 63.0100 Changes, additions or omissions to IECC. Changes, additions or omissions to the IECC are specified in this subchapter and are rules of the department and are not requirements of the IECC.

Note: This subchapter is numbered to correspond to the numbering used within the model code; i.e. s. Comm 63.0101 refers to section IECC 101. With a few exceptions, subchapter III of this chapter is numbered to correspond to the numbering in the previous energy requirements of Comm 63; i.e., s. Comm 63.1005 was previously Comm 63.05.

Note: Copies of the International Energy Conservation Code are on file in the offices of the department, the secretary of state and the revisor of statutes.

Note: Copies of the International Energy Conservation Code can be obtained from organizations as specified in s. Comm 61.05.

Note: Copies of department forms are available from the Safety and Buildings Division, P.O. Box 7162, Madison, WI 53707–7162; telephone (608) 266–3151 or TTY (608) 264–877; or on the Commerce webpage at: www.commerce.state.wi.us

History: CR 00–179: cr. Register December 2001 No. 552, eff. 7–1–02.

Comm 63.0101 Scope and general requirements. Substitute the following wording for the requirements in IECC section 101: Requirements relating to purpose, scope and application are contained in subch. I.

History: CR 00–179: cr. Register December 2001 No. 552, eff. 7–1–02.

Comm 63.0102 Materials, systems and equipment. These are department rules in addition to the requirements in IECC section 102:

(1) PROHIBITION OF HEATED SIDEWALKS. The installation or use of heated sidewalks is prohibited as specified in s. 101.124, Stats.

Note: Section 101.124, Stats., reads as follows: "Heated Sidewalks Prohibited. In this section "exterior pedestrian traffic surface" means any sidewalk, ramp, stair, stoop, step, entrance way, plaza or pedestrian bridge not fully enclosed within a building and "heated" means heated by electricity or energy derived from the combustion of fossil fuels, but not including the use of waste thermal energy. "Exterior pedestrian traffic surface" does not include any means of ingress or egress by the physically disabled required under s. 101.13 (2). No person may construct a heated exterior pedestrian traffic surface. The department or any city, village, town or county is prohibited from approving any plan under s. 101.12 which includes such heated surface. The department shall order any existing heated exterior pedestrian traffic surface in operation to be shut off. This section does not apply to any inpatient health care facility as defined in s. 50.135 (1), or community-based residential facility, as defined in s. 50.01 (1g)."

(2) MATERIAL PROPERTIES. Thermal properties, performance of building envelope sections and components and heat transfer properties shall be determined in accordance with s. Comm 63.1018.

History: CR 00–179: cr. Register December 2001 No. 552, eff. 7–1–02.

Comm 63.0103 Alternate materials–method of construction, design or insulating systems. The requirements in IECC section 103 are not included as part of this code.

History: CR 00–179: cr. Register December 2001 No. 552, eff. 7–1–02.

Comm 63.0104 Construction documents. Substitute the following wording for the requirements in IECC section 104:

Construction documents and other supporting documents shall be submitted in accordance with ch. Comm 61.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.0105 Inspections. Substitute the following wording for the requirements in IECC section 105: Inspections shall be performed in accordance with ch. Comm 61.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.0107 Conflicting requirements. Substitute the following wording for the requirements in IECC section 107.2: The process for dealing with conflicting rules shall be as specified in ch. Comm 61.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.0202 General definitions. (1) This is a department definition in addition to the definitions in IECC section 202: "Circulating system" means service water heating system without a heat trap, or systems with circulating pump.

(2) Substitute the following definitions for the corresponding definitions listed in IECC section 202:

(a) "Approved" has the meaning given in s. Comm 62.0202 (2) (a).

(b) "Multifamily dwelling" has the meaning given in s. Comm 61.04 (4).

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02; CR 04-016: r. and recr. (2) Register December 2004 No. 588, eff. 1-1-05.

Comm 63.0302 Exterior design parameters.

(1) WEATHER ADJUSTMENTS. Substitute the following wording for the requirements in IECC Table 302.1 footnote a: The outdoor design temperature shall be selected from the columns of 97-1/2 percent values for winter and 2-1/2 percent values for summer from tables in the ASHRAE *Handbook of Fundamentals*. Adjustments shall be permitted to reflect local climates, which differ from the tabulated temperatures, or local weather experience as determined by other weather resources.

(2) DEGREE-DAYS. Substitute the following wording for the requirements in IECC Table 302.1, footnote b: The degree days heating (base 65° F) and cooling (base 65° F) shall be selected from National Oceanic and Atmospheric Administration "Annual Degree Days to Selected Bases Derived from the 1961-1990 Normals," the ASHRAE *Handbook of Fundamentals*, data available from adjacent military installations, or other sources of local weather data.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.0402 System analysis. (1) ENERGY ANALYSIS. This is a department informational note to be used under IECC section 402.1:

Note: The federal Department of Energy has developed REScheck™, a computer program that may be used in demonstrating compliance for a residential building which has no more than 3 stories and has 3 or more dwelling units. The REScheck program may be downloaded at <http://www.energycodes.gov/>. When using the program, the applicable code must be defined as the "2000 IECC." The use of the "Wisconsin" option will apply requirements associated with a 1 or 2 family dwelling, which are more restrictive than those associated with low-rise multifamily buildings.

(2) APPROVED CALCULATION TOOL. Substitute the following wording for the requirements in IECC section 402.4.7: The same calculation tool shall be used to estimate the annual energy usage for space heating and cooling of the Standard design and the Proposed design. The calculation tool shall be approved by the department.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02; CR 04-016: renum. to be (2), cr. (1) Register December 2004 No. 588, eff. 1-1-05.

Comm 63.0502 Building envelope. (1) GENERAL. Substitute the following wording for the requirements and the exceptions in IECC section 502.1.1:

(a) *Moisture control.* Except as specified in sub. (2), the design shall not create conditions of accelerated deterioration from moisture condensation. Vapor retarders shall be provided on all warm-

in winter sides of frame walls, floors and ceilings. The vapor retarder shall have a maximum permeance rating of 1.0 perm when tested in accordance with Procedure A of the ASTM E96. The vapor retarder shall be installed on the warm-in winter side of the thermal insulation.

(b) *Exceptions.* Where other approved means to avoid condensation in unventilated framed wall, floor, roof and ceiling cavities are provided.

(2) FLOORS OVER UNHEATED SPACES. Substitute the following wording for the requirements in IECC section 502.2.3.3: The floor section over an unheated space shall be selected from IECC Appendix Table 502.2.3.3 for the overall thermal transmittance factor (U_o) not exceeding the value specified for floors over unheated spaces in IECC Table 502.2. For floors over outdoor air, such as overhangs, U_o -factors for heating shall meet the same requirement as shown for floors over unheated spaces in IECC Table 502.2.

(3) COMPLIANCE BY PRESCRIPTIVE SPECIFICATION ON AN INDIVIDUAL COMPONENT BASIS. (a) *General.* Substitute the following wording for the requirements in IECC section 502.2.4: For Type A-2 residential buildings with a window area less than or equal to 20%, 25%, or 30% of the gross exterior wall area, the thermal resistance of insulation applied to the opaque building envelope components shall be greater than or equal to the minimum R -values, and the thermal transmittance of all fenestration assemblies shall be less than or equal to the maximum U -factors shown in IECC Tables 502.2.4(7), 502.2.4(8), or 502.2.4(9), as applicable. IECC sections 502.2.4.1 to 502.2.4.17 shall apply to the use of these tables.

(b) *Floors.* Substitute the following wording for the requirements in IECC section 502.2.4.8: Floor R -values shall apply to floors over unconditioned spaces and floors over outside air.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02; CR 04-016: r. and recr. (3) Register December 2004 No. 588, eff. 1-1-05.

Comm 63.0503 Building mechanical systems and equipment. (1) LOAD CALCULATIONS. Substitute the following

wording for the requirements in IECC section 503.3.1: Heating load calculations shall be determined in accordance with s. Comm 63.1023.

(2) DISTRIBUTION SYSTEM, CONSTRUCTION AND INSULATION. (a) *Hydronic piping insulation.* Substitute the following wording for the requirements and the exceptions in IECC sections 503.3.3.1 and 503.3.3.2 and IECC Table 503.3.3.1: All system piping shall be thermally insulated in accordance with s. Comm 63.1029 (1) and (2).

(b) *Duct and plenum insulation.* Substitute the following wording for the requirements and the exceptions in IECC section 503.3.3.3 and IECC Table 503.3.3.3: Duct and plenum insulation shall be provided in accordance with s. Comm 63.0803 (2) (f).

(c) *Low-pressure duct systems.* Substitute the following wording for the requirements in IECC section 503.3.3.4.2: Low-pressure duct systems shall comply with all of the following:

1. Sections of supply and return ducts not located entirely within the conditioned space, and the unconditioned side of enclosed stud bays or joist cavities or spaces that are used to transport air shall be sealed.

2. Sealing shall be accomplished using welds, gaskets, mastics, mastic-plus-embedded-fabric systems or tapes installed in accordance with the manufacturer's instructions.

3. Insulation that provides a continuous air barrier may be used in lieu of sealing metal ducts.

4. Tapes and mastics used with rigid fibrous glass ducts shall be listed and labeled as complying with UL 181A.

5. Tapes and mastics used with flexible air ducts shall be listed and labeled as complying with UL 181B.

6. Tapes with rubber-based adhesives may not be used.

Note: Standard duct tape has a rubber-based adhesive and does not comply with the requirements under this section.

(d) *Sealing required.* Substitute the following wording for the requirements in IECC section 503.3.3.4.3: High- and medium-pressure ducts shall be sealed in accordance with s. Comm 63.1029 (4).

(e) *Mechanical ventilation.* Substitute the following wording for the requirements in IECC section 503.3.3.5: Each mechanical ventilation system (supply or exhaust, or both) shall be equipped with a readily accessible switch or other means for shutoff, or volume reduction and shutoff, when ventilation is not required. Automatic or gravity dampers that close when the system is not operating shall be provided for all outdoor air exhausts. Motorized dampers that close when the system is not operating shall be provided on all outdoor air intakes.

(f) *Balancing.* Substitute the following wording for the requirements in IECC section 503.3.3.7: Balancing and documentation of the HVAC system shall conform to the IMC.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02; CR 01-139: renum. (2) (c) to (e) to be (2) (d) to (f), cr. (2) (c), r. and recr. (2) (d) Register June 2002 No. 558, eff. 7-1-02; CR 04-016: am. (2) (a) and (b) Register December 2004 No. 588, eff. 1-1-05.

Comm 63.0504 Service water heating. (1) COMBINATION SERVICE WATER-HEATING AND SPACE HEATING BOILERS. The requirements in IECC section 504.2.2, Exception 1, are not included as part of this code.

(2) PIPE INSULATION. Substitute the following wording for the requirements and the exception in IECC section 504.5: Pipe insulation shall be provided in accordance with s. Comm 63.1029 (1) and (2).

(3) SWIMMING POOLS. The requirements in IECC section 504.3, and IECC sections 504.3.1 to 504.3.3 are not included as part of this code.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.0505 Lighting power budget. Substitute the following informational note for the requirements and the exception in IECC section 505.2:

Note: See ss. Comm 63.1040 to 63.1053 for requirements for lighting systems.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02; CR 04-016: r. and recr. Register December 2004 No. 588, eff. 1-1-05.

Comm 63.0602 Building envelope. (1) THERMAL PERFORMANCE CRITERIA, FLOORS OVER OUTSIDE AIR. Substitute the following wording for the requirements in IECC section 602.1.4: The required R-value in Tables 602.1 shall apply to all floors.

(2) CAULKING, SEALANTS AND GASKETING. This is a department rule in addition to the requirements in IECC section 602.1.10: When installed in the building envelope, recessed lighting fixtures shall comply with IECC section 502.1.3.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02; CR 01-139: r. (2), renum. (3) to be (2) Register June 2002 No. 558, eff. 7-1-02.

Comm 63.0605 Electrical power and lighting. (1) ELECTRICAL ENERGY CONSUMPTION. This is a department rule in addition to the requirements in IECC chapter 6: In residential buildings having individual dwelling units, provisions shall be made to determine the electrical energy consumed by each tenant by separately metering individual dwelling units.

(2) LIGHTING POWER BUDGET. This is a department informational note to be used under IECC chapter 6:

Note: See ss. Comm 63.1040 to 63.1053 for requirements for lighting systems.

History: CR 04-016: cr. Register December 2004 No. 588, eff. 1-1-05.

Comm 63.0701 General scope and application. Substitute the following wording for the requirements in IECC section 701.1: Commercial buildings shall meet the requirements of subch. III or they shall comply with the requirements specified in IECC chapter 8.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.0802 Building envelope requirements.

(1) GENERAL. These are department rules in addition to the requirements in IECC section 802.1: Glazed structures or glazed portions of buildings used for the production of plant life or for maintaining plant life as the primary purpose of the structure are exempt from the building envelope requirements. When the glazed areas are attached to a building with a different class of construction, these glazed areas shall be separated from the remainder of the building with construction material complying with the building envelope requirements.

(2) MOISTURE CONTROL. Substitute the following wording for the requirements and exceptions in IECC section 802.1.2:

(a) *Moisture control.* Except as specified in par. (b), vapor retarders shall be provided on all warm-in winter sides of frame walls, floors and ceilings. The vapor retarder shall have a maximum permeance rating of 1.0 perm when tested in accordance with Procedure A of the ASTM E 96, Standard Test Methods for Water Vapor Transmission of Materials.

(b) *Other approved means.* Where other approved means to avoid condensation in unventilated framed wall, floor, roof and ceiling cavities are provided.

(3) ROOF ASSEMBLY. This is a department rule in addition to the requirements in IECC section 802.2.4: The thermal transmittance value for ceilings next to unconditioned spaces shall comply with s. Comm 63.1015 (5).

(4) SEALING OF THE BUILDING ENVELOPE. This is a department rule in addition to the requirements in IECC section 802.3.2: When installed in the building envelope, recessed lighting fixtures shall comply with IECC section 502.1.3.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02; CR 01-139: r. (3), renum. (4) and (5) to be (3) and (4) Register June 2002 No. 558, eff. 7-1-02.

Comm 63.0803 Building mechanical systems.

(1) GENERAL. This is a department rule in addition to the requirements in IECC section 803.1: Electrical motors shall comply with s. Comm 63.1032.

(2) SIMPLE HVAC SYSTEMS AND EQUIPMENT. (a) *Equipment and system sizing.* Substitute the following wording for the requirements in IECC section 803.2.1.1: Heating and cooling equipment and systems shall be sized to provide the minimum space and system loads calculated in accordance with IECC section 803.2.1.

(b) *Temperature controls.* Substitute the following wording for the requirements in IECC section 803.2.3.1: Each heating and cooling system shall have at least one temperature control device that complies with IECC sections 803.3.3.1.1, 803.3.3.2 and 803.3.3.3.

(c) *Humidity controls.* This is a department rule in addition to the requirements in IECC section 803.2.3.2: If a system is equipped with a means for adding moisture to maintain specific humidity levels in a zone, a humidistat shall be provided.

(d) *Cooling with outdoor air.* Substitute the following wording for the requirements in IECC section 803.2.6: Each fan system shall have economizer controls complying with s. Comm 63.1031.

(e) *Shutoff dampers.* Substitute the following wording for the requirements and the exceptions in IECC section 803.2.7:

1. 'Outdoor air supply and exhaust ducts.' Except as specified in subd. 2., automatic or gravity dampers that close when the system is not operating shall be provided for all outdoor air exhausts and motorized dampers that close when the system is not operating shall be provided on all outdoor air intakes.

2. 'Exceptions.' Outdoor air supply and exhaust ducts restricted by health and life safety requirements are exempt.

(f) *Duct and plenum insulation.* Substitute the following wording for the requirements and the exceptions in IECC section 803.2.8:

1. 'Supply and return air ducts and plenums.' Except as specified in subd. 2., all supply ducts and return air ducts and plenums shall be insulated with a minimum of R-4 insulation when located in unconditioned spaces and with a minimum of R-7.5 insulation when located outside the building envelope. When located within a building envelope assembly, the duct or plenum shall be separated from the building exterior or unconditioned or exempt spaces by a minimum of R-7.5 insulation. All supply ducts located in plenums within the building envelope shall be insulated to R-4.

2. 'Exceptions.' a. When located within equipment.

b. When the design temperature difference between the interior and exterior of the duct or plenum does not exceed 15°F.

3. 'Joints, longitudinal and transverse seams, and connections.' Joints, longitudinal and transverse seams, and connections in ductwork shall be sealed in accordance with s. Comm 63.1029 (4).

(g) *Piping insulation.* Substitute the following wording for the requirements in IECC section 803.2.9: All piping serving as part of a heating or cooling system shall be thermally insulated in accordance with s. Comm 63.1029 (1) and (2).

(3) **COMPLEX HVAC SYSTEMS AND EQUIPMENT.** (a) *Equipment and system sizing.* Substitute the following wording for the requirements in IECC section 803.3.1.1: Heating and cooling equipment and system capacity shall be sized to provide the minimum space and system loads calculated in accordance with IECC section 803.2.1.

(b) *Shutoff damper controls.* Substitute the following wording for the requirements and the exception in IECC section 803.3.3.4:

1. Except as specified in subd. 2., automatic or gravity dampers that close when the system is not operating shall be provided for all outdoor air exhausts and motorized dampers that close when the system is not operating shall be provided on all outdoor air intakes.

2. Outdoor air supply and exhaust ducts restricted by health and life safety requirements are exempt.

(c) *Economizers.* Substitute the following wording for the requirements and the exception in IECC section 803.3.3.5: Each fan system shall have economizer controls complying with s. Comm 63.1031.

(d) *Piping insulation.* Substitute the following wording for the requirements and the exceptions in IECC section 803.3.7: All piping serving as part of a heating or cooling system shall be thermally insulated in accordance with s. Comm 63.1029 (1) and (2).

(e) *HVAC system completion.* Substitute the following wording for the requirements in IECC sections 803.3.8, 803.3.8.1, 803.3.8.2, and 803.3.8.3: Balancing and documentation of HVAC systems shall conform to the IMC.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02; CR 01-139: r. and recr. (2) (f) 3. Register June 2002 No. 558, eff. 7-1-02; **CR 04-016:** cr. (2) (g) Register December 2004 No. 588, eff. 1-1-05.

Comm 63.0804 Service water heating. (1) **TEMPERATURE CONTROLS.** The requirements in IECC section 804.3 are not included as part of this code.

(2) **HEAT TRAPS.** Substitute the following wording for the requirements in IECC section 804.4: Plumbing piping systems, including those without an integral heat trap shall comply with s. Comm 63.1029 (1) and (2).

(3) **PLUMBING PIPE INSULATION.** Substitute the following wording for the requirements in IECC section 804.5: All system piping shall be thermally insulated in accordance with s. Comm 63.1029 (1) and (2).

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.0805 Lighting systems. Substitute the following wording for the requirements in IECC section 805: Lighting systems shall comply with ss. Comm 63.1040 to 63.1053.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.0806 Lighting power for the standard design. Substitute the following wording for the requirements in IECC section 806.4.7: The lighting power for the Standard design shall be the maximum allowed in accordance with s. Comm 63.0805. Where the occupancy of the building is not known, the lighting power density shall be 1.5 watts per square foot.

History: CR 04-016: cr. Register December 2004 No. 588, eff. 1-1-05.

Comm 63.0900 Referenced standards. This is a department rule in addition to the requirements in IECC chapter 9: The following standards are hereby incorporated by reference into this code:

(1) ASHRAE Standard 90.1-89, Energy Efficient Design of New Buildings, Except Low Rise Residential Buildings.

(2) ASTM C 177-85, Test method for steady-state heat flux measurements and thermal transmission properties by means of the guarded-hot-plate apparatus.

(3) ASTM C 335-84, Test method for steady state heat transfer properties of horizontal pipe insulation.

(4) National Concrete Masonry Association (NCMA) Evaluation Procedures of Integrally Insulated Concrete Masonry Walls, January 1, 1999.

Note: ASHRAE standards may be purchased from the American Society of Heating, Refrigerating and Air Conditioning Engineers, Inc., 1791 Tullie Circle, NE, Atlanta, GA 30329.

ASTM standards may be purchased from the American Society for Testing and Materials, 1916 Race Street, Philadelphia, PA 19103.

NCMA Evaluation Procedures may be obtained from the National Concrete Masonry Association, 2302 Horse Pen Road, Herndon, VA 20171-3499.

Copies of the standards adopted under this section are on file in the offices of the department, the secretary of state and the revisor of statutes.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02.

Subchapter III — Building Design for Commercial Buildings

Part 1 — Application

Comm 63.1001 Application. This subchapter shall be applied to all commercial buildings unless the building complies with IECC chapter 8.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02.

Part 2 — Definitions

Comm 63.1005 Definitions. In this subchapter:

(1) "Ambient Lighting" is lighting designed to provide a substantially uniform level of illumination throughout an area, exclusive of any provision for special visual tasks or decorative effect. When designed for lower-than-task illuminance used in conjunction with other specific task lighting systems, it is also called "general" lighting.

(2) "Automatic" means self-acting, operating by its own mechanism when actuated by some impersonal influence, such as, a change in current strength, pressure, temperature, or mechanical configuration.

(3) "Automatic time switch control devices" means control devices that are capable of automatically turning loads off and on based on time schedules.

(4) "Building envelope" means the elements of a building that enclose conditioned spaces through which thermal energy may be transferred to or from the exterior or to or from unconditioned spaces.

(5) "Comfort cooling" or "comfort heating" means treating air to control one or more of the following: temperature, relative humidity, or distribution to meet the comfort requirements of the human occupants of the conditioned space.

(6) "Conditioned floor area" or "CFA" means the floor area in square feet of enclosed conditioned space on all floors of a build-

ing, as measured at the floor level of the exterior surfaces of exterior walls enclosing the conditioned space.

(7) "Commercial building" means a building as defined in IECC section 202.

(8) "Conditioned space" means a cooled space, heated space, or indirectly conditioned space.

(9) "Cooled space" means an enclosed space within a building that is conditioned by a cooling system with a sensible capacity that either exceeds 5 Btu/hr sq ft or is capable of maintaining a space dry-bulb temperature of 90°F or less at design conditions.

(10) "Daylighting control" means a device that automatically regulates the power input to electric lighting near the fenestration to maintain the desired workplace illumination, thus taking advantage of direct or indirect sunlight.

(11) "Daylit area" means the space on the floor that is the larger of par. (a) or (b) as follows:

(a) 1. For areas daylit by vertical glazing, the daylit area has the length of 15 feet, or the distance on the floor, perpendicular to the glazing, to the nearest 60-inch or higher opaque partition, whichever is less; and a width of the window plus either 2 feet on each side, the distance to an opaque partition, or one-half the distance to the closest skylight or vertical glazing, whichever is least.

2. For areas daylit by horizontal glazing, the daylit area is the footprint of the skylight plus, in each of the lateral and longitudinal dimensions of the skylight, the lesser of the floor-to-ceiling height, the distance to the nearest 60-inch or higher opaque partition, or one-half the horizontal distance to the edge of the closest skylight or vertical glazing.

(b) The daylit area calculated using a method acceptable to the department.

(12) "Deadband" means the range of values within which an input variable can be varied without initiating any noticeable change in the output variable.

(13) "Degree day" means a unit based upon temperature difference and time, used in estimating annual heating or cooling energy consumption. One degree day accrues for each degree of difference between the daily mean temperature and a reference temperature.

(14) "Display lighting" means lighting confined to the area of a display that provides a higher level of illuminance than the level of surrounding ambient illuminance.

(15) "Economizer, air" means a ducting arrangement and automatic control system that allows a cooling supply fan to supply outside air to reduce or eliminate the need for mechanical refrigeration during mild or cold weather.

(16) "Economizer, water" means a system by which the supply air of a cooling system is cooled directly or indirectly or both by evaporation of water or other appropriate fluid in order to reduce or eliminate the need for mechanical refrigeration during some time periods.

(17) "Effective aperture" or "EA" means for windows, the visible light transmittance times the window wall ratio per wall; and for sky lights, the well efficiency times the visible light transmittance times the sky light area times 0.85 divided by the gross exterior roof area.

(18) "Efficacy" means the ratio of light from a lamp to the electrical power consumed, including ballast losses, expressed in lumens per watt.

(19) "Emissivity" means the ratio of the rate of radiant heat energy emitted by a body at a given temperature to the rate of radiant heat energy emitted by a standard called a blackbody, at the same temperature in the same surroundings.

(20) "Exterior envelope" has the same meaning as "building envelope."

(21) "Exterior roof or ceiling" means an exterior partition, or partition separating a conditioned space from an enclosed unconditioned space, that has a slope less than 60° from horizontal, that

has conditioned space below, and that is not an exterior door or skylight.

(22) "Exterior roof or ceiling area" means the area of the exterior surface of an exterior roof or ceiling.

(23) "Exterior wall" means an exterior partition that is not an exterior floor or soffit, exterior door, exterior roof or ceiling, window, or skylight.

(24) "Exterior wall area" means the area of the opaque exterior surface of exterior walls.

(25) "Fenestration" means any light-transmitting section in a building wall or roof. The fenestration includes glazing material, which may be glass or plastic, framing such as mullions, muntins, and dividers, external shading devices, internal shading devices, and integral or between glass shading devices.

(26) "Fenestration area" means the total area of fenestration measured using the rough opening and including the glazing material, sash, and frame.

(27) "General lighting" means lighting designed to provide a substantially uniform level of illumination throughout an area, exclusive of any provision for special visual tasks or decorative effect. When designed for lower-than-task illuminance used in conjunction with other specific task lighting systems, it is also called "ambient" lighting.

(28) "Gross exterior wall area" means the gross area of exterior walls separating a conditioned space from the outdoors or from unconditioned spaces as measured on the exterior above grade. It consists of the opaque wall, excluding vents and grills, including between floor spandrels, peripheral edges of flooring, window areas including sash, and door areas.

(29) "Gross floor area" means the sum of the floor areas of the conditioned spaces within the building including basements, mezzanine and intermediate-floored tiers, and penthouses of headroom height 7.5 ft or greater. It is measured from the exterior faces of exterior walls or from the centerline of walls separating buildings, excluding covered walkways, open roofed-over areas, porches and similar spaces, pipe trenches, exterior terraces or steps, chimneys, roof overhangs, and similar features.

(30) "Gross floor area over outside or unconditioned spaces" means the gross area of a floor assembly separating a conditioned space from the outdoors or from unconditioned spaces as measured from the exterior faces of exterior walls or from the centerline of walls separating buildings. The floor assembly shall be considered to include all floor components through which heat may flow between indoor and outdoor or unconditioned environments.

(31) "Gross lighted area" or "GLA" means the sum of the total lighted areas of a building measured from the inside of the perimeter walls for each floor of the building.

(32) "Gross roof area" means the gross area of a roof or ceiling assembly separating a conditioned space from the outdoors or from unconditioned spaces, measured from the exterior faces of exterior walls or from the centerline of walls separating buildings. The roof assembly shall be considered to include all roof or ceiling components through which heat may flow between indoor and outdoor environments including skylights but excluding service openings.

(33) "Gross exterior roof area" means the sum of the skylight area and the exterior roof/ceiling area.

(34) "Heat capacity" or "HC" means the amount of heat necessary to raise the temperature of a given mass one degree. Numerically, it is the mass multiplied by the specific heat.

(35) "Heated space" means an enclosed space within a building that is conditioned by a heating system with an output capacity either exceeding 10 Btu/h-ft² or capable of maintaining a space dry-bulb temperature of 50°F or more at design conditions.

(36) "Heating, ventilating, and air conditioning system" or "HVAC system" means the equipment, distribution network, and

terminals that provide either collectively or individually the process of heating, ventilating, or air conditioning to a building.

(37) “Indirectly conditioned space” means an enclosed space including, but not limited to, unconditioned volume in atria, that is not directly conditioned space; and either has an area-weighted heat transfer coefficient to directly conditioned space exceeding that to the outdoors or to unconditioned space, or is a space through which air from directly conditioned spaces is transferred at a rate exceeding three air changes per hour.

(38) “Informational sign” means a sign used to give building or room identification direction or a warning for safety purposes in a building, but does not include advertising signs for product or merchandise displays.

(39) “Listed space area” or “LS” means any interior space with an identified area of activities for which a lighting power budget is calculated and listed in the lighting power allowance determination.

(40) “Lumen maintenance control device” means a device capable of automatically adjusting the light output of a lighting system throughout a continuous range to provide a preset level of illumination.

(41) “Luminaire” means a complete lighting unit consisting of at least one lamp and the parts designed to distribute the light, to position and protect the lamp, to connect the lamp to the power supply and ballasting, when applicable. Luminaires are commonly referred to as “lighting fixtures” or “instruments.”

(42) “Manual” means capable of being operated by personal intervention.

(43) “Mass wall” means a wall assembly with a heat capacity (HC) greater than or equal to 5 Btu/ft² °F.

(44) “Mass wall insulation position” means:

(a) Exterior insulation position: a wall having all or nearly all of its mass exposed to the room air with the insulation on the exterior of that mass.

(b) Integral insulation position: a wall having mass exposed to both room and outside air with substantially equal amounts of mass on the inside and outside of the insulation layer.

(c) Interior insulation position: a wall not meeting either par. (a) or (b), particularly a wall having most of its mass external to an insulation layer.

(45) “Medical and clinical care” means the promotion of the condition of being sound in body or mind through medical, dental or psychological examination and treatment.

(46) “Multiscene dimming system” means a lighting control device that has the capability of setting light levels throughout a continuous range, and that has pre-established settings within the range.

(47) “Occupant-sensing device” means a device that automatically controls the lights based on occupancy.

(48) “Opaque areas” means all exposed areas of a building envelope which enclose conditioned space except fenestration areas and building service openings such as vents and grilles.

(49) “Ornamental chandeliers” means ceiling-mounted, close-to-ceiling, or suspended decorative luminaires that use glass, crystal, ornamental metals, or other decorative material and that typically are used in hotels, motels, restaurants, or churches as a significant element in the interior architecture.

(50) “Precision commercial or industrial work” means an art, craft, or manufacturing operation requiring a certain degree of refinement.

(51) “Private driveways, walkways, and parking lots” means exterior transit areas that are associated with a commercial or residential building and intended for use solely by the employees or tenants and not by the general public.

(52) “Public driveways, walkways, and parking lots” means exterior transit areas that are intended for use by the general public.

(53) “Recooling” means lowering the temperature of air that has been previously heated by a heating system.

(54) “Recovered energy” means energy utilized from an energy-using system which would otherwise be wasted or not contribute to a desired end use.

(55) “Reduced flicker operation” means the operation of a light, in which the light has a visual flicker less than 30% for frequency and modulation.

(56) “Reheating” means raising the temperature of air that has been previously cooled either by refrigeration or an economizer system.

Note: Introducing outdoor air necessary to meet ventilation requirements or to assure adequate indoor air quality is not considered to be cooling.

(57) “Reset” means adjustment of the controller set point to a higher or lower value automatically or manually.

(58) “Residential building” means a building as defined in IECC section 202.

(59) “Sconce” means a wall mounted decorative light fixture.

(60) “Shading coefficient” or “SC_x” means the ratio of solar heat gain through a fenestration, with or without integral shading devices, to that occurring through unshaded 1/8-in. thick clear double strength glass.

(61) “Shell building” means a building for which the envelope is designed, constructed, or both prior to knowing the occupancy type.

Note: See also speculative building.

(62) “Speculative building” means a building for which the envelope is designed, constructed, or both prior to the design of the lighting, HVAC systems, or both. A speculative building differs from a shell building in that the intended occupancy is known for the speculative building.

Note: See also shell building.

(63) “Support area” means an area for functions that are different from but necessary to accomplish the main activity or purpose of other listed space areas.

(64) “Tandem wired” means pairs of luminaires operating with one lamp in each luminaire powered from a single two-lamp ballast contained in the other luminaires.

(65) “Task oriented lighting” means lighting that is designed specifically to illuminate a task location, and that is generally confined to the task location.

(66) “Thermal break” means an element of low thermal conductivity placed in an assembly to reduce the flow of heat between highly conductive materials.

(67) “Thermal conductance” or “C” means the constant time rate of heat flow through a unit area of a body induced by a unit temperature difference between the surfaces, expressed in Btu/h-ft²·°F or equivalent units. It is the reciprocal of thermal resistance.

(68) “Thermal resistance” or “R” means the reciprocal of thermal conductance, 1/C expressed in h-ft²·°F/Btu or equivalent units. The total thermal resistance of an assembly is 1/U_o.

(69) “Thermal transmittance” or “U” means the overall coefficient of heat transfer from fluid to fluid. It is the time rate of heat flow per unit area under steady conditions from the fluid on the warm side of the barrier to the fluid on the cold side, per unit temperature difference between the 2 fluids, expressed in Btu/h-ft²·°F or equivalent units.

(70) “Thermal transmittance, overall” or “U_o” means the gross overall (area weighted average) coefficient of heat transfer from air to air or fluid to fluid for a gross area of the building envelope, expressed in Btu/h-ft²·°F or equivalent units. The U_o value applies to the combined effect of the time rate of heat flows

through the various parallel paths such as windows, doors, and opaque construction areas comprising the gross area of one or more building envelope components such as walls, floors, and roof or ceiling.

(71) “Thermostat” means an automatic control device responsive to temperature.

(72) “Unconditioned space” means a space within a building that is not a conditioned space.

Note: See conditioned space.

(73) “Unlisted space” means the difference in area between the gross lighted area and the sum of all listed space areas.

(74) “Variable air volume HVAC system” or “VAV HVAC system” means HVAC systems that control the dry-bulb temperature within a space by varying the volume of air supply to the space.

(75) “Visible light transmittance” or “VLT” means the ratio, expressed as a decimal, of visible light that is transmitted through

a glazing material to the light that strikes the material.

(76) “Wall heat capacity” or “HC” means the sum of products of the mass of each individual material in the wall per unit area of wall surface times its individual specific heat, Btu/(ft²°F).

(77) “Well efficiency” means the ratio of the amount of visible light leaving a skylight well to the amount of visible light entering the skylight well and is calculated as follows:

(a) for rectangular wells:


$$\frac{\text{Well height (well length + well width)}}{2 \times \text{well length} \times \text{well width}} = \text{the well index}$$

(b) for irregular shaped wells:

$$\frac{\text{Well height} \times \text{well perimeter}}{4 \times \text{well area}} = \text{the well index}$$

(c) The length, width, perimeter, and area expressed in pars. (a) and (b) are measured at the bottom of the well. The well index and the weighted average well wall reflectance are used in Figure 63.1005 to determine the well efficiency.

Figure 63.1005 Well Efficiency

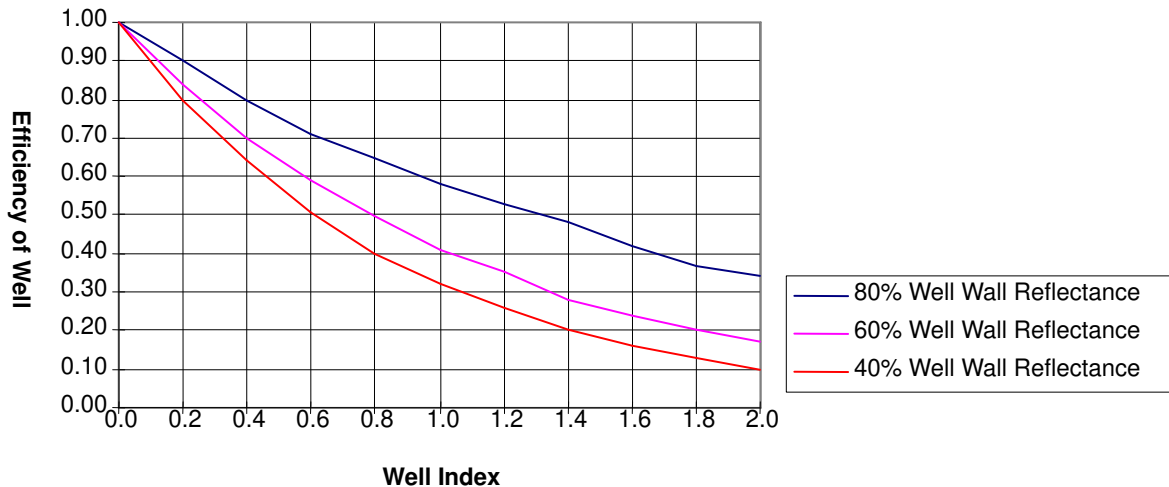

Note: Reprinted from the IES Lighting Handbook, 1984, courtesy of the Illuminating Engineering Society of North America.

(78) “Window” means glazing that is not a skylight.

(79) “Window area” means the area of the surface of a window, plus the area of the frame, sash, and mullions.

(80) “Window wall ratio” means the ratio of the window area, including glazed areas of doors, to the gross exterior wall area.

(81) “Zone” means a space or group of spaces within a building with any combination of heating, cooling, or lighting requirements sufficiently similar so that desired conditions can be maintained throughout by a single controlling device.

History: CR 00-179; cr. Register December 2001 No. 552, eff. 7-1-02.

Part 3 — Building Envelope

Comm 63.1010 Exempt buildings. This part applies to buildings or separately enclosed identifiable areas that have a mechanical space heating or air conditioning system.

History: CR 00-179; cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.1011 Air leakage and moisture migration.

(1) **GENERAL.** The requirements of this section apply to those building components that separate interior building conditioned space from the outdoors or from unconditioned spaces or crawl spaces. Compliance with the criteria for air leakage through build-

ing components shall be determined by tests conducted in accordance with specified standards.

(2) **AIR LEAKAGE FOR FACTORY MANUFACTURED WINDOWS, DOORS AND CURTAIN WALL ASSEMBLIES.** Factory manufactured windows, doors and curtain wall assemblies shall comply with IECC section 802.3.1.

(3) **AIR LEAKAGE REQUIREMENTS FOR EXTERIOR ENVELOPE.** Openings and penetrations in the building envelope shall be sealed or gasketed in accordance with s. Comm 63.0802 (3).

(4) **MOISTURE CONDENSATION.** The design of buildings shall not create conditions of accelerated deterioration from moisture condensation and shall comply with s. Comm 63.0802 (2).

History: CR 00-179; cr. Register December 2001 No. 552, eff. 7-1-02; CR 01-139; am. (3) Register June 2002 No. 558, eff. 7-1-02.

Comm 63.1012 Daylight credits for skylights.

(1) **COMMERCIAL BUILDINGS.** Credits for skylights may be used in commercial buildings if the IECC section 802 requirements and any modifications or additions specified in subch. II are met.

(2) **RESIDENTIAL BUILDINGS.** Day light credits may be used in residential buildings if the IECC section 502 requirements are met.

History: CR 00-179; cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.1014 Building envelope thermal performance. (1) GENERAL. Except as provided in sub. (2), building envelopes shall comply with either the component standards of s. Comm 63.1015 or the system standards of s. Comm 63.1016. The calculation procedures of s. Comm 63.1019 shall be used to show compliance.

(2) EXCEPTIONS. (a) Buildings and areas of buildings that are used as factories and automatic car washes shall comply with s. Comm 63.1017.

(b) Buildings and areas of buildings that are used as warehouses that have documentation provided to verify that the HVAC system to be installed does not use energy primarily to provide human comfort shall comply with s. Comm 63.1017.

Note: See s. Comm 63.1010 for exempt buildings and spaces.

History: CR 00-179; cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.1015 Component standards option.

(1) GENERAL. This section describes the component standards for building envelope thermal performance. Because component requirements consider the effect of solar gain as well as conductive heat transfer, the requirements for each component shall be met independently under this option. The wall and roof trade-off exception in sub. (4) may be used with this option. The system analysis design method specified in IECC section 806 shall be used to demonstrate the acceptability of trade-offs between component energy-conserving features. Separate occupancies in the same building shall meet the requirements of this section independently.

(2) DETERMINATION OF APPROPRIATE ACP TABLE. The appropriate alternate component package or ACP table shall be determined based on building location using Figures 63.1015-1 and 63.1015-4.

(3) MAXIMUM ALLOWABLE WINDOW WALL RATIO. In this subsection, the percentage of windows, including glazed areas of doors, relative to the gross exterior wall area of the building shall be less than or equal to the maximum allowable window wall ratio chosen from the appropriate ACP table for the glazing type of the building. The window wall ratio is the total area of window assemblies, including glazed areas of doors, divided by the total gross exterior wall area, considering all elevations of the building. The maximum allowable window wall ratio shall be determined using the following steps:

(a) Select the shading coefficient (SC_x) range that is no less than the fenestration SC_x including permanently installed internal, integral and external shading devices, but excluding the effect of external shading projections. Note that this includes curtains, shades, or blinds that are permanently installed. For a shell or speculative building for which the envelope is designed or constructed prior to the design of the lighting, HVAC systems, or both, only those shading devices that are part of the design when it is being evaluated for compliance shall be considered when determining compliance.

Note: Refer to ASHRAE Handbook, Fundamentals Volume, Chapter 27 for more information on shading coefficients. Shading coefficients for fenestration may be obtained from the manufacturer or from IECC Table 102.5.2 (3) when the conversion factor for solar heat gain coefficient (SHGC) to SC_x given in IECC section 102.5.2 is applied. See also s. Comm 63.1019 (5).

(b) Select appropriate fenestration type. This is determined by the thermal transmittance value (U_{of}) of the fenestration assembly. The U_{of} of all assemblies must fall within the range, or lower, to determine the maximum window wall ratio, or an area-weighted average thermal transmittance value may be used.

(4) WALL AND ROOF TRADE-OFF. Trade-offs between the above grade exterior wall opaque areas and the gross roof area shall be allowed if either of the following conditions are met:

(a) 1. Except as specified in subd. 2., the thermal transmittance, overall value (U_o) for any above grade exterior opaque wall area or gross roof area may be increased or decreased, provided that the total annual energy use due to heat gain and loss for the building envelope is less than or equal to the total annual energy use due to heat gain and loss resulting from the use of the values in the appropriate ACP table given in Figures 63.1015-1 to 63.1015-4. Calculation of the total annual energy use of the building designs shall be done in accordance with IECC section 806.

2. The latest version of the ComCheck-EZ computer program or other programs subject to the approval of the department may be used to determine required thermal transmittance values in lieu of the ACP tables.

Note: ComCheck-EZ is a computer program that may be used only for determining building envelope compliance. The ComCheck-EZ computer program may be downloaded at: <http://www.energycodes.gov/>. The federal Department of Energy has issued a computer package called ComCheck-Plus, which establishes trade-offs between the building envelope, lighting, and HVAC equipment; however, this program has not been approved for use in Wisconsin since Wisconsin's lighting allowances are not the same as those included in the program.

(b) A submittal to the department for review and approval, incorporating recognized engineering practices, that the annual energy use due to heat gain and loss for the building envelope shall be less than or equal to that established in par. (a).

(5) THERMAL TRANSMITTANCE VALUES FOR ROOFS, WALLS AND CEILINGS NEXT TO UNCONDITIONED SPACES, AND FLOORS OVER UNCONDITIONED SPACES. (a) The U -values for the building roofs, walls and ceilings next to unconditioned spaces, and floors over unconditioned spaces shall be less than or equal to those listed in the appropriate ACP table given in Figures 63.1015-1 to 63.1015-4.

(b) Skylights for which daylight credit cannot be taken in accordance with s. Comm 63.1012 shall be included in the calculation of the overall thermal transmittance value of the roof assembly (U_{or}).

(c) Unconditioned below-grade spaces that have floor or ceiling assemblies insulated as specified on the appropriate ACP table do not require below-grade wall insulation.

(6) THERMAL RESISTANCE VALUE FOR SLAB-ON-GRADE FLOORS. (a) Unheated slab-on-grade floors shall have insulation around the perimeter of the floor with the thermal resistance (R_u) of the insulation as listed in the appropriate ACP table given in Figures 63.1015-1 to 63.1015-4.

(b) For heated slabs-on-grade, the required minimum R -value shall be the R -value for the unheated slab-on-grade plus 2.0.

(c) The slab insulation specified shall extend either in a vertical plane downward from the top of the slab for the minimum distance given in the appropriate ACP table or downward to the bottom of the slab then in a horizontal plane beneath the slab or outward from the building for the minimum distance given in the ACP table. Vertical insulation shall not be required to extend below the foundation footing.

(d) The R -value and dimensions required for slabs refer only to the building insulation materials. Insulative continuity shall be maintained in the design of slab edge insulation systems. Continuity shall be maintained from the wall insulation through the intersection of the slab, wall and footing to the body of the slab edge insulation.

History: CR 00-179; cr. Register December 2001 No. 552, eff. 7-1-02; CR 04-016; am. (5) (a) and (6) (a) Register December 2004 No. 588, eff. 1-1-05.

Figure 63.1015-1
Degree Day Regions for Use with AC Tables



**Figure 63.1015-2
Alternate Component Package
ACP Table A**

| Part A1: Maximum Window Area / Gross Exterior Wall Area | | | | | | |
|--|---|--------------------|--------------------|--------------------|--------------------|-------------|
| Exterior Wall U_o | Shading Coefficient Range SC_x | U_{of} Range | | | | |
| | | 0.60 to 0.56 | 0.55 to 0.51 | 0.50 to 0.46 | 0.45 to 0.41 | ≤ 0.40 |
| ≤ 0.06 | 0.80 – 0.71 | 0.20 | 0.21 | 0.23 | 0.25 | 0.27 |
| | 0.70 – 0.61 | 0.20 | 0.22 | 0.24 | 0.26 | 0.28 |
| | 0.60 – 0.51 | 0.21 | 0.22 | 0.25 | 0.27 | 0.30 |
| | 0.50 – 0.41 | 0.21 | 0.23 | 0.25 | 0.28 | 0.31 |
| | ≤ 0.40 | 0.21 | 0.23 | 0.26 | 0.29 | 0.33 |
| 0.061 to 0.070 | 0.80 – 0.71 | 0.18 | 0.20 | 0.21 | 0.23 | 0.25 |
| | 0.70 – 0.61 | 0.18 | 0.20 | 0.22 | 0.24 | 0.27 |
| | 0.60 – 0.51 | 0.19 | 0.21 | 0.23 | 0.25 | 0.28 |
| | 0.50 – 0.41 | 0.19 | 0.21 | 0.23 | 0.26 | 0.30 |
| | ≤ 0.40 | 0.19 | 0.21 | 0.24 | 0.27 | 0.31 |
| 0.071 to 0.080 | 0.80 – 0.71 | 0.16 | 0.18 | 0.20 | 0.22 | 0.24 |
| | 0.70 – 0.61 | 0.17 | 0.18 | 0.20 | 0.23 | 0.25 |
| | 0.60 – 0.51 | 0.17 | 0.19 | 0.21 | 0.23 | 0.26 |
| | 0.50 – 0.41 | 0.17 | 0.19 | 0.21 | 0.24 | 0.27 |
| | ≤ 0.40 | 0.18 | 0.19 | 0.22 | 0.25 | 0.28 |
| 0.081 to 0.090 | 0.80 – 0.71 | 0.15 | 0.16 | 0.18 | 0.20 | 0.22 |
| | 0.70 – 0.61 | 0.15 | 0.17 | 0.18 | 0.21 | 0.23 |
| | 0.60 – 0.51 | 0.15 | 0.17 | 0.19 | 0.21 | 0.24 |
| | 0.50 – 0.41 | 0.16 | 0.17 | 0.19 | 0.22 | 0.25 |
| | ≤ 0.40 | 0.16 | 0.17 | 0.20 | 0.22 | 0.26 |

| Part A2: Other Criteria |
|--|
| Roof Max $U_o = 0.040$ |
| Wall and Ceiling Adjacent to Unconditioned Space Max $U_o = 0.10$ |
| Floor Over Unconditioned Space Max $U_o = 0.040$ |
| Wall Below Grade Min R-Value = 13 |

| Part A3: Unheated Slab-On-Grade Minimum R-Value | | | |
|--|----------------------|------|------|
| Insulation Orientation | Length of Insulation | | |
| | 24" | 36" | 48" |
| Horizontal | R=18 | R=15 | R=11 |
| Vertical | R=8 | R=6 | R=4 |

**Figure 63.1015-3
Alternate Component Package
ACP Table B**

| Part B1: Maximum Window Area / Gross Exterior Wall Area | | | | | | |
|--|---|--------------------|--------------------|--------------------|--------------------|-------------|
| Exterior Wall U_o | Shading Coefficient Range SC_x | U_{of} Range | | | | |
| | | 0.60 to 0.56 | 0.55 to 0.51 | 0.50 to 0.46 | 0.45 to 0.41 | ≤ 0.40 |
| ≤ 0.06 | 0.80 – 0.71 | 0.20 | 0.21 | 0.22 | 0.23 | 0.24 |
| | 0.70 – 0.61 | 0.21 | 0.22 | 0.24 | 0.25 | 0.27 |
| | 0.60 – 0.51 | 0.22 | 0.24 | 0.25 | 0.27 | 0.29 |
| | 0.50 – 0.41 | 0.24 | 0.25 | 0.27 | 0.30 | 0.32 |
| | ≤ 0.40 | 0.25 | 0.27 | 0.29 | 0.32 | 0.35 |
| 0.061 to 0.070 | 0.80 – 0.71 | 0.19 | 0.20 | 0.21 | 0.22 | 0.23 |
| | 0.70 – 0.61 | 0.20 | 0.21 | 0.22 | 0.24 | 0.25 |
| | 0.60 – 0.51 | 0.21 | 0.23 | 0.24 | 0.26 | 0.28 |
| | 0.50 – 0.41 | 0.22 | 0.24 | 0.26 | 0.28 | 0.31 |
| | ≤ 0.04 | 0.24 | 0.26 | 0.28 | 0.31 | 0.34 |
| 0.071 to 0.080 | 0.80 – 0.71 | 0.18 | 0.19 | 0.20 | 0.21 | 0.23 |
| | 0.70 – 0.61 | 0.19 | 0.20 | 0.21 | 0.23 | 0.24 |
| | 0.60 – 0.51 | 0.20 | 0.21 | 0.23 | 0.25 | 0.27 |
| | 0.50 – 0.41 | 0.21 | 0.23 | 0.25 | 0.27 | 0.29 |
| | ≤ 0.40 | 0.22 | 0.24 | 0.27 | 0.29 | 0.32 |
| 0.081 to 0.090 | 0.80 – 0.71 | 0.17 | 0.18 | 0.19 | 0.20 | 0.21 |
| | 0.70 – 0.61 | 0.18 | 0.19 | 0.20 | 0.21 | 0.23 |
| | 0.60 – 0.51 | 0.19 | 0.20 | 0.21 | 0.23 | 0.25 |
| | 0.50 – 0.41 | 0.20 | 0.21 | 0.23 | 0.25 | 0.28 |
| | ≤ 0.40 | 0.21 | 0.23 | 0.25 | 0.27 | 0.30 |

| Part B2: Other Criteria |
|--|
| Roof Max $U_o = 0.045$ |
| Wall and Ceiling Adjacent to Unconditioned Space Max $U_o = 0.11$ |
| Floor Over Unconditioned Space Max $U_o = 0.040$ |
| Wall Below Grade Min R-Value = 12 |

| Part B3: Unheated Slab-On-Grade Minimum R-Value | | | |
|--|----------------------|------|------|
| Insulation | Length of Insulation | | |
| Orientation | 24" | 36" | 48" |
| Horizontal | R=18 | R=15 | R=11 |
| Vertical | R=8 | R=6 | R=4 |

Figure 63.1015-4
Alternate Component Package
ACP Table C

| Part C1: Maximum Window Area / Gross Exterior Wall Area | | | | | | |
|--|---|--------------------|--------------------|--------------------|--------------------|-------------|
| Exterior Wall U_o | Shading Coefficient Range SC_x | U_{of} Range | | | | |
| | | 0.60 to 0.56 | 0.55 to 0.51 | 0.50 to 0.46 | 0.45 to 0.41 | ≤ 0.40 |
| ≤ 0.06 | 0.80 – 0.71 | 0.20 | 0.21 | 0.22 | 0.22 | 0.23 |
| | 0.70 – 0.61 | 0.22 | 0.23 | 0.24 | 0.25 | 0.26 |
| | 0.60 – 0.51 | 0.23 | 0.25 | 0.26 | 0.27 | 0.29 |
| | 0.50 – 0.41 | 0.25 | 0.27 | 0.29 | 0.30 | 0.32 |
| | ≤ 0.40 | 0.27 | 0.29 | 0.32 | 0.34 | 0.37 |
| 0.061 to 0.070 | 0.80 – 0.71 | 0.19 | 0.20 | 0.21 | 0.22 | 0.23 |
| | 0.70 – 0.61 | 0.21 | 0.22 | 0.23 | 0.24 | 0.25 |
| | 0.60 – 0.51 | 0.22 | 0.24 | 0.25 | 0.26 | 0.28 |
| | 0.50 – 0.41 | 0.24 | 0.26 | 0.27 | 0.29 | 0.31 |
| | ≤ 0.40 | 0.26 | 0.28 | 0.30 | 0.33 | 0.35 |
| 0.071 to 0.080 | 0.80 – 0.71 | 0.18 | 0.19 | 0.20 | 0.21 | 0.22 |
| | 0.70 – 0.61 | 0.20 | 0.21 | 0.22 | 0.23 | 0.24 |
| | 0.60 – 0.51 | 0.21 | 0.23 | 0.25 | 0.26 | 0.27 |
| | 0.50 – 0.41 | 0.23 | 0.25 | 0.26 | 0.28 | 0.30 |
| | ≤ 0.40 | 0.25 | 0.27 | 0.29 | 0.31 | 0.34 |
| 0.081 to 0.090 | 0.80 – 0.71 | 0.17 | 0.18 | 0.19 | 0.20 | 0.21 |
| | 0.70 – 0.61 | 0.19 | 0.20 | 0.21 | 0.22 | 0.23 |
| | 0.60 – 0.51 | 0.20 | 0.22 | 0.23 | 0.24 | 0.26 |
| | 0.50 – 0.41 | 0.22 | 0.23 | 0.25 | 0.27 | 0.29 |
| | ≤ 0.40 | 0.24 | 0.26 | 0.28 | 0.30 | 0.33 |

| Part C2: Other Criteria |
|--|
| Roof Max $U_o = 0.049$ |
| Wall and Ceiling Adjacent to Unconditioned Space Max $U_o = 0.11$ |
| Floor Over Unconditioned Space Max $U_o = 0.040$ |
| Wall Below Grade Min R-Value = 11 |

| Part C3: Unheated Slab-On-Grade Minimum R-Value | | | |
|--|----------------------|------|------|
| Insulation | Length of Insulation | | |
| Orientation | 24" | 36" | 48" |
| Horizontal | R=18 | R=15 | R=11 |
| Vertical | R=8 | R=6 | R=4 |

Comm 63.1016 System standards option. To comply with the system standards for building envelope thermal performance, the building shall comply with section 8.6 of ASHRAE standard 90.1 or with the system analysis design specified in IECC section 806 applied to the thermal envelope alone. Building site climate data shall be determined using Wisconsin division of state energy statistics or other source acceptable to the department.

Note: Section 8.6 of ASHRAE 90.1 Standard requires use of the latest version of the ENVSTD computer program, which is the computer program included in the ASHRAE 90.1 Standard to evaluate an envelope trade-off.

Note: ComCheck-EZ is a computer program that may be used only for determining building envelope compliance. The ComCheck-EZ computer program may be downloaded at: <http://www.energycodes.gov/>. The federal Department of Energy has issued a computer package called ComCheck-Plus, which establishes trade-offs between the building envelope, lighting, and HVAC equipment; however, this program has not been approved for use in Wisconsin since Wisconsin's lighting allowances are not the same as those included in the program.

History: CR 00-179; cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.1017 Design criteria. (1) THERMAL PERFORMANCE. (a) Except as provided in par. (b), the thermal performance values for the exterior envelope of buildings or areas of buildings that are warehouses that meet the criteria of s. Comm 63.1014 (2) (b), or that are factories shall not exceed the values in Table 63.1017-1. The calculation procedures of s. Comm 63.1019 shall be used to show compliance.

**Table 63.1017-1
Thermal Performance Values**

| Number of Stories | Thermal Performance Values* |
|-------------------|-----------------------------|
| 1-2 | 12 |
| 3-4 | 13 |
| 5-7 | 16 |
| 8-12 | 18 |
| 13-20 | 20 |
| Over 20 | 21 |

* Expressed in Btu/hour/square foot of above-grade exterior envelope. See s. Comm 63.1023 (2) and (3) for design conditions.

(b) The thermal performance values specified in par. (a) may be increased or decreased provided the U-value for other components is decreased or increased so the total heat gain or loss for the entire building envelope and floor area does not exceed the total heat gain or loss resulting from conformance to the values specified in this section.

(2) FLOORS OVER UNCONDITIONED SPACES. The overall heat transmission coefficient (U-value) for floors of heated or mechanically cooled spaces over unconditioned spaces shall not exceed 0.08 Btu/h-ft²-°F.

(3) SLAB-ON-GRADE PERIMETER INSULATION. For slab-on-grade floors with or without a grade beam, a foundation bearing wall or a foundation frost wall, the thermal resistance of the insulation around the perimeter of the floor shall not be less than the values shown in Table 63.1017-2. The insulation shall extend 48 inches in the vertical or horizontal direction or combination thereof with a total dimension of 48 inches. Slab-on grade perimeter insulation shall be moisture resistant.

**Table 63.1017-2
Perimeter Insulation Requirements¹**

| Slab-on-grade Perimeter Insulation | | Zone 1 | Zone 2 | Zone 3 | Zone 4 |
|------------------------------------|---------------------------|--------|--------|--------|--------|
| R = °F-ft ² -Hour | Unheated Slabs | 6.7 | 6.2 | 5.9 | 5.2 |
| Btu | Heated Slabs ² | 9.3 | 9.0 | 8.6 | 8.2 |

¹ See Fig. 63.1023 for zone definitions.

² Heated slabs have piping, duct work or other heat distribution system components embedded in or under them.

History: CR 00-179; cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.1018 Material properties. (1) ASHRAE FUNDAMENTAL DATA. Except as specified in sub. (2), when available, information on thermal properties, performance of building envelope sections, and components and heat transfer shall be obtained from ASHRAE *Handbook of Fundamentals*.

(2) EXCEPTIONS. (a) *Laboratory or field test measurements.* When the information is not available from ASHRAE *Handbook of Fundamentals*, the data may be obtained from laboratory or field-test measurements. If laboratory or field test measurements are used for envelope heat transmission, they shall be obtained using one of the following test methods:

1. ASTM C177, Test method by guarded hot plate apparatus.
2. ASTM C518, Test method by means of the heat flow meter apparatus.
3. ASTM C236, Standard test method by means of a guarded hot box.
4. ASTM C976, Standard test method by means of a calibrated hot box.
5. ASTM C335, Test method of horizontal pipe insulation.

(b) *Foam plastic insulation.* For foam plastic insulations that use a gas other than air as the insulating medium, laboratory or field tests shall be conducted on representative samples that have been aged for the equivalent of 5 years or until the R-Value has stabilized. The tests shall be conducted by an independent third party and shall be submitted for department product review and approval in accordance with ch. Comm 61.

(c) *Masonry or concrete units.* 1. Integrally insulated concrete masonry systems within the scope of the National Concrete Masonry Association (NCMA) shall be evaluated for the thermal performance of the masonry or concrete units in accordance with one of the following:

- a. Use the NCMA Evaluation Procedures for the Integrally-Insulated Concrete Masonry Walls.
- b. Use of default values as approved by the department may be used. No extrapolations or interpolations are allowed.

2. All other concrete or masonry units not within the scope of the NCMA Evaluation Procedures shall comply with one of the following methods for determining the thermal performance of the assembly or system:

- a. Use default values as approved by the department. No extrapolations or interpolations are allowed.
- b. Verify thermal performance through a laboratory or field test measurements specified in par. (a).

c. Use the department material approval process as specified in ch. Comm 61 to determine the U-factor.

History: CR 00-179; cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.1019 Required calculation procedures.

(1) GENERAL. The following procedures shall be used to calculate the thermal performance of above- and below-grade envelope sections of any building that is heated or mechanically cooled.

(2) OVERALL THERMAL TRANSMITTANCE (U₀). The overall thermal transmittance of the building envelope assembly shall be calculated in accordance with the following equation:

$$U_0 = \sum U_i A_i / A_0 = (U_1 A_1 + U_2 A_2 + \dots + U_n A_n) / A_0$$

where:

U₀ = The area-weighted average thermal transmittance of the gross area of an envelope assembly; that is the exterior wall assembly including fenestration and doors, the roof and ceiling assembly, and the floor assembly, Btu/h-ft²-°F.

A₀ = The gross area of the envelope assembly, ft².

U_i = The thermal transmittance of each individual path of the envelope assembly, for example, the opaque portion of the wall assembly, Btu/h-ft²-°F. U_i also equals 1/R_i where R_i is

the total resistance to heat flow of an individual path through an envelope assembly.

A_i = The area of each individual element of the envelope assembly, ft^2 .

(3) THERMAL TRANSMITTANCE (U_i) OF AN INDIVIDUAL PATH THROUGH AN ENVELOPE ASSEMBLY. The thermal transmittance of each envelope shall be determined with consideration of all major series and parallel heat flow paths through the elements of the assembly and film coefficients. Compression of insulation shall be considered in determining the thermal resistance.


(a) *Thermal transmittance of opaque elements.* The thermal transmittance of opaque elements of assemblies shall be determined using a series path procedure with correction for the presence of parallel paths within an element of the envelope assembly such as wall cavities with parallel paths through insulation and studs. An acceptable procedure shall be used, as specified in Table 63.1019-1. Figure 63.1019-1 illustrates a typical roof assembly.

Table 63.1019-1
Calculation Procedures for Evaluating Major Series and Parallel Heat Flow Paths

| Acceptable Procedures for Determining U_i for Opaque Elements | | |
|---|--|--|
| Sheathing | Framing | |
| | Metal | Nonmetal |
| Metal on One or Both Sides | Tests – s. Comm 63.1019 (3) (a) 1. a. Thermal Bridges – s. Comm 63.1019 (3) (a) 1. c. | Tests – s. Comm 63.1019 (3) (a) 1. a. Series or Parallel Path – s. Comm 63.1019 (3) (a) 2. |
| Nonmetal on Both Sides | Tests – s. Comm 63.1019 (3) (a) 1. a. Parallel Path Correction Factor – s. Comm 63.1019 (3) (a) 1. b. Zone Method – s. Comm 63.1019 (3) (a) 1. d. | Tests – s. Comm 63.1019 (3) (a) 1. a. Series or Parallel Path – s. Comm 63.1019 (3) (a) 2. |

Figure 63.1019-1

Calculation Procedure for Thermal Resistance of a Typical Roof Assembly

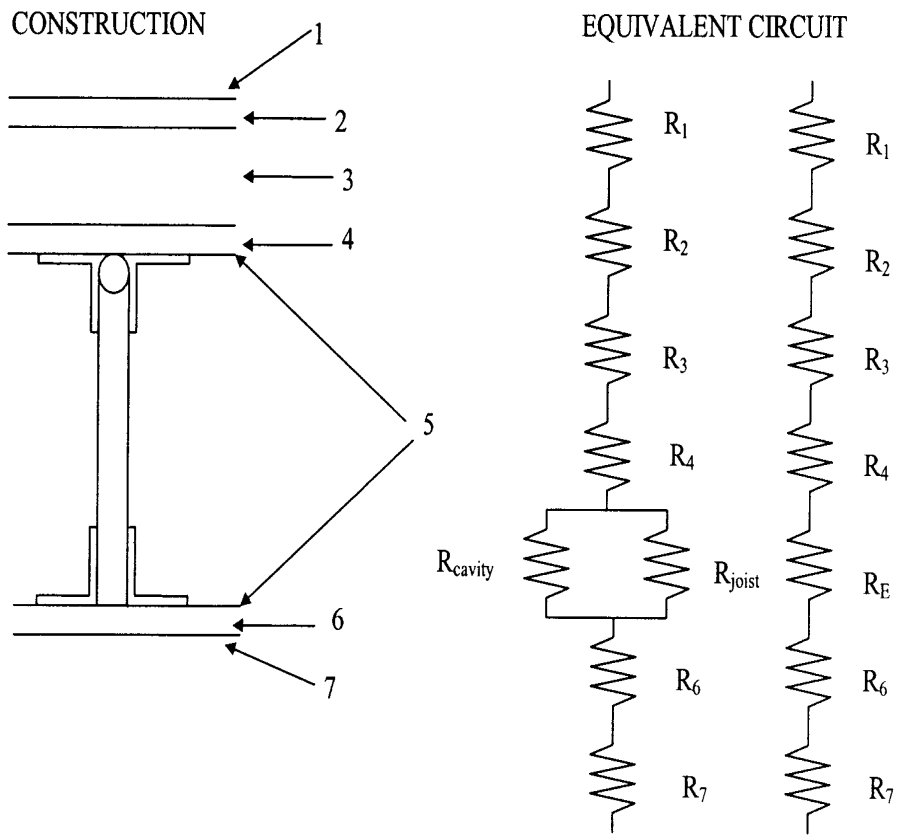

$$\text{Where } 1/R_e = \frac{(1 - \% \text{ joist})}{R_{cavity}} + \frac{\% \text{ Joist}}{R_{joist}} \text{ or } R_e = R_{cavity} \times F_c$$

R_e is the equivalent resistance of the element contacting the parallel path. F_c is the parallel path correction factor.

1. For envelope assemblies containing metal framing, the U_i shall be determined by using one of the following methods:

- a. Using results from laboratory or field-test measurements where one of the procedures specified in s. Comm 63.1018 is used.
- b. Using the thermal resistance of those roof and wall assemblies listed in Tables 63.1019-2 and 63.1019-3 shall be corrected using the following parallel path correction factor procedure:

Considering the total resistance of the series path:

$$U_i = 1/R_t$$

$$R_t = R_i + R_e$$

where:

R_t = The total resistance of the envelope assembly.

R_i = The resistance of the series elements (for $i = 1$ to n) excluding the parallel path element(s)

R_e = The equivalent resistance of the element containing the parallel path, the value of R_e is:

$$R_e = R\text{-value of insulation} \times F_c$$

The Parallel Path Correction Factors (F_c) may be obtained from tests conducted using procedures listed in s. Comm 63.1018. Parallel Path Correction Factors for some envelope assemblies are listed in Tables 63.1019-2 and 63.1019-3.

c. For elements with internal metallic structures bonded on one or both sides to a metal skin or covering, the calculation procedure specified in the ASHRAE *Handbook of Fundamentals*, or specified in ASHRAE standard 90.1, or other procedure acceptable to the department shall be used to include the effects of thermal bridges in metal construction.

d. For elements other than those covered above, the zone method described in the ASHRAE *Handbook of Fundamentals* shall be used for calculation.

**Table 63.1019-2
Roofs
Parallel Path Correction Factors^a**

| | | | | | | | | | | | | |
|-------------------|-----|------|------|------|------|------|------|------|------|------|------|------|
| Bridged R-Value | 0 | 5 | 10 | 15 | 20 | 25 | 30 | 35 | 40 | 45 | 50 | 55 |
| Correction Factor | 1.0 | 0.96 | 0.92 | 0.88 | 0.85 | 0.81 | 0.79 | 0.76 | 0.73 | 0.71 | 0.69 | 0.67 |

^a Table values are based upon metal trusses with 4-foot spacing that penetrate the insulation, and 0.66-inch diameter cross members every 1 foot.

**Table 63.1019-3
Wall Sections with Metal Studs
Parallel Path Correction Factors**

| Size of Members | Gauge of Stud ^a | Spacing of Framing, in. | Cavity Insulation R-Value | Correction Factor | Effective Framing/Cavity R-Values |
|-----------------|----------------------------|-------------------------|---------------------------|-------------------|-----------------------------------|
| 2 x 4 | 18-16 | 16 o.c. | R-11 | 0.50 | R-5.5 |
| | | | R-13 | 0.46 | R-6.0 |
| | | | R-15 | 0.43 | R-6.4 |
| 2 x 4 | 18-16 | 24 o.c. | R-11 | 0.60 | R-6.6 |
| | | | R-13 | 0.55 | R-7.2 |
| | | | R-15 | 0.52 | R-7.8 |
| 2 x 6 | 18-16 | 16 o.c. | R-19 | 0.37 | R-7.1 |
| | | | R-21 | 0.35 | R-7.4 |
| 2 x 6 | 18-16 | 24 o.c. | R-19 | 0.45 | R-8.6 |
| | | | R-21 | 0.43 | R-9.0 |
| 2 x 8 | 18-16 | 16 o.c. | R-25 | 0.31 | R-7.8 |
| 2 x 8 | 18-16 | 24 o.c. | R-25 | 0.38 | R-9.6 |

^a These factors can be applied to metal studs of this gauge or thinner.

2. For assemblies containing nonmetal framing, the U_i shall be determined from one of the laboratory or field test measurements specified in s. Comm 63.1018 or from the ASHRAE series-parallel method. Formulas in the ASHRAE *Handbook of Fundamentals*, shall be used for these calculations.

3. The opaque portions of doors shall be considered to be a part of the opaque wall assembly in the calculation of the average thermal transmittance. The thermal transmittance of the entire opaque door assembly including the frame shall be included in the calculation.

(b) *Thermal transmittance of fenestration.* Values of U_{of} shall be determined using one of the following methods:

1. The National Fenestration Rating Council (NFRC) 100 Procedure for Determining Fenestration Product U-Factors. The thermal performance values shall be certified through the NFRC Fenestration Thermal Performance Rating Certification and Labeling Program as described in the NFRC Product Certification Program LAP 1, PCP 1, and CAP 1.

2. The values for the appropriate product type given in IECC Table 102.5.2 (1) may be used.

Note: In order to use the component standards option of s. Comm 63.1015, the U -value of fenestration must be 0.60 or less.

(4) GROSS AREA OF ENVELOPE COMPONENTS. (a) *Roof assembly.* The gross area of a roof assembly consists of the total surface of the roof assembly exposed to outside air or unconditioned spaces. The roof assembly shall be considered to include all roof or ceiling components through which heat may flow between indoor and outdoor environments including skylight surfaces but excluding service openings. For thermal transmittance purposes when return air ceiling plenums are employed, the roof or ceiling assembly shall not include the resistance of the ceiling or the plenum space as part of the total resistance of the assembly.

(b) *Floor assembly.* The gross area of a floor assembly over outside or unconditioned spaces consists of the total surface of the floor assembly exposed to outside air or unconditioned space. The floor assembly shall include all floor components through

which heat may flow between indoor and outdoor or unconditioned space environments.

(c) *Exterior walls.* The gross area of exterior walls enclosing a heated or cooled space is measured on the exterior and consists of the opaque wall including between floor spandrels, peripheral edges of flooring, window areas including sash, and door areas, but excluding vents, grilles, and pipes.

(5) **SHADING COEFFICIENTS.** The shading coefficient (SC_x) for fenestration shall be obtained from the *ASHRAE Handbook of Fundamentals* or from manufacturer's test data or from IECC section 102.5.2. SC_x is the shading coefficient of the fenestration including permanently installed internal and external shading devices but excluding the effect of external shading projections, which is calculated separately. The shading coefficient used for louvered shade screens shall be determined using a profile angle of 30° as found in the *ASHRAE Handbook of Fundamentals*.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02; CR 04-016: am. (3) (a) (intro.) and 1. b., renum. Tables 63.1019-1 and 63.1019-2 to be Tables 63.1019-2 and 63.1019-3, renum. Figures 63.1019-1 and 63.1019-2 to be Table 63.1019-1 and Figure 63.1019-1 Register December 2004 No. 588, eff. 1-1-05.

Part 4 — Equipment and Systems

Comm 63.1020 Minimum equipment efficiencies.

(1) Space heating or cooling equipment that is not covered by 10 CFR Part 430, Energy Conservation Program for Consumer Products, shall have a minimum efficiency at the specified rating conditions not less than the values given in ASHRAE 90.1, section 10.4.1.

(2) Equipment ratings shall be certified under a nationally recognized certification program or rating procedure or by data furnished by the equipment manufacturer to show compliance with the minimum efficiency requirements.

Note: The following certification programs are accepted by the department: Gas Appliance and Manufacturers Association (GAMA) and Air-Conditioning and Refrigeration Institute (ARI).

(3) Compliance with minimum efficiency requirements specified for HVAC equipment shall include compliance with part-load requirements where indicated as well as standards for full-load requirements. The part-load efficiency shall be determined as specified in ASHRAE 90.1.

(4) Space heating or cooling equipment used to provide additional functions, such as water heating for plumbing, as part of a combination or integrated system shall comply with minimum performance requirements for the appropriate space heating or cooling equipment category.

(5) Equipment providing water heating for plumbing that is used to provide additional functions, such as space heating, as part of a combination or integrated system shall comply with minimum performance requirements for water heating equipment as specified in s. Comm 84.20 (5) (n).

(6) Combination space and plumbing water heating equipment shall comply with IECC section 504.2.2 and s. Comm 63.0504 (1).

Note: See ch. Comm 64 for additional requirements for combined systems.

(7) Equipment that is not used for comfort cooling or comfort heating is exempt from the energy efficiency requirements of this chapter.

Note: Omission of minimum performance requirements for certain classes of HVAC equipment does not preclude use of that equipment.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.1021 Field-assembled equipment and components. When components, such as indoor or outdoor coils, from more than one manufacturer are used as parts of air-conditioning or heating equipment, component efficiencies shall be specified based on data provided by the component manufacturers.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.1022 Heat pump equipment controls.

Controls for heat pumps equipped with supplementary heaters that are installed in residential buildings shall comply with IECC section 503.3.2.3, and controls for equipment installed in commercial buildings shall comply with IECC sections 803.3.3.1.1.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.1023 Load calculations for sizing.

(1) **CALCULATION PROCEDURES.** Heating and cooling system design loads for the purpose of sizing systems and equipment shall be determined in accordance with the procedures described in the *ASHRAE Handbook of Fundamentals*, or a similar computation procedure approved by the department. For those design parameters addressed in subs. (2) to (6), the values specified shall be used.


Note: This section does not require the installation of cooling equipment.

(2) **INDOOR DESIGN CONDITIONS.** The winter indoor design temperature is specified in Table 64.0403. When air conditioning is provided in accordance with ch. Comm 64, the summer indoor design temperature is 78°F or lower.

(3) **OUTDOOR DESIGN CONDITIONS.** Winter maximum and summer minimum for outdoor design temperatures shall be taken from Figure 63.1023.

Note: Systems may be designed for colder winter temperatures or for warmer summer temperatures.

**Figure 63.1023
Outdoor Design Conditions**

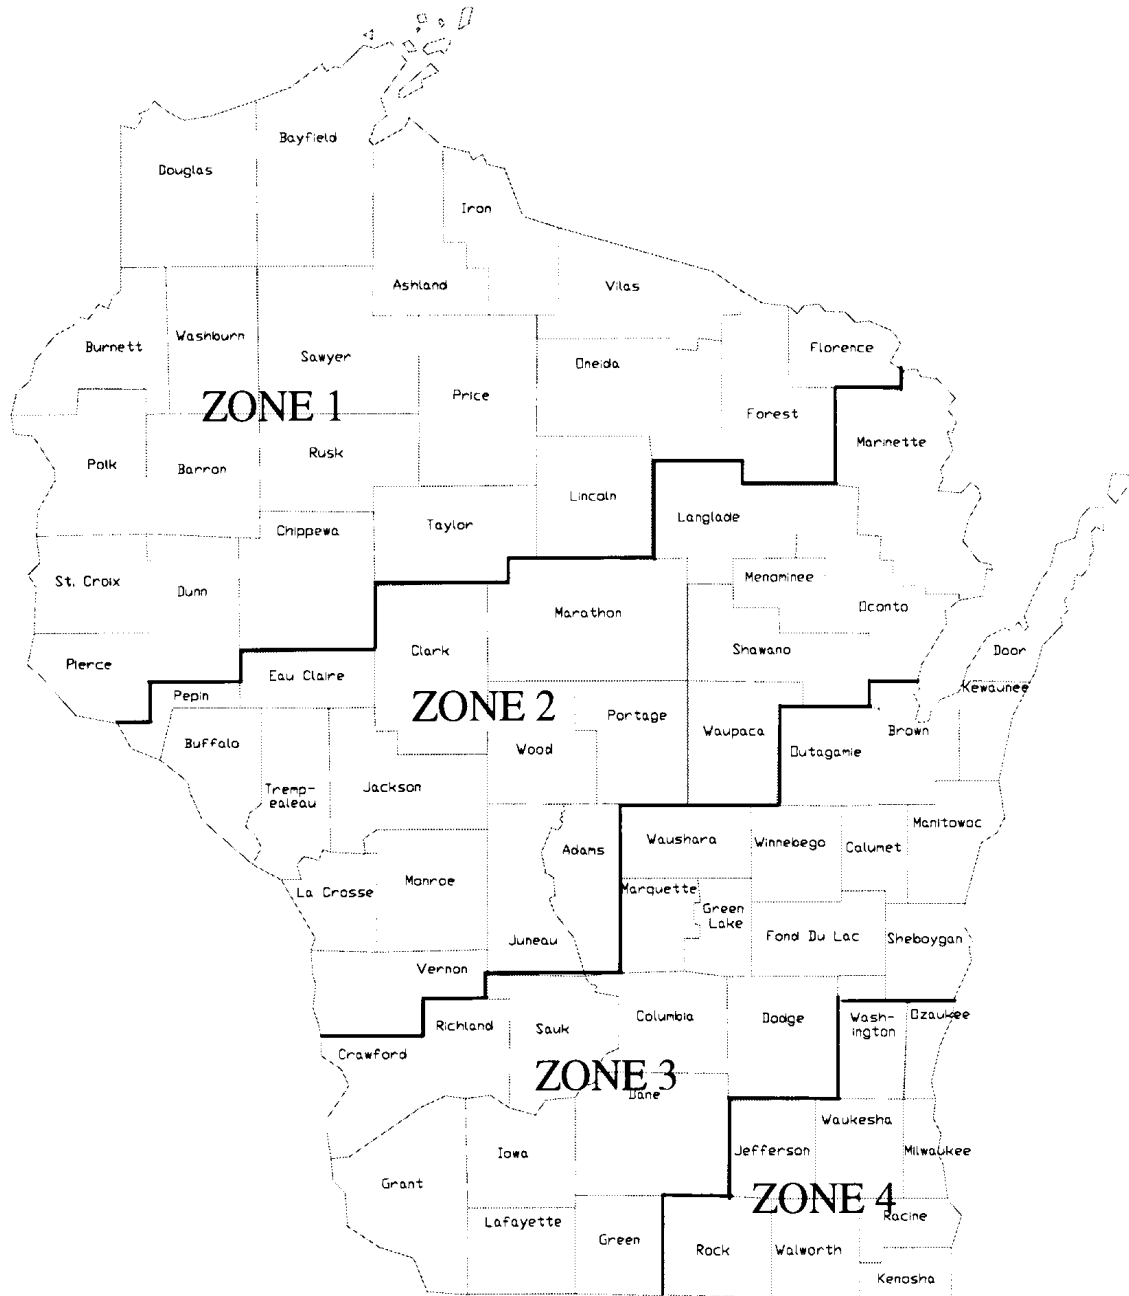

| Zone | Winter | Summer | |
|------|----------------------|------------------|------------------|
| | Design Temp. (°F) | Dry Bulb (°F) | Wet Bulb (°F) |
| 1 | -25 | 86 | 75* |
| 2 | -20 | 87 | 75 |
| 3 | -15 | 87 | 75 |
| 4 | -10 | 89 | 77 |

*Exception: For Douglas, Bayfield, Ashland and Iron Counties, use 70°F summer wet bulb design temperature.

(4) **VENTILATION.** Outdoor air ventilation loads shall be based on ventilation rates specified in ch. Comm 64.

(5) **ENVELOPE.** Envelope heating and cooling loads shall be based on envelope characteristics such as thermal conductance, shading coefficient, and air leakage consistent with the values used to demonstrate compliance with this subchapter, Part 3, building envelope.

(6) **LIGHTING.** Lighting loads shall be based on actual design lighting levels or power budgets consistent with subch. III, Part 5. Lighting loads may not be included for the purpose of calculating design heating loads.

History: CR 00-179; cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.1024 System and equipment sizing.

HVAC systems and equipment shall be sized to provide the minimum space and system loads calculated in accordance with s. Comm 63.1023. Heating and cooling equipment and systems shall meet the minimum efficiencies in IECC Table 803.2.2 (1).

History: CR 00-179; cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.1026 Temperature controls. (1) SYSTEM CONTROL.

Each HVAC system shall include at least one temperature control device.

(2) **ZONE CONTROLS.** (a) *Individual thermostatic controls.* 1. 'General.' Except as provided in subd. 2., the supply of heating and cooling energy to each zone shall be controlled by individual thermostatic controls responding to temperature within the zone.

2. 'Exceptions.' Independent perimeter systems that are designed to offset only envelope heat losses or gains, or both, may serve one or more zones also served by an interior system with the following limitations:

a. The perimeter system shall include at least one thermostatic control zone for each building exposure having exterior walls facing only one orientation for 50 contiguous feet or more; and

b. The perimeter system heating and cooling supply shall be controlled by thermostats located within the zones served by the system.

(b) *Zone controls for comfort heating.* Where used to control comfort heating, zone thermostatic controls shall be capable of being set locally or remotely by adjustment or selection of sensors down to 55°F or lower.

(c) *Zone controls for comfort cooling.* Where used to control comfort cooling, zone thermostatic controls shall be capable of being set locally or remotely by adjustment or selection of sensors up to 85°F or higher.

(d) *Zone controls for both heating and cooling.* 1. 'General.' Except as provided in subd. 2., zone thermostatic controls used to control both comfort heating and cooling shall be capable of providing a temperature range, or deadband, of at least 5°F within which the supply of heating and cooling energy to the zone is shut off or reduced to a minimum.

2. 'Exceptions.' a. Deadbands are not required for special occupancy, special usage, or required systems where deadband controls are not appropriate.

b. Deadbands are not required for buildings complying with the ASHRAE energy cost budget method under subch. III, Part 5, if, in the proposed building energy analysis, heating and cooling

thermostat set-points are set to the same value between 70°F and 75°F inclusive and assumed to be constant throughout the year.

c. Deadbands may be omitted for thermostats that have manual changeover between heating and cooling modes.

History: CR 00-179; cr. Register December 2001 No. 552, eff. 7-1-02; CR 04-016; am. (2) (b) Register December 2004 No. 588, eff. 1-1-05.

Comm 63.1027 Zone controls. (1) THERMOSTATIC AND HUMIDISTATIC CONTROLS. Except as provided in sub. (2), zone thermostatic and humidistatic controls shall be capable of operating in sequence to supply heating and cooling energy to the zone. Such controls shall prevent any of the following:

(a) Reheating.

(b) Recooling.

(c) Mixing or simultaneous supply of air that has been previously mechanically heated and air that has been previously cooled, either by mechanical refrigeration or by economizer systems.

(d) Other simultaneous operation of heating and cooling systems to the same zone.

(2) **EXCEPTIONS.** All of the following systems and zones are exempt from this section:

(a) Variable air volume (VAV) systems which, during periods of occupancy, are designed to reduce the air supply to each zone to a minimum before reheating, recooling, or mixing takes place. This minimum volume shall be no greater than the largest of the following:

1. 30% of the peak supply volume.

2. The minimum required to meet ventilation requirements of ch. Comm 64.

3. 0.4 cfm/square foot of zone conditioned floor area.

(b) Zones where special pressurization relationships or cross-contamination requirements are such that VAV systems are impractical, such as isolation rooms, operating areas of hospitals, and laboratories.

(c) Where at least 75% of the energy for reheating or for providing warm air in mixing systems is provided from a site-recovered or site-solar energy source.

(d) Zones where specified humidity levels are required to satisfy process needs, such as computer rooms and museums.

(e) Zones with a peak supply air quantity of 150 cfm or less.

(f) Multiple reheat systems serving multiple zones, other than those employing variable air volume for temperature control, that are provided with controls that will automatically reset the system cold air supply to the highest temperature level that will satisfy the zone requiring the coolest air. In the case of direct expansion cooling systems, cooling may be cycled based on the zone requiring the coolest air or average room temperature for all zones.

(g) Dual duct and multizone systems that are provided with controls that will automatically reset all of the following:

1. The cold duct air supply to the highest temperature that will satisfy the zone requiring the coolest air.

2. The hot duct air supply to the lowest temperature that will satisfy the zone requiring the warmest air.

(h) Systems in which heated air is recooled, directly or indirectly, to maintain space temperature that are provided with controls that will automatically reset the temperature to which the supply air is heated to the lowest level that will satisfy the zone requiring the warmest air.

(i) A multiple zone heating, ventilating and air-conditioning system that employs reheating or recooling for control of not more than 5,000 cfm or 20% of the total supply air of the system, whichever is less.

(3) **OFF-HOUR CONTROLS.** Except as provided in pars. (a) to (c), mechanical HVAC systems shall be equipped with automatic controls capable of accomplishing a reduction of energy use through control setback or equipment shutdown during periods of

nonuse or alternate use of the zones served by the system. The following systems are exempt from this subsection:

- (a) Systems serving areas expected to operate continuously.
- (b) Where it can be shown that setback or shutdown will not result in a decrease in overall building energy costs.
- (c) Equipment with full load demands of 2 kW or 6826 Btu/h or less that is controlled by readily accessible manual off-hour controls.

History: CR 00-179; cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.1028 Humidity control. If a system is equipped with a means for adding moisture to maintain specific humidity levels in a zone or zones, a humidistat shall be provided in accordance with IECC section 503.3.2.4 for residential buildings and IECC section 803.2.3.2 for commercial buildings.

History: CR 00-179; cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.1029 Insulation, materials and construction. (1) GENERAL. Insulation required by subs. (2) and (3) shall

be suitably protected from damage. Insulation shall be installed in accordance with practices acceptable to the department. The department accepts MICA Commercial and Industrial Insulation Standards as an insulation installation practice.

(2) PIPING INSULATION. Except as provided in pars. (a) to (c), recirculating plumbing system piping, plumbing piping in the first 8 feet from storage tanks for noncirculating systems, any piping served by a self-regulating electric heating cable, HVAC system piping, and related HVAC fluid conveying conduit, such as heat exchanger bodies, shall be thermally insulated in accordance with Table 63.1029 or equivalent. The following piping or conduit is exempted from this subsection:

- (a) Factory-installed piping or conduit within HVAC equipment tested and rated in accordance with s. Comm 63.1020;
- (b) Piping or conduit for which no insulation is specified in Table 63.1029.
- (c) Where it can be shown that the heat gain or heat loss to or from piping or conduit without insulation will not increase building energy use.

**Table 63.1029
Plumbing and HVAC Piping Minimum Insulation (R-Value)**

| Fluid Design Operating Temp. Range, °F | Insulation Conductivity ^a | | Nominal Pipe Diameter | | | | | |
|--|--|-------------------------------|---|--------------------|----------------------|----------------------|--------------|------------------|
| | Conductivity Range Btu·in./ (h·ft ² ·°F) | Mean Rating Temp. °F | Runouts ^b up to 2 inches | 1 inch and less | 1-1/4 to 2 inches | 2-1/2 to 4 inches | 5 & 6 inches | 8 inches & up |
| Heating systems (Steam, Steam Condensate, and Hot Water) | | | | | | | | |
| Above 350 | 0.32-0.34 | 250 | R-4.4 | R-4.4 | R-7.4 | R-8.8 | R-10.3 | R-10.3 |
| 251-350 | 0.29-0.31 | 200 | R-4.8 | R-4.8 | R-8.1 | R-8.1 | R-11.3 | R-11.3 |
| 201-250 | 0.27-0.30 | 150 | R-3.3 | R-3.3 | R-5.0 | R-6.7 | R-6.7 | R-11.7 |
| 141-200 | 0.25-0.29 | 125 | R-1.8 | R-1.8 | R-5.2 | R-5.2 | R-5.2 | R-5.2 |
| 105-140 | 0.24-0.28 | 100 | R-1.8 | R-1.8 | R-3.6 | R-3.6 | R-3.6 | R-5.4 |
| Domestic and Service Hot Water systems^c | | | | | | | | |
| 105 and greater | 0.24-0.28 | 100 | R-1.8 | R-3.6 | R-3.6 | R-5.4 | R-5.4 | R-5.4 |
| Cooling systems (Chilled water, brine, and refrigerant)^d | | | | | | | | |
| 40-55 | 0.23-0.27 | 75 | R-1.9 | R-1.9 | R-2.8 | R-3.7 | R-3.7 | R-3.7 |
| Below 40 | 0.23-0.27 | 75 | R-3.7 | R-3.7 | R-5.6 | R-5.6 | R-5.6 | R-5.6 |

^a For insulation outside the state conductivity range, the minimum thickness (T) shall be determined as follows: $T = PR [(1+t/PR)^{k/k-1} - 1]$, where T = minimum insulation thickness for material with conductivity K, in.; PR = actual outside radius of pipe, in.; t = insulation thickness, in.; K = conductivity of alternate material at mean rating temperature indicated for the applicable fluid temperature; and k = the lower value of the conductivity range listed for the applicable fluid temperature.

^b Runouts to individual terminal units not exceeding 12 ft. in length.

^c Applies to recirculating sections of service or domestic hot water systems and first 8 ft. from storage tank for nonrecirculating systems.

^d The required minimum thickness does not consider water vapor transmission and condensation.

(3) AIR-HANDLING SYSTEM INSULATION. All air-handling ducts and plenums installed as part of an HVAC air distribution system shall be thermally insulated in accordance with s. Comm 63.0803 (2) (f).

(4) ADDITIONAL DUCT SEALING. (a) *General.* Except as specified in par. (b), ductwork and plenums shall be sealed in accordance with Table 63.1029-1, and shall meet the duct seal classes specified in Table 63.1029-2.

(b) *Exception.* Ductwork and plenums confined within individual dwelling units shall comply with s. Comm 63.0503 (2) (c).

**Table 63.1029-1
Minimum Duct Seal Level^a**

| Duct Location | Duct Type | | | |
|-----------------------|---------------------------------------|---------------------------------------|---------|--------|
| | Supply | | Exhaust | Return |
| | ≤ 2 in. w.c. ^b (500 Pa) | > 2 in. w.c. ^b (500 Pa) | | |
| Outdoors ^c | A | A | C | A |
| Unconditioned Spaces | B | A | C | B |
| Conditioned Spaces | C | B | B | C |

^a See Table 63.1029-2 definition of Seal Class.

^b Duct design static pressure classification.

^c Includes indirectly conditioned spaces, such as return air plenums.

**Table 63.1029-2
Duct Seal Classes**

| Duct Seal Class | Sealing Requirements ^a |
|-----------------|--|
| A | All transverse joints, longitudinal seams, and duct wall penetrations. Pressure sensitive tape shall not be used as the primary sealant. |
| B | All transverse joints and longitudinal seams. Pressure sensitive tape shall not be used as the primary sealant. |
| C | Transverse joints only. |

^a Longitudinal seams are joints oriented in the direction of airflow. Transverse joints are connections of two duct sections and are oriented perpendicular to airflow. Duct wall penetrations are openings made by any screw fastener, pipe, rod or wire. Spiral lock seams in round and flat oval duct need not be sealed. All other connections are considered transverse joints, including but not limited to spin-ins, taps and other branch connections, access door frames and jambs, and duct connections to equipment.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02; CR 01-139: r. and recr. (4) Register June 2002 No. 558, eff. 7-1-02; **CR 04-016: r. and recr. Table 63.1029 Register December 2004 No. 588, eff. 1-1-05.**

Comm 63.1030 Hydronic system controls. Hydronic system controls shall comply with IECC section 803.3.3.7.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.1031 Economizer controls. (1) FAN SYSTEM. Except as provided in sub. (2), each fan system shall be

designed and capable of being controlled to take advantage of favorable weather conditions to reduce mechanical cooling requirements. The system shall include either of the following:

(a) A temperature or enthalpy air economizer system which is capable of automatically modulating outside air and return air dampers to provide 100% of the design supply air quantity as outside air for cooling;

(b) A water economizer system, which is capable of cooling supply air by direct evaporation, indirect evaporation, or both. Such a system shall be designed and capable of being controlled to provide 100% of the expected system cooling load at outside air temperatures of 50°F dry-bulb/40°F wet-bulb and below.

(2) EXCEPTIONS. All of the following systems are exempt from this subsection:

(a) Individual fan-cooling units with a supply capacity of less than 2,000 cfm or a total system cooling capacity of less than 62,000 Btu/hour for split systems or less than 36,000 Btu/hour for all other types. The total capacity of all such units complying by use of this exception shall not exceed 600,000 Btu/hour per building or 10% of the total installed cooling capacity, whichever is larger;

(b) Systems with air or evaporatively cooled condensers for which it can be shown that the use of outdoor air cooling affects the operation of other systems, such as humidification, dehumidification, or supermarket refrigeration systems, so as to increase overall building energy costs;

Note: Other areas that may use controlled humidification or dehumidification are computer rooms, museums, library stacks and drafting rooms.

(c) Where the overall building energy use resulting from alternative designs, such as internal to external zone heat recovery systems, can be shown to be less than those resulting from an economizer system.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.1032 Electrical motors. (1) PERMANENTLY WIRED MOTORS. Any permanently wired motor that meets all of the criteria specified in pars. (a) through (g) shall meet the efficiency requirements specified in Table 63.1032 and the requirements of this section:

(a) The motor is used in a HVAC fan or pumping system.

(b) The motor is polyphase.

(c) The motor is one horsepower or more.

(d) The motor is a design A or B squirrel-cage, foot-mounted, T-frame induction motor that has synchronous speeds of 3600, 1800, 1200, and 900 rpm.

(e) The motor is expected to operate more than 1000 hours per year.

(f) The motor is not a multispeed motor used in a system designed to use more than one speed.

(g) The motor is not a component of equipment that meets the efficiency requirements of s. Comm 63.1020 where motor input is included in the determination of the equipment efficiency.

(2) MOTOR NAMEPLATE. The motor nameplate shall list the minimum nominal full-load motor efficiency.

Note: Motors that are classified as "energy efficient" under the National Electric Manufacturer's Association Standard MG 12.55, dated 3-14-91, are acceptable to the department as meeting the efficiency requirements of this section.

Table 63.1032
Minimum Acceptable Nominal Full-Load Motor Efficiency for Single-Speed Polyphase Squirrel-Cage Induction Motors Having Synchronous Speeds of 3600, 1800, 1200 and 900 rpm

| Full-Load Efficiencies—Open Motors | | | | | | | | |
|------------------------------------|--------------------|--------------------|--------------------|--------------------|--------------------|--------------------|--------------------|--------------------|
| HP | 2-Pole | | 4-Pole | | 6-Pole | | 8-Pole | |
| | Nominal Efficiency | Minimum Efficiency | Nominal Efficiency | Minimum Efficiency | Nominal Efficiency | Minimum Efficiency | Nominal Efficiency | Minimum Efficiency |
| 1.0 | — | — | 82.5 | 81.5 | 80.0 | 78.5 | 74.0 | 72.0 |
| 1.5 | 82.5 | 81.5 | 84.0 | 82.5 | 84.0 | 82.5 | 75.5 | 74.0 |
| 2.0 | 84.0 | 82.5 | 84.0 | 82.5 | 85.5 | 84.0 | 85.5 | 84.0 |
| 3.0 | 84.0 | 82.5 | 86.5 | 85.5 | 86.5 | 85.5 | 86.5 | 85.5 |
| 5.0 | 85.5 | 84.0 | 87.5 | 86.5 | 87.5 | 86.5 | 87.5 | 86.0 |
| 7.5 | 87.5 | 86.5 | 88.5 | 87.5 | 88.5 | 87.5 | 88.5 | 87.5 |
| 10.0 | 88.5 | 87.5 | 89.5 | 88.5 | 90.2 | 89.5 | 89.5 | 88.5 |
| 15.0 | 89.5 | 88.5 | 91.0 | 90.2 | 90.2 | 89.5 | 89.5 | 88.5 |
| 20.0 | 90.5 | 89.5 | 91.0 | 90.2 | 91.0 | 90.2 | 90.2 | 89.5 |
| 25.0 | 91.0 | 90.2 | 91.7 | 91.0 | 91.7 | 91.0 | 90.2 | 89.5 |
| 30.0 | 91.0 | 90.2 | 92.4 | 91.7 | 92.4 | 91.7 | 91.0 | 90.2 |
| 40.0 | 91.7 | 91.0 | 93.0 | 92.4 | 93.0 | 92.4 | 91.0 | 90.2 |
| 50.0 | 92.4 | 91.7 | 93.0 | 92.4 | 93.0 | 92.4 | 91.7 | 91.0 |
| 60.0 | 93.0 | 92.4 | 93.6 | 93.0 | 93.6 | 93.0 | 92.4 | 91.7 |
| 75.0 | 93.0 | 92.4 | 94.1 | 93.6 | 93.6 | 93.0 | 93.6 | 93.0 |
| 100.0 | 93.0 | 92.4 | 94.1 | 93.6 | 94.1 | 93.6 | 93.6 | 93.0 |
| 125.0 | 93.6 | 93.0 | 94.5 | 94.1 | 94.1 | 93.6 | 93.6 | 93.0 |
| 150.0 | 93.6 | 93.0 | 95.0 | 94.5 | 94.5 | 94.1 | 93.6 | 93.0 |
| 200.0 | 94.5 | 94.1 | 95.0 | 94.5 | 94.5 | 94.1 | 93.6 | 93.0 |

| Full-Load Efficiencies—Enclosed Motors | | | | | | | | |
|--|--------------------|--------------------|--------------------|--------------------|--------------------|--------------------|--------------------|--------------------|
| HP | 2-Pole | | 4-Pole | | 6-Pole | | 8-Pole | |
| | Nominal Efficiency | Minimum Efficiency | Nominal Efficiency | Minimum Efficiency | Nominal Efficiency | Minimum Efficiency | Nominal Efficiency | Minimum Efficiency |
| 1.0 | 75.5 | 74.0 | 82.5 | 81.5 | 80.0 | 78.5 | 74.0 | 72.0 |
| 1.5 | 82.5 | 81.5 | 84.0 | 82.5 | 85.5 | 84.0 | 77.0 | 75.5 |
| 2.0 | 84.0 | 82.5 | 84.0 | 82.5 | 86.5 | 85.5 | 82.5 | 81.5 |
| 3.0 | 85.5 | 84.0 | 87.5 | 86.5 | 87.5 | 86.5 | 84.0 | 82.5 |
| 5.0 | 87.5 | 86.5 | 87.5 | 86.5 | 87.5 | 86.5 | 85.5 | 84.0 |
| 7.5 | 88.5 | 87.5 | 89.5 | 88.5 | 89.5 | 88.5 | 85.5 | 84.0 |
| 10.0 | 89.5 | 88.5 | 89.5 | 88.5 | 89.5 | 88.5 | 88.5 | 87.5 |
| 15.0 | 90.2 | 89.5 | 91.0 | 90.2 | 90.2 | 89.5 | 88.5 | 87.5 |
| 20.0 | 90.2 | 89.5 | 91.0 | 90.2 | 90.2 | 89.5 | 89.5 | 88.5 |
| 25.0 | 91.0 | 90.2 | 92.4 | 91.7 | 91.7 | 91.0 | 89.5 | 88.5 |
| 30.0 | 91.0 | 90.2 | 92.4 | 91.7 | 91.7 | 91.0 | 91.0 | 90.2 |
| 40.0 | 91.7 | 91.0 | 93.0 | 92.4 | 93.0 | 92.4 | 91.0 | 90.2 |
| 50.0 | 92.4 | 91.7 | 93.0 | 92.4 | 93.0 | 92.4 | 91.7 | 91.0 |
| 60.0 | 93.0 | 92.4 | 93.6 | 93.0 | 93.6 | 93.0 | 91.7 | 91.0 |
| 75.0 | 93.0 | 92.4 | 94.1 | 93.6 | 93.6 | 93.0 | 93.0 | 92.4 |
| 100.0 | 93.6 | 93.0 | 94.5 | 94.1 | 94.1 | 93.6 | 93.0 | 92.4 |
| 125.0 | 94.5 | 94.1 | 94.5 | 94.1 | 94.1 | 93.6 | 93.6 | 93.0 |
| 150.0 | 94.5 | 94.1 | 95.0 | 94.5 | 95.0 | 94.5 | 93.6 | 93.0 |
| 200.0 | 95.0 | 94.5 | 95.0 | 94.5 | 95.0 | 94.5 | 94.1 | 93.6 |

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02.

Part 5 — Lighting Power

Comm 63.1040 Scope. (1) GENERAL. Except as specified in sub. (2), ss. Comm 63.1041 to 63.1051 shall apply to all of the following rooms, spaces and areas:

- (a) Interior spaces of buildings.
- (b) Building exteriors and exterior areas such as entrances, exits, and loading docks.
- (c) Roads, grounds, parking, and other exterior areas where lighting is energized through the building electrical service.

(2) EXCEPTIONS. Lighting that is specifically designated as required by a health or life safety regulation is exempt.

History: CR 00-179; cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.1041 Exterior lighting power requirement. The exterior lighting power of a building or a group of buildings in a multibuilding facility calculated in accordance with s. Comm 63.1042 shall be no greater than the lighting power allowance calculated in accordance with s. Comm 63.1043.

History: CR 00-179; cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.1042 Calculation of exterior lighting power. The calculated exterior lighting power is the sum of the power for all exterior luminaires that are included in s. Comm 63.1040, minus the power for exempted exterior lighting as specified in subs. (1) to (5).

- (1) Task lighting for outdoor activities such as manufacturing and processing facilities.
- (2) Lighting power for theatrical productions.
- (3) Lighting for outdoor sporting facilities, including playing and seating areas.
- (4) Lighting for dwelling units that is controlled within the dwelling unit.
- (5) Exit way or egress lighting required by IBC section 1003.2.11 that has switching regulated by Article 700 of the National Electrical Code.

History: CR 00-179; cr. Register December 2001 No. 552, eff. 7-1-02; correction in (5) made under s. 13.93 (2m) (b) 7., Stats., Register April 2003 No. 568.

Comm 63.1043 Exterior lighting power allowance.

(1) CALCULATION METHOD. The exterior lighting power allowance for a building or a multibuilding facility is the sum of all the allowed lighting powers for all exterior areas. The lighting power for each area is calculated by multiplying the unit power allowance from Table 63.1043 by the applicable length or area.

(2) APPLICABLE AREAS AND LENGTHS. The applicable areas and lengths used with Table 63.1043 to calculate the exterior lighting power allowance are described in pars. (a) to (d).

(a) Horizontal areas of grounds, driveways, lots, gardens or parks may be calculated as if they were flat, or the actual area of the surfaces of contours may be used.

(b) Canopied areas are the area of the horizontal surface under the canopy. A canopy includes an exterior awning, soffit or ornamental or functional structure signifying a main entrance to a building.

(c) The linear length of door openings is measured in plan view and includes the door opening only. Sidelights and other portions of the door, which do not open, are not included.

(d) The applicable area of the building facade includes all vertical and horizontal areas that are intended to be illuminated.

Table 63.1043
Exterior Lighting Unit Power Allowances

| Area Description | Allowances |
|--|--|
| Canopies (not associated with an entrance) | 4 W/ft ² |
| Commerce or merchandizing areas | 4 W/ft ² |
| Exit (with or without canopy) | 16 W/lin ft of door opening |
| Entrance (without canopy) | 20 W/lin ft of door opening |
| Entrance (with canopy) | |
| High traffic (retail, hotel, airport, theater, etc.) | 6.6 W/ft ² of canopied area |
| Light traffic (hospital, office, school, etc.) | 2.6 W/ft ² of canopied area |
| Loading area | 0.26 W/ft ² |
| Loading door | 13 W/lin ft of door opening |
| Building exterior surfaces/facades | 0.16 W/ft ² of surface area to be illuminated |
| Storage and nonmanufacturing work areas | 0.13 W/ft ² |
| Other activity areas for casual use such as picnic grounds, gardens, parks and other landscaped areas. | 0.06 W/ft ² |
| Private driveways/walkways | 0.06 W/ft ² |
| Public driveways/walkways | 0.10 W/ft ² |
| Private parking lots | 0.08 W/ft ² |
| Public parking lots | 0.12 W/ft ² |
| Pump island canopies | 4 W/ft ² |

History: CR 00-179; cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.1044 Interior lighting power requirement.

The interior lighting power of a building calculated in accordance with s. Comm 63.1045 shall be no greater than the interior lighting power allowance calculated in accordance with s. Comm 63.1046.

History: CR 00-179; cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.1045 Calculation of interior lighting power.

The calculated interior lighting power of a building is the total watts of all interior luminaires including, but not limited to, track and flexible lighting systems, lighting that is integral with modular furniture, movable displays and cabinets, and internally illuminated case work for task or display purposes, minus any adjustments allowed under subs. (1) through (4).

(1) MULTIPLE INTERLOCKED LIGHTING SYSTEMS SERVING A SPACE. When multiple interlocked lighting systems serve a space, the watts of all systems except the system with the highest wattage may be excluded from the calculated lighting power if:

(a) The lighting systems are interlocked to prevent simultaneous operation; or

(b) The lighting systems are controlled by a preset dimming system or other device that prevents simultaneous operation of more than one lighting system, except under the direct control of authorized personnel.

(2) REDUCTION OF WATTAGE THROUGH CONTROLS. The watts of any luminaire that is controlled may be reduced by the number of watts times the applicable power adjustment factor from Table 63.1045 if all of the following are met:

- (a) The control complies with s. Comm 63.1051.
- (b) At least 50% of the light output of the luminaire is within the applicable space listed in Table 63.1045.
- (c) Except as noted in Table 63.1045, only one power adjustment factor is used for the luminaire.
- (d) For daylighting control credits, the luminaire is controlled by the daylighting control, and the luminaire is located within the daylit area.
- (e) For automatic time switch control devices, a timed manual override is provided at each switch location required by s. Comm 63.1050. The override device shall control only the lights in the surrounding area enclosed by ceiling–height partitions.

Table 63.1045
Lighting Power Adjustment Factors

| Type of Control | Type of Space | Factor |
|--|---|--------|
| Automatic daylighting controls | Daylit areas | |
| Continuous dimming | | 0.30 |
| Multiple step dimming | | 0.20 |
| On/off | | 0.10 |
| Automatic time switch control device in conjunction with automatic daylighting controls | Daylit areas ≤ 250 square feet | |
| Continuous dimming | | 0.35 |
| Multiple step dimming | | 0.25 |
| On/off | | 0.15 |
| Automatic time switch control device in conjunction with lumen maintenance and automatic daylighting controls | Daylit areas ≤ 250 square feet | |
| Continuous dimming | | 0.40 |
| Multiple step dimming | | 0.30 |
| On/off | | 0.20 |
| Lumen maintenance | Any space | 0.10 |
| Lumen maintenance in conjunction with an automatic time switch control device | Space ≤ 250 square feet | 0.15 |
| Automatic time switch control device | Spaces ≤ 250 square feet | 0.15 |
| Occupant–sensing device with a separate sensor for each space | Spaces ≤ 250 square feet enclosed by opaque floor–to–ceiling partitions; any size classroom, corridor, conference or waiting room | 0.30* |
| Occupant–sensing device with separate sensor for each space | Rooms of any size that are used exclusively for storage | 0.60* |
| Occupant–sensing device with separate sensor for each space | Spaces > 250 square feet | 0.10* |
| Occupant–sensing device with a separate sensor for each space used in conjunction with daylighting controls and separate sensor for each space | Spaces ≤ 250 square feet within a daylit area and enclosed by opaque floor–to–ceiling partitions | |
| Continuous dimming | | 0.40* |
| Multiple step dimming | | 0.35* |
| On/off | | 0.35* |
| Occupant–sensing device with a separate sensor for each space used in conjunction with daylighting controls and separate sensor for each space and lumen maintenance | Spaces ≤ 250 square feet within a daylit area and enclosed by opaque floor–to–ceiling partitions | 0.35* |
| Continuous dimming | | 0.45* |
| Multiple step dimming | | 0.40* |
| On/off | | 0.35* |
| Occupant–sensing device with a separate sensor for each space used with lumen maintenance | Spaces ≤ 250 square feet and enclosed by opaque floor–to–ceiling partitions | 0.35* |
| Occupant–sensing device with a separate sensor for each space used in conjunction with an automatic time switch control device | Spaces ≤ 250 square feet enclosed by opaque floor to ceiling partitions | 0.35* |
| Manual dimming system | Hotels, motels, restaurants, auditoriums, theaters | 0.10 |
| Multiscene programmable dimming system | Hotels, motels, restaurants, auditoriums, theaters | 0.20 |
| Occupant–sensing device with programmable multiscene dimming system | Hotels, motels, restaurants, auditoriums, theaters | 0.35 |

*Note to Table 63.1045: Adjustment factors for occupant–sensing devices are for devices with on–off operation. If devices are used that turn lights down, rather than off, the adjustment factor shall be multiplied by the percent of energy savings that occur while the lights are turned down.

(3) LIGHTING WATTAGE EXCLUDED. The watts of the following lighting applications may be excluded from the calculated interior lighting power of the building.

(a) Lighting for theatrical productions and other live performances, television broadcasting, audio-visual presentations, and those portions of entertainment facilities such as stage areas in hotel ballrooms, night clubs, dance floors, churches, and casinos where lighting is an essential technical element for the function performed, if the lighting is an addition to a general lighting system, and if the lighting is separately controlled and accessible only to authorized operators.

(b) Lighting for television, video and film production.

(c) Lighting for photographic processes.

(d) Lighting for the amusement and attraction areas in theme parks.

(e) Lighting for exhibits in areas such as exhibit, convention, and hotel function areas, if the lighting is an addition to a general lighting system, and if the lighting is separately controlled and accessible only to authorized operators.

(f) Specialized local lighting installed in nonlighting process equipment by its manufacturer used to illuminate process related tasks only.

(g) In buildings for medical and clinical care, examination and surgical lights, low-level night lights, and lighting integral to medical equipment.

(h) Lighting fixtures that are an integral part of refrigeration equipment.

(i) Nonretail display lighting required for art exhibits or displays in galleries, museums and monuments.

(j) Special lighting needed for research.

(k) Task lighting for plant growth or maintenance, if it is equipped with an automatic 24-hour time switch that has program back-up capabilities that prevent the loss of the switch's program and time setting for at least 10 hours if power is interrupted.

(L) Exit way or egress illumination that is normally off.

(m) Task lighting specifically designed for primary use by visually impaired, for lip reading, and by senior citizens.

(n) Lighting for informational signs and exit signs, but excluding commercial displays.

Note: See s. Comm 63.1005 (38) for definition of informational sign and s. Comm 63.1052 for exit sign requirements.

(o) Display window lighting in retail facilities provided the display area is separated from the store sales area by opaque ceiling-height partitions.

(p) Lighting in dwelling units that provides complete independent living facilities for one or more persons including permanent provisions for living, sleeping, eating, cooking, and sanitation.

(q) In restaurant buildings and areas, lighting for food warming or integral to food preparation equipment.

(r) Lighting equipment that is for sale.

(s) Lighting demonstration equipment in lighting education facilities.

(4) LIGHTING FIXTURES THAT ALLOW SUBSTITUTION OF SOURCES. The watts of track and other lighting fixtures that allow the substitution of low efficacy sources for high efficacy sources without altering the wiring of the fixture shall be determined by this subsection or other method approved by the department.

(a) *Track and busway line-voltage lighting.* The wattage of line-voltage lighting track and plug-in busway that allow the addition and relocation, or both, of luminaries without altering the wiring of the system shall be the specified wattage of the luminaries included in the system with a minimum of 30 W/lin ft.

(b) *Low-voltage lighting systems.* The wattage of low-voltage lighting track, cable conductor, rail conductor, and other flexible lighting systems that allow the addition or relocation, or both, without altering the wiring of the system shall be the specified wattage of the transformer supplying the system.

(c) *Incandescent medium base sockets.* The wattage for medium base fixtures shall be the listed lighting power capacity, in watts, of the fixture.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.1046 Calculation of interior lighting power allowance. The interior lighting power allowance shall be calculated using one of the methods in s. Comm 63.1047, 63.1048 or 63.1049 as applicable.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.1047 Complete building method. The complete building method may be used only on projects involving entire buildings where at least 80% of the areas of the building are the same type of use. Under this approach, the interior lighting power allowance is the lighting power density value in Table 63.1047 times the floor area of the entire building. Hotel, motel and residential buildings shall not use this method. Building uses that are not listed in Table 63.1047 shall be assigned the allowed lighting power density given under "All Others."

**Table 63.1047
Complete Building Method
Lighting Power Density Values (Watts/ft²)**

| <u>Type of Use</u> | <u>Allowed Lighting Power Density</u> |
|---|---------------------------------------|
| Banks and Financial Institutions | 1.7 |
| Correctional Housing | 1.4 |
| General Commercial and Industrial Work Buildings | 1.2 |
| Grocery Store | 1.8 |
| Industrial and Commercial Storage Buildings | 0.8 |
| Medical Buildings and Clinics | 1.5 |
| Office Building | 1.5 |
| Religious Worship, Auditorium, and Convention Centers | 2.0 |
| Restaurants | 1.5 |
| Retail and Wholesale Store | 2.6 |
| Schools | 1.8 |
| Theaters | 1.5 |
| All others | 0.8 |

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.1048 Area category method. Under the area category method, the interior lighting power allowance for the building is the sum of all allowed lighting powers for all areas in the building. The allowed lighting power for an area is the lighting power density in Table 63.1048 times the area. For purposes of the Area Category Method, an "Area" means all contiguous spaces that accommodate or are associated with a single one of the primary functions listed in Table 63.1048. Buildings with primary functions not listed in Table 63.1048 shall not use this method. Where areas are bounded or separated by interior partitions, the floor space occupied by those interior partitions shall not be included in any area. The area shall not include enclosed retail display windows with exempted lighting as described in s. Comm 63.1045 (3) (o). When the Area Category Method is used to calculate the interior lighting power allowance for an entire building, main entry lobbies, corridors, rest rooms, and support functions shall be treated as separate areas.

Table 63.1048
Area Category Method – Lighting Power
Density Values (Watts/ft²)

| <u>Primary Function</u> | <u>Allowed Lighting Power Density</u> |
|---|---------------------------------------|
| Auditorium | 2.0 |
| Auto Repair | 2.0 |
| Bank/Financial Institution | 1.8 |
| Classrooms | 2.0 |
| Convention, Conference and Meeting Centers | 1.6 |
| Corridors, Rest Rooms and Support Areas | 0.8 |
| Detention Facilities | 1.6 |
| Dining | 1.2 |
| Exhibit | 2.3 |
| Storage Garage | 0.2 |
| General Commercial and Industrial Work | 1.3 |
| Grocery | 2.0 |
| Guest Room or Dorm Room | 1.4 |
| Hotel Function | 2.3* |
| Industrial and Commercial Storage | 0.6 |
| Kitchen | 2.2 |
| Laboratory | 3.3 |
| Lobbies: | |
| Hotel Lobby | 2.3* |
| Main Entry Lobby | 1.6* |
| Malls, Arcades, and Atria | 1.2* |
| Medical and Clinical Care | 1.8 |
| Office | 1.6 |
| Precision Commercial and/or Industrial Work | 2.0 |
| Religious Worship | 2.2* |
| Retail Sales, Wholesale Showrooms | 2.8 |
| Theaters: | |
| Motion Picture | 1.0 |
| Performance | 1.5* |

* **Note to Table 63.1048:** The smallest of the following values may be added to the allowed lighting power listed in Table 63.1048 for ornamental chandeliers and sconces that are switched or dimmed on circuits different from the circuits for general lighting:

- a. 1 watt per square foot times the area of the space in which the chandelier or sconce is used; or
- b. The actual design wattage of the chandelier or sconce.

History: CR 00-179; cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.1049 Activity method. Under the activity method, the interior lighting power allowance for a building is determined by calculating a lighting power budget for each space in accordance with subs. (1) to (4) and summing them in accordance with sub. (5).

(1) The lighting power budget of each interior space shall be determined in accordance with the following equation:

$$LPB = A \times UPD \times AF$$

Where:

LPB = lighting power budget of the space, W

A = area of the space, ft²

UPD = unit power density, W/ft² [Table 63.1049]

AF = area factor of the room [Figure 63.1049]

(a) The UPD shall be selected from Table 63.1049. For applications to areas or activities other than those given, select values for the most similar areas or activities. The UPD for a multifunctional space shall be based on the lowest UPD of any of the activities of the space.

(b) The area factor (AF) shall be determined from Figure 63.1049 based on the room area (A_r) and ceiling height. The room area shall be calculated from the inside dimensions of the room. Rooms of identical ceiling height and activities may be evaluated as a group. The AF of a group of rooms shall be determined from the average area of these rooms.

The following equation gives the formula used in developing Fig. 63.1049.

$$AF = 0.2 + 0.8(1/0.9^n)$$

Where:

$$n = \left[\frac{10.21(CH - 2.5)}{\sqrt{A_r}} \right] - 1$$

AF= Area factor

CH= Average ceiling height, ft.

A_r= Room area, ft²

If AF < 1.0, then AF = 1.0

If AF > 1.8, then AF = 1.8

(2) For rooms serving multiple functions such as hotel banquet or meeting rooms and office conference or presentation rooms; an adjustment factor of 1.5 times the UPD may be used if a supplementary system is actually installed and meets all of the following conditions:

(a) The installed power for the supplementary system shall not be greater than 33% of the adjusted lighting power budget calculated for that space.

(b) Independent controls shall be installed for the supplementary system.

(3) In rooms containing multiple simultaneous activities, such as a large general office having separate accounting and drafting areas within the same room, the lighting power budget for the rooms shall be the weighted average of the activities in proportion to the areas being served.

(4) The activity of indoor sports areas shall be considered as an area 10 feet beyond the playing boundaries of the sport, not to exceed the total floor area of the indoor sports space less the spectator seating area.

(5) The interior lighting power allowance shall be calculated in accordance with the following equation. The interior lighting power allowance shall include a 0.20 W/ft² allowance for unlisted spaces.

$$ILPA = (LPB_1 + LPB_2 + \dots + LPB_n) + (0.20 \text{ W/ft}^2 \times \text{unlisted space area})$$

Where:

ILPA= interior lighting power allowance, W



Unlisted space area = GLA – Σ(LS), ft²

GLA= gross lighted area, ft²

LPB= lighting power budget, W

LS= listed space

Figure 63.1049 Area Factor

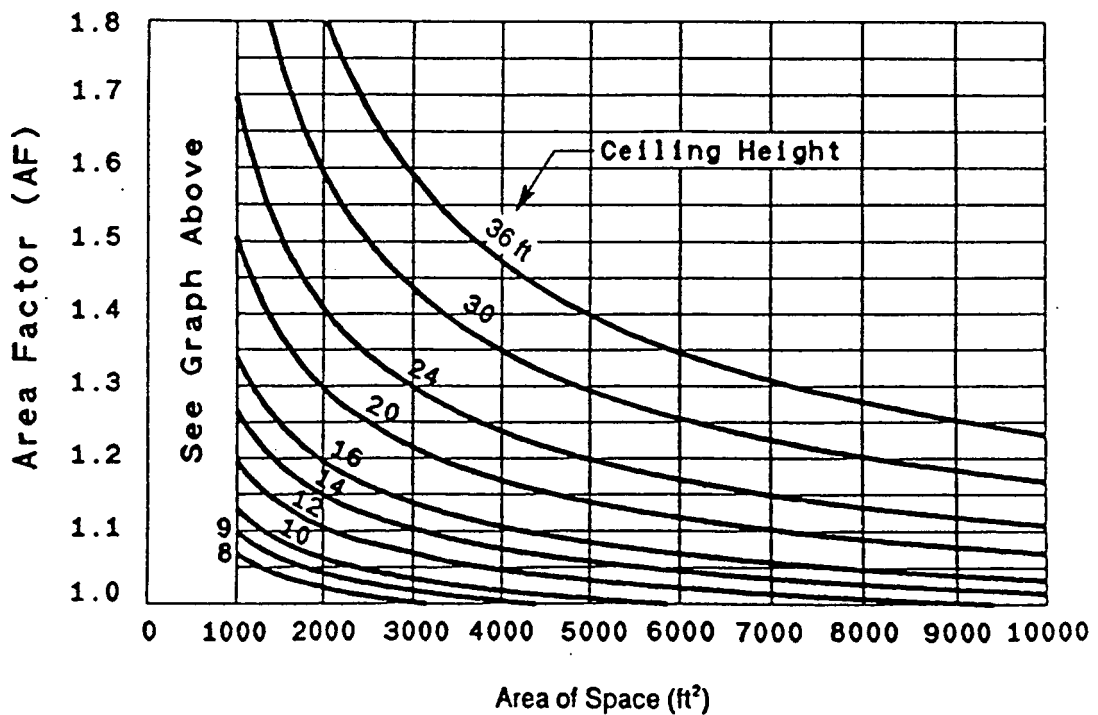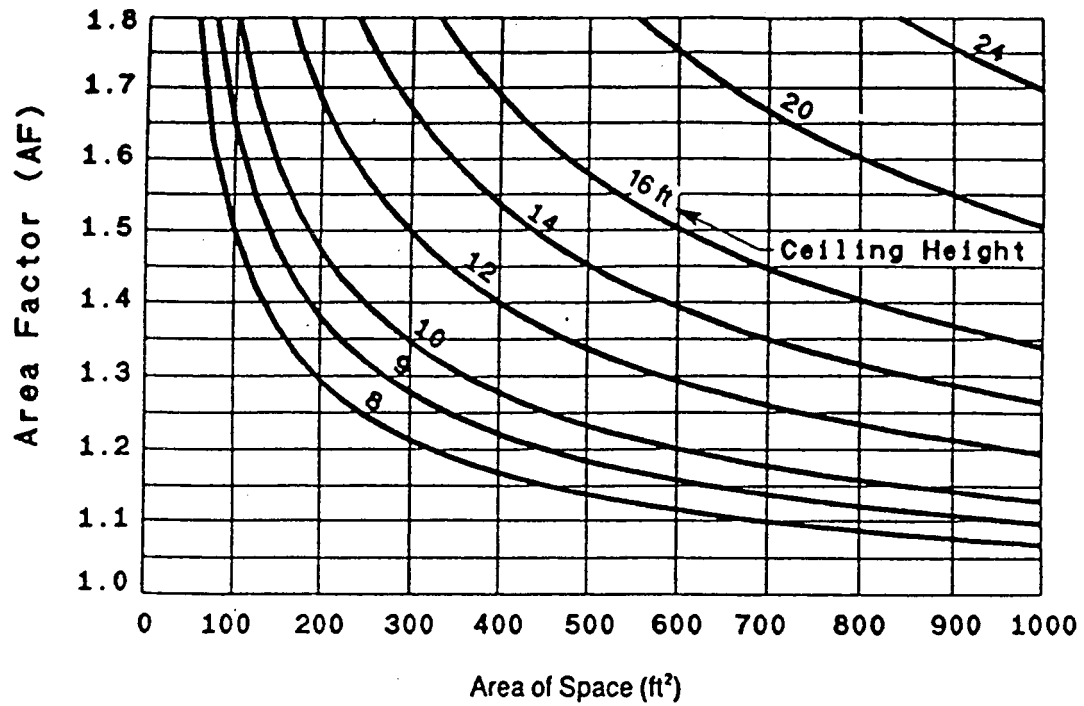

**Table 63.1049
Unit Power Densities**

| Part a – Common Activity Areas | | |
|---|---------------------------------|-------------|
| Activity/Area | UPD W/ft² | Note |
| Auditorium | 1.6 | a |
| Corridor | 0.8 | b |
| Classroom/Lecture Hall | 2.0 | |
| Electrical/Mechanical Equipment Room | | |
| General | 0.7 | b |
| Control Rooms | 1.5 | b |
| Food Service | | |
| Fast Food/Cafeteria | 1.3 | |
| Leisure Dining | 2.5 | c |
| Bar Lounge | 2.5 | c |
| Kitchen | 1.4 | |
| Recreation/Lounge | 0.7 | |
| Stair | | |
| Active Traffic | 0.6 | |
| Emergency Exit | 0.4 | |
| Toilet and Washroom | 0.8 | |
| Garage | | |
| Auto and Pedestrian Circulation Area | 0.3 | |
| Parking Area | 0.2 | |
| Laboratory | 3.0 | |
| Library | | |
| Audio/Visual | 1.1 | |
| Stack Area | 1.5 | |
| Card File and Cataloging | 1.6 | |
| Reading Area | 1.9 | |
| Lobby (General) | | |
| Reception and Waiting | 1.0 | |
| Elevator Lobbies | 0.8 | |
| Atrium (Multistory) | | |
| First Three Floors | 0.7 | |
| Each Additional Floor | 0.2 | |
| Locker Room and Shower | 0.8 | |
| Office Category 1 (<i>Enclosed offices, all open plan offices without partitions or with partitions* lower than 4.5 feet below the ceiling</i>) | | |
| Reading, Typing and Filing | 1.8 | d |
| Drafting | 2.6 | d |
| Accounting | 2.1 | d |
| Office Category 2 (<i>Open plan offices 900 square feet or larger with partitions* 3.5 to 4.5 feet below the ceiling. Offices less than 900 square feet shall use Category 1</i>) | | |

| | | |
|--|-----|---|
| Reading, Typing and Filing | 1.9 | b |
| Drafting | 2.9 | b |
| Accounting | 2.4 | b |
| Office Category 3 (<i>Open plan offices 900 square feet or larger with partitions* higher than 3.5 feet below the ceiling. Offices less than 900 square feet shall use Category 1</i>) | | |
| Reading, Typing and Filing | 2.2 | b |
| Drafting | 3.4 | b |
| Accounting | 2.7 | b |
| Common Activity Areas | | |
| Conference Meeting Room | 1.8 | a |
| Computer Office Equipment | 2.1 | |
| Filing, Inactive | 1.0 | |
| Mail Room | 1.8 | |
| Shop | | |
| Machinery | 2.5 | |
| Electrical/Electronic | 2.5 | |
| Painting | 1.6 | |
| Carpentry | 2.3 | |
| Welding | 1.2 | |
| Storage and Warehouse | | |
| Inactive Storage | 0.3 | |
| Active Storage, Bulky | 0.3 | |
| Active Storage, Fine | 1.0 | |
| Material Handling | 1.0 | |
| Unlisted Space | 0.2 | |

* Not less than 90% of all work stations shall be individually enclosed with partitions of at least the height described.

Part b – Specific Buildings

| Activity/Area | UPD W/ft² | Note |
|-------------------------------|---------------------------------|-------------|
| Airport, Bus and Rail Station | | |
| Baggage Area | 1.0 | |
| Concourse/Main Thruway | 0.9 | |
| Ticket Counter | 2.5 | |
| Waiting and Lounge Area | 1.2 | |
| Bank | | |
| Customer Area | 1.1 | |
| Banking Activity Area | 2.8 | |
| Barber and Beauty Parlor | 2.0 | |
| Church, Synagogue, Chapel | | |
| Worship/Congregational | 2.5 | |
| Preaching and Sermon | 2.7 | |
| Dormitory | | |
| Bedroom | 1.1 | |
| Bedroom With Study | 1.4 | |
| Study Hall | 1.8 | |

Part b – Specific Buildings (Continued)

| Activity/Area | UPD W/ft ² | Note |
|--|--------------------------|------|
| Fire and Police Department | | |
| Fire Engine Room | 0.7 | |
| Detention Dayroom | 1.5 | |
| Jail Cell | 1.2 | |
| Hospital/Nursing Home | | |
| Corridor | 1.3 | b |
| Dental Suite/Examination/Treatment | 1.6 | |
| Emergency | 2.3 | |
| Laboratory | 3.0 | |
| Lounge/Waiting Room | 0.9 | |
| Medical Supplies | 2.4 | |
| Nursery | 2.0 | |
| Nurse Station | 2.1 | |
| Occupational Therapy/Physical Therapy | 1.6 | |
| Patient Room | 1.4 | |
| Pharmacy | 1.7 | |
| Radiology | 2.1 | |
| Surgical and O.B. Suites | | |
| General Area | 2.1 | |
| Operating Room | 7.0 | |
| Recovery | 2.3 | |
| Hotel/Conference Center | | |
| Banquet Room/Multipurpose | 2.4 | a |
| Bathroom/Powder Room | 1.2 | |
| Guest Room | 1.4 | |
| Public Area | 1.2 | |
| Exhibition Hall | 2.6 | |
| Conference/Meeting | 1.8 | a |
| Lobby | 1.9 | |
| Reception Desk | 2.4 | |
| Laundry | | |
| Washing | 0.9 | |
| Ironing and Sorting | 1.3 | |
| Museum and Gallery | | |
| General Exhibition | 1.9 | |
| Inspection/Restoration | 3.9 | |
| Storage (Artifacts) | | |
| Inactive | 0.6 | |
| Active | 0.7 | |
| Post Office | | |
| Lobby | 1.1 | |
| Sorting and Mailing | 2.1 | |
| Service Station/Auto Repair | | |
| | 1.0 | |
| Theater | | |
| Performance Arts | 1.5 | |
| Motion Picture | 1.0 | |

| | |
|--|-------|
| Lobby | 1.5 |
| Retail Establishments | |
| Merchandising and Circulation Area – Applicable to all lighting, including accent and display lighting, installed in merchandising and cir- culation areas | |
| | 2.2 g |
| Mall Concourse | 1.4 |
| Retail Support Areas | |
| Tailoring | 2.1 |
| Dressing/Fitting Rooms | 1.4 |

Part c – Indoor Athletic Areas^{e,f}

| Activity/Area | UPD W/ft ² |
|--|--------------------------|
| Seating Area, All Sports | 0.4 |
| Badminton | |
| Club | 0.5 |
| Tournament | 0.8 |
| Basketball/Volleyball | |
| Intramural | 0.8 |
| College | 1.3 |
| Professional | 1.9 |
| Bowling | |
| Approach Area | 0.5 |
| Lanes | 1.1 |
| Boxing or Wrestling (platform) | |
| Amateur | 2.4 |
| Professional | 4.8 |
| Gymnasium | |
| General Exercising and Recreation Only | 1.0 |
| Handball/Raquetball/Squash | |
| Club | 1.3 |
| Tournament | 2.6 |
| Hockey, Ice | |
| Amateur | 1.3 |
| College or Professional | 2.6 |
| Skating Rink | |
| Recreational | 0.9 |
| Exhibition/Professional | 2.6 |
| Swimming | |
| Recreational | 0.9 |
| Exhibition | 1.5 |
| Under Water | 1.0 |
| Tennis | |
| Recreational (Class III) | 1.3 |
| Club/College (Class II) | 1.9 |
| Professional (Class I) | 2.6 |
| Tennis, Table | |
| Club | 1.0 |
| Tournament | 1.6 |

Notes for Table 63.1049:

- a A 1.5 power adjustment factor is applicable for multifunctional spaces.
 - b Area factor of 1.0 shall be used for these spaces.
 - c UPD includes lighting power required for clean-up purpose.
 - d Area factor shall not exceed 1.55.
 - e Area factor of 1.0 shall be used for all indoor athletic spaces.
 - f Facilities that are used for more than one level of play shall have appropriate switching between the different levels specified in Table 63.1049. Dimming shall not be used to accomplish the reduction in illumination. The illumination at all levels shall be uniform.
 - g Where lighting equipment is specified to be installed to highlight specific merchandise in addition to lighting equipment specified for general lighting and is switched or dimmed on circuits different from the circuits for general lighting, the smaller of the actual wattage of the lighting equipment installed specifically for merchandise, or 0.8 W/ft² times the floor area of the display area shall be added to the interior lighting power determined in accordance with this line item.
- History:** CR 00-179; cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.1050 Lighting controls that must be installed. (1) AREA CONTROLS. (a) Except as provided in pars. (c) and (d), each interior area enclosed by ceiling-height partitions shall have an independent switching or control device. This switching or control device shall comply with all of the following:

1. Be readily accessible.
2. Located so that a person using the device can see the lights or area controlled by that switch, or so that the area being lit is annunciated.
3. Be manually operated, or automatically controlled by an occupant-sensing device that meets the requirements of s. Comm 63.1051 (4).

(b) Other devices may be installed in conjunction with the switching or control device required by par. (a) provided that they:

1. Permit the required switching or control device to override the action of the other devices; and
2. Reset the mode of any automatic system to normal operation without further action.

(c) Up to one-half watt per square foot of lighting in any area within a building that must be continuously illuminated for reasons of building security or emergency egress are exempt from par. (a) if:

1. The area is designated a security or emergency egress area on the plans and specifications submitted to the department; and
2. The area is controlled by switches accessible only to authorized personnel.

(d) Public areas with switches that are accessible only to authorized personnel are exempt from the area control requirements of par. (a).

(2) CONTROLS TO REDUCE LIGHTING. (a) Except as provided in par. (b), the general lighting of any enclosed interior space 100 square feet or larger in which the connected lighting load exceeds 1.2 watts per square foot for the space as a whole, and that has more than one light source or luminaire, shall be controlled so that the load for the lights may be reduced by at least one-half while maintaining a reasonably uniform level of illuminance throughout the area. A reasonably uniform reduction of illuminance shall be achieved by one of the following:

1. Controlling all lamps or luminaires with dimmers.
2. Dual switching of alternate rows of luminaires, alternate luminaires, or alternate lamps.
3. Switching the middle lamps of three lamp luminaires independently of the outer lamps.
4. Switching each luminaire or each lamp.
5. Other methods approved by the department.

(b) The requirements of par. (a) do not apply to any of the following:

1. Lights in areas that are controlled by an occupant-sensing device that meets the requirements of s. Comm 63.1051 (4).
2. Lights in corridors.

3. Lights in areas that are controlled by an automatic time switch control device that has a timed manual override available at each switch location required by sub. (1), and that controls only the lights in that area enclosed by ceiling height partitions.

(3) DAYLIT AREAS. (a) Except as provided in par. (b), daylit areas in any interior enclosed space greater than 250 square feet and a lighting density more than 1.2 W/ft² shall meet the requirements of subs. 1. and 2.

1. Such areas shall have at least one control that complies with all of the following:

- a. Controls only luminaires in the daylit area.
- b. Controls at least 50% of the lamps or luminaires in the daylit area, in a manner described in sub. (2) (a) 1. to 5., independently of all other lamps or luminaires in the enclosed space. The other luminaires in the enclosed space may be controlled in any manner allowed by sub. (2) (a) 1. to 5.

2. Such areas shall have controls that control the luminaires in each vertically daylit area separately from the luminaires in each horizontally daylit area.

(b) The requirements of this subsection do not apply to any of the following:

1. Daylit areas where the effective aperture of glazing is equal or less than 0.1 for vertical glazing and 0.01 for horizontal glazing.
2. Daylit areas where existing adjacent structures or natural objects obstruct daylight to the extent that effective use of daylighting is not feasible.

(4) SHUT-OFF CONTROLS. (a) Except as provided in par. (b), for every floor or metered space, all interior lighting systems shall be equipped with at least one separate automatic control to shut off the lighting. This automatic control shall meet the requirements of s. Comm 63.1051 and may be an occupancy sensor, automatic time switch, or other device capable of automatically shutting off the lighting.

(b) The requirements of par. (a) do not apply to any of the following:

1. Buildings or separately metered spaces of less than 5,000 square feet of space.
2. Where the system is serving an area that must be continuously lit, or where the use of the space prohibits the use of a pre-established lighting program.

Note: Service equipment rooms as specified in NEC 110-26 (3) (d) are covered by this exception.

3. In residential buildings, hotels and motels, lighting of corridors, guest rooms, and lodging quarters.

4. Up to one-half watt per square foot of lighting in any area within a building that must be continuously illuminated for reasons of building security or emergency egress, if:

- a. The area is designated a security or emergency egress area on the plans and specifications submitted to the department; or
- b. The area is controlled by switches accessible only to authorized personnel.

(c) If an automatic time switch control device is installed to comply with par. (a), it shall incorporate an override switching device that complies with all of the following:

1. Is readily accessible.
2. Is located so that a person using the device can see the lights or the area controlled by that switch, or so that the area being lit is annunciated.
3. Is manually operated.
4. Allows the lighting to remain on for no more than two hours when an override is initiated.

5. Controls an area not exceeding 20,000 square feet in malls, auditoriums, gymnasiums, single tenant retail spaces, factories, warehouses and arenas, and not exceeding 5,000 square feet for other uses.

6. Two overrides may be provided for a maximum of 10,000 square feet if the lighting is dual level controlled in accordance with sub. (2) (a) 2. or 3.

(5) DISPLAY LIGHTING CONTROLS. Display lighting shall be separately switched on circuits that are 20 amps or less.

(6) EXTERIOR LIGHTING CONTROLS. Except in lighting in parking garages, tunnels, and large covered areas that require illumination during daylight hours, exterior lighting shall be controlled by a directional photocell or astronomical time switch that automatically turns off the exterior lighting when daylight is available. Time switches shall be capable of maintaining the correct time during a power outage lasting up to 10 hours.

(7) HOTEL AND MOTEL GUEST ROOM CONTROLS. Hotel and motel guest rooms or suites excluding bathrooms shall have one or more master switches at the main entry door or at the entry door of each room that turn off all permanently wired lighting fixtures and switched receptacles in the room or suite.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02; CR 04-016: am. (6) Register December 2004 No. 588, eff. 1-1-05.

Comm 63.1051 Requirements for lighting control devices. Automatic time switch control devices, occupant-sensing devices, automatic daylighting control devices, lumen maintenance control devices, or interior photocell sensor devices that are used to justify a wattage reduction factor in the calculation of the actual internal lighting power in s. Comm 63.1045 (2) shall be approved for compliance with all of the applicable requirements of subs. (1) to (7) and shall be installed in compliance with sub. (8). Approval of devices shall be obtained via the material approval program in accordance with ch. Comm 61 or via manufacturer certification to the California Energy Commission.

Note: Information on California Energy Commission Certification may be obtained from the California Energy Commission, Energy Efficiency and Demand Analysis Division, 1516 9th Street, MS-25, Sacramento, CA 95814, (916) 654-4080. A list of approved control devices is available on the internet at <ftp://38.144.192.166/pub/efftech/appliance/>.

(1) ALL DEVICES: INSTRUCTIONS FOR INSTALLATION AND CALIBRATION. The manufacturer shall provide step-by-step instructions for installation and start-up calibration of the device.

(2) ALL DEVICES: STATUS SIGNAL. The device shall have an indicator that visibly or audibly informs the device operator that it is operating properly, or that it has failed or malfunctioned, except for photocell sensors or other devices where a status signal is infeasible because of inadequate power.

(3) AUTOMATIC TIME SWITCH CONTROL DEVICES. Automatic time switch control devices shall comply with all of the following:

(a) Be capable of programming different schedules for weekdays and weekends.

(b) Incorporate an automatic "holiday shut-off" feature that turns off all loads for at least 24 hours, then resumes the normally scheduled operation.

(c) Have program backup capabilities that prevent the loss of the device's program and time setting for at least 10 hours if power is interrupted.

(4) OCCUPANT-SENSING DEVICES. Occupant-sensing devices shall be capable of automatically controlling all the lights in an area no more than 30 minutes after the area has been vacated. In addition, ultrasonic and microwave devices shall have a built-in mechanism that allows calibration of the sensitivity of the device to room movement in order to reduce the false sensing of occupants and shall comply with either par. (a) or (b), as applicable:

(a) If the device emits ultrasonic radiation as a signal for sensing occupants within an area, the device shall comply with all of the following:

1. Have had an Initial Report submitted to the Bureau of Radiological Health, Federal Food and Drug Administration, under 21 CFR 1002.10.

2. Emit no audible sound.

3. Not emit ultrasound in excess of the decibel (dB) values given in Table 63.1051 measured no more than 5 feet from the source on axis.

**Table 63.1051
Maximum Ultrasound Emissions**

| Midfrequency of Sound Pressure Third-Octave Bank (in kHz) | Maximum dB Level within Third-Octave B and (in dB reference 20 micropascals) |
|---|--|
| less than 20 | 80 |
| 20 or more to less than 25 | 105 |
| 25 or more to less than 31.5 | 110 |
| 31.5 or more | 115 |

(b) If the device emits microwave radiation as a signal for sensing occupants within area, the device shall comply with all of the following:

1. Comply with all applicable provisions in 47 CFR Part 5, and have an approved Federal Communications Commission identification number that appears on all units of the device and that has been submitted to the department.

2. Not emit radiation in excess of 1 milliwatt per square centimeter measured at no more than 5 centimeters from the emission surface of the device.

3. Have permanently affixed to it installation instructions recommending that it be installed at least 12 inches from any area normally used by room occupants.

(5) AUTOMATIC DAYLIGHTING CONTROL DEVICES. Automatic daylighting control devices shall comply with all of the following:

(a) Be capable of reducing the light output of the general lighting of the controlled area by at least one-half while maintaining a uniform level of illuminance throughout the area.

(b) If the device is a dimmer, provide electrical outputs to lamps for reduced flicker operation through the dimming range and without causing premature lamp failure.

(c) If the device is a stepped dimming system, incorporate time delay circuits to prevent cycling of light level changes of less than three minutes.

(d) If the device uses step switching with separate "on" and "off" settings for the steps, have sufficient separation or deadband of "on" and "off" points to prevent cycling.

(e) Have provided by the manufacturer step-by-step instructions for installation and start-up calibration to design foot-candle levels.

(6) LUMEN MAINTENANCE CONTROL DEVICES. Lumen maintenance control devices shall comply with all of the following:

(a) Be capable of reducing the light output of the general lighting of the controlled area by at least 30% while maintaining a uniform illuminance throughout the area.

(b) Provide electrical outputs to lamps for reduced flicker operation through the dimming range and without causing premature lamp failure.

(c) Incorporate an alarm, either audible or visible, to announce when a specified setpoint of lumens or watts has been reached.

(d) Have provided by the manufacturer step-by-step instructions for installation and start up calibration to design foot-candle levels.

(7) INTERIOR PHOTOCCELL SENSOR DEVICES. Interior photocell sensors shall not have a mechanical slide cover or other device that permits easy unauthorized disabling of the control, and shall not be incorporated into a wall-mounted occupant-sensing device.

(8) INSTALLATION IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS. If an automatic time switch control device, occupant-sensing device, automatic daylighting control device, lumen maintenance control device, or interior photocell sensor device is installed, it shall comply with both pars. (a) and (b).

(a) The device shall be installed in accordance with the manufacturer's instructions.

(b) Automatic daylighting control devices and lumen maintenance control devices shall:

1. Be installed so that automatic daylighting control devices control only luminaries within the daylit area; and

2. Have photocell sensors that are either ceiling mounted or located so that they are accessible only to authorized personnel, and that are located so that they maintain adequate illumination in the area according to the designer's or manufacturer's instructions.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.1052 Exit signs. Exit signs shall have an installed wattage of 20 watts or less.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02.

Comm 63.1053 Reduction of single lamp ballasts. The following luminaries located within the same room shall be tandem wired or provided with three-lamp ballasts:

(1) One-lamp or three-lamp fluorescent luminaries recess-mounted within 10 feet center-to-center of each other.

(2) One-lamp or three-lamp fluorescent luminaries pendant- or surface-mounted within one foot edge-to-edge of each other.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02.

Part 6 — Nondepletable Energy Source

Comm 63.1060 Buildings utilizing solar, geothermal, wind or other nondepletable energy source. Any building, or portion thereof, utilizing any nondepletable energy source shall meet all the requirements in IECC section 806.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02.

Part 7 — System Analysis Design

Comm 63.1070 System analysis design. A building designed using system analysis design shall comply with IECC section 806.

History: CR 00-179: cr. Register December 2001 No. 552, eff. 7-1-02.